


7. ALL MATERIALS AND CONSTRUCTION METHODS MUST CORRESPOND TO THE CURRENT PELL PUBLIC WORKS STANDARDS AND SPECIFICATIONS.
8. ALL UTILITY SERVICE MATERIALS 100mm+ AND LARGER MUST BE PVC DR-18 PER AWWA C900-16, SIZE 50mm+ AND SMALLER MUST BE SOFT COPPER TYPE "K" PER ASTM B88-49.
9. WATERMANS AND/OR SERVICES ARE TO HAVE A MINIMUM COVER OF 1.7m WITH A MINIMUM HORIZONTAL SPACING OF 1.0m FROM THEMSELVES AND OTHER UTILITIES.
10. PROVISIONS FOR FLUSHING WATER LINE PRIOR TO TIEING, MUST BE PROVIDED WITH AT LEAST A 50mm+ DIAMETER FLUSH LINE TO THE MAIN LINE. THE FLUSH LINE SHALL BE 1.0m+ LONGER THAN THE MAIN LINE AS THE LINE. THEY MUST ALSO BE HOSED OR PIPES TO ALLOW WATER TO DRAIN INTO A PARKING LOT OR DRAINAGE DITCH. THE FLUSH LINE SHALL BE 1.0m+ LONGER THAN THE MAIN LINE.
11. ALL CURB STOPS TO BE 3.0m OFF THE FACE OF THE BUILDING UNLESS NOTED OTHERWISE.
12. HYDRANT AND VALVE SET TO REGION STANDARD 1-6-1 DIMENSION "A" (0.7m) & "B" (0.9m) AND TO HAVE 1.0m+ CLEARANCE.
13. WATERMANS TO BE INSTALLED TO GRADES SHOWN ON APPROVED SITE PLAN. COPY OF GRADE SHEET MUST BE SUBMITTED WITH THE CONTRACT. ALL UTILITY LOCATIONS SHALL BE MARKED WITH 100mm+ DIAMETER PIPES.
14. WATERMANS MUST HAVE A VERTICAL CLEARANCE OF 0.3m OVER AND 0.5m UNDER SEWER AND ALL OTHER UTILITIES WITHIN 1.0m.
15. ALL PROPOSED WATER PIPING MUST BE ISOLATED FROM EXISTING LINES IN ORDER TO ALLOW INDEPENDENT PRESSURE TESTING AND DISCHARGING FROM EXISTING SYSTEMS.
16. ALL UTILITY LOCATIONS SHALL BE MARKED WITH 100mm+ DIAMETER PIPES. ALL SHALL BE ARRANGED THROUGH THE REGIONAL INSPECTION AND/OR, OR BY CONTACTING THE OPERATIONS AND MAINTENANCE DEPARTMENT.
17. ALL EXISTING UTILITIES IN THE FIELD SHALL BE IDENTIFIED AND MARKED BY THE CONTRACTOR.
18. THE CONTRACTOR SHALL BE SOLE RESPONSIBLE FOR LOCATES, EXPOSING, SUPPORTING AND PROTECTING OF ALL UNDERGROUND UTILITIES AND STRUCTURES EXISTING IN THE LINE OF CONSTRUCTION IN THE FIELD. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING UTILITIES AND STRUCTURES RESULTING FROM DAMAGE TO SAME.
19. THE CONTRACTOR SHALL BE RESPONSIBLY RESPONSIBLE TO GIVE A WRITTEN NOTICE TO UTILITIES PRIOR TO CROSSING SUCH UTILITIES. FOR THE PURPOSE OF INSPECTION BY THE CONCERNED UTILITY. THIS INSPECTION WILL BE CONDUCTED PRIOR TO THE COMMENCEMENT OF THE CONSTRUCTION, WITH THE CONTRACTOR RESPONSIBLE FOR ALL COSTS ARISING FROM SUCH INSPECTION.
20. ALL PROPOSED WATER PIPING MUST BE ISOLATED THROUGH A TEMPORARY CONNECTION THAT SHALL INCLUDE AN ISOLATING VALVE AND BE INSTALLED TO THE GRADES SHOWN ON THE APPROVED SITE PLAN. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PREVENTION OF THE ACTIVE DISTRIBUTION SYSTEM, CONFORMING TO REGION OF PELL STANDARDS 1-7-7 OR R-1-7-7.

PRIVATE WATER TANK FOR FIRE PROTECTION WITH BOOSTER PUMP TO BE PROVIDED IN BUILDING MECHANICAL ROOM PER MECHANICAL DESIGN AND SPECIFICATIONS.

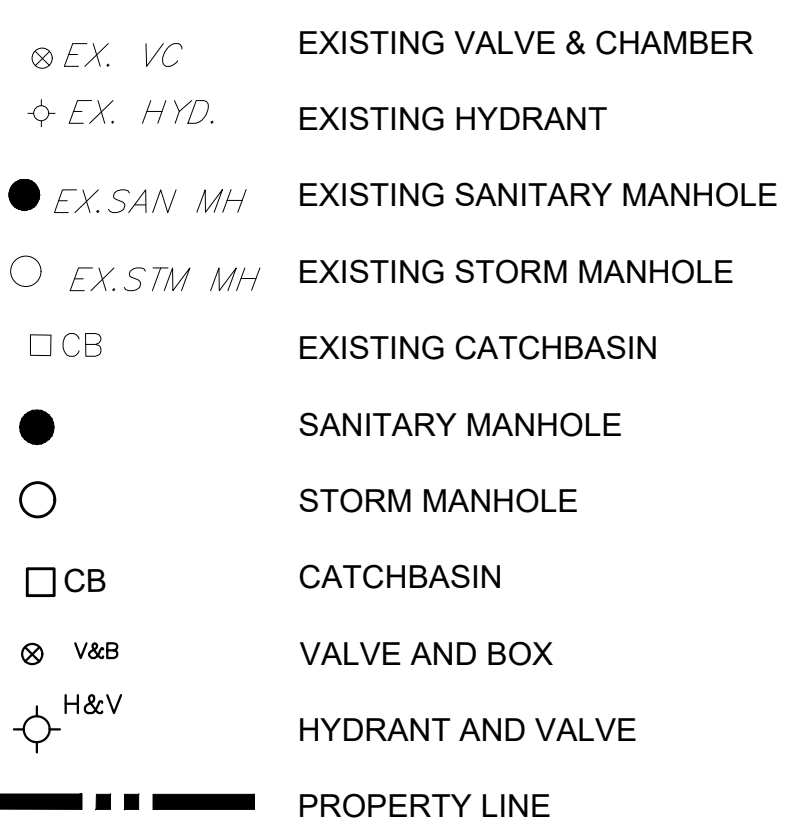

SEE DWG. SS8

STORMWATER
MANAGEMENT
POND C. REFER
TO DWG. SW2
FOR DETAILS.

ENVIRONMENTAL AREA

| | | | | | | | |
|--|----------------------|------|------------|------|--|--|--|
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| I | SUBMITTED FOR S.P.A. | J.G. | FEB. 24/21 | | | | |
| No. | REVISIONS TO DRAWING | BY | DATE | APPR | | | |
| ALL PREVIOUS ISSUES OF THIS DRAWING ARE SUPERSEDED | | | | | | | |
| CLIENT | | | | | | | |

TRIBAL PARTNERS CANADA INC.



12892 DIXIE ROAD

SITE SERVICING PLAN

11511



100 Commerce Valley Dr. West, Thornhill, ON Canada L3T 0A1
 Tel: 905.880.4403 Fax: 905.883.6055 www.100commercevalley.com

| | |
|--|--|
| | |
|--|--|

[illegible][illegible]

| | Mean | SD | 95% CI |
|---|------|------|-------------|
| Age at baseline | 60.7 | 8.1 | (54.5-66.9) |
| Female sex | 50.0 | 50.0 | (0-100) |
| Married | 50.0 | 50.0 | (0-100) |
| White ethnicity | 50.0 | 50.0 | (0-100) |
| High education | 50.0 | 50.0 | (0-100) |
| Smoking status | 50.0 | 50.0 | (0-100) |
| Alcohol consumption | 50.0 | 50.0 | (0-100) |
| Physical activity | 50.0 | 50.0 | (0-100) |
| Depression | 50.0 | 50.0 | (0-100) |
| Stroke | 50.0 | 50.0 | (0-100) |
| Hypertension | 50.0 | 50.0 | (0-100) |
| Diabetes | 50.0 | 50.0 | (0-100) |
| Cholesterol | 50.0 | 50.0 | (0-100) |
| Blood pressure | 50.0 | 50.0 | (0-100) |
| Systolic blood pressure | 50.0 | 50.0 | (0-100) |
| Diastolic blood pressure | 50.0 | 50.0 | (0-100) |
| Total cholesterol | 50.0 | 50.0 | (0-100) |
| HDL cholesterol | 50.0 | 50.0 | (0-100) |
| LDL cholesterol | 50.0 | 50.0 | (0-100) |
| Fasting glucose | 50.0 | 50.0 | (0-100) |
| Hemoglobin A1c | 50.0 | 50.0 | (0-100) |
| Creatinine | 50.0 | 50.0 | (0-100) |
| eGFR | 50.0 | 50.0 | (0-100) |
| Urine albumin | 50.0 | 50.0 | (0-100) |
| Proteinuria | 50.0 | 50.0 | (0-100) |
| Cardiovascular disease | 50.0 | 50.0 | (0-100) |
| Heart failure | 50.0 | 50.0 | (0-100) |
| Myocardial infarction | 50.0 | 50.0 | (0-100) |
| Angina pectoris | 50.0 | 50.0 | (0-100) |
| Peripheral vascular disease | 50.0 | 50.0 | (0-100) |
| Atrial fibrillation | 50.0 | 50.0 | (0-100) |
| Valvular heart disease | 50.0 | 50.0 | (0-100) |
| Coronary artery disease | 50.0 | 50.0 | (0-100) |
| Ischemic stroke | 50.0 | 50.0 | (0-100) |
| Transient ischemic attack | 50.0 | 50.0 | (0-100) |
| Stroke with unknown etiology | 50.0 | 50.0 | (0-100) |
| Stroke without known etiology | 50.0 | 50.0 | (0-100) |
| Stroke with known etiology | 50.0 | 50.0 | (0-100) |
| Stroke without clinical evidence | 50.0 | 50.0 | (0-100) |
| Stroke with clinical evidence | 50.0 | 50.0 | (0-100) |
| Stroke with radiological evidence | 50.0 | 50.0 | (0-100) |
| Stroke without radiological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with both clinical and radiological evidence | 50.0 | 50.0 | (0-100) |
| Stroke without either clinical or radiological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with clinical evidence but no radiological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with radiological evidence but no clinical evidence | 50.0 | 50.0 | (0-100) |
| Stroke with both clinical and radiological evidence but no histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke without either clinical or radiological evidence but with histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with clinical evidence but no radiological or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with radiological evidence but no clinical or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with both clinical and radiological evidence but no histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke without either clinical or radiological evidence but with histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with clinical evidence but no radiological or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with radiological evidence but no clinical or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with both clinical and radiological evidence but no histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke without either clinical or radiological evidence but with histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with clinical evidence but no radiological or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with radiological evidence but no clinical or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with both clinical and radiological evidence but no histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke without either clinical or radiological evidence but with histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with clinical evidence but no radiological or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with radiological evidence but no clinical or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with both clinical and radiological evidence but no histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke without either clinical or radiological evidence but with histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with clinical evidence but no radiological or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with radiological evidence but no clinical or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with both clinical and radiological evidence but no histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke without either clinical or radiological evidence but with histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with clinical evidence but no radiological or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with radiological evidence but no clinical or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with both clinical and radiological evidence but no histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke without either clinical or radiological evidence but with histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with clinical evidence but no radiological or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with radiological evidence but no clinical or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with both clinical and radiological evidence but no histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke without either clinical or radiological evidence but with histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with clinical evidence but no radiological or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with radiological evidence but no clinical or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with both clinical and radiological evidence but no histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke without either clinical or radiological evidence but with histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with clinical evidence but no radiological or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with radiological evidence but no clinical or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with both clinical and radiological evidence but no histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke without either clinical or radiological evidence but with histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with clinical evidence but no radiological or histopathological evidence | 50.0 | 50.0 | (0-100) |
| Stroke with radiological evidence but no clinical or histopathological evidence | 50.0 | | |

[illegible]

| | | |
|-----|--------|--------|
| REQ | ORDERS | QUOTES |
|-----|--------|--------|

| | | |
|------|-----------|------|
| J.G. | 10/12 CAD | A.V. |
| | DATE | |

| | |
|-----------|------------|
| 1:500 | FEBRUARY |
| ST NUMBER | DWG NUMBER |

| | |
|-----------|----|
| 201-11545 | SS |
|-----------|----|
