

FUNCTIONAL SERVICING REPORT

CHICKADEE LANE ROUNDING OUT AREA "B"

13935, 13951 AND 13999 CHICKADEE LANE, 0 KING STREET

AND

550, 600 AND 615 GLASGOW ROAD

PART OF LOT 10, CONCESSION 5 AND 6

TOWN OF CALEDON

PREPARED FOR

ZANCOR HOMES (BOLTON) LTD.

MARCH 26TH 2019

REVISED JANUARY 4TH 2021



CANDEVCON LIMITED
CONSULTING ENGINEERS & PLANNERS

TEL (905) 794-0600 FAX (905) 794-0611

PROJECT NO. W17003

FUNCTIONAL SERVICING REPORT

CHICKADEE LANE ROUNDING OUT AREA "B"

13935, 13951 AND 13999 CHICKADEE LANE, 0 KING STREET

AND

550, 600 AND 615 GLASGOW ROAD

PART OF LOT 10, CONCESSION 5 AND 6

TOWN OF CALEDON

PREPARED FOR

ZANCOR HOMES (BOLTON) LTD.



MARCH 26TH 2019

REVISED JANUARY 4TH 2021



CONTENTS

	Page
1. INTRODUCTION	1
2. PROPOSED DEVELOPMENT PLANS	3
3. EXISTING CONDITIONS	4
3.1 General	4
3.2 Topography, Drainage and Natural Features	4
4. BACKGROUND TECHNICAL STUDIES	5
4.1 Master Environmental Servicing Plan	5
4.2 Infrastructure Servicing Study (IS	5
4.3 Physiography and Geotechnical Conditions	5
4.4 Storm Drainage	6
5. SANITARY AND WATER SERVICING	7
5.1 Sanitary	7
5.1.1 Existing Sanitary Services	7
5.1.2 Proposed Sanitary Servicing	7
5.2 Water	8
5.2.1 Existing Water Network	8
5.2.2 Proposed Watermain System	8
6. STORM DRAINAGE AND STORMWATER MANAGEMENT	10
6.1 General	10
6.2 Storm Sewer System	10
6.3 Stormwater Management	11
6.3.1 General	11
6.3.2 Stormwater Management Pond - Storage Volumes	12
6.4 Water Balance	13
7. SEDIMENT AND EROSION CONTROL	15

CONTENTS (CONT'D)

TABLES

	Page
TABLE I Estimated Water Demand	9
TABLE II Proposed Stormwater Management Pond Outflow Rates	11
TABLE III Stormwater Management Pond - Preliminary Design Data	12
TABLE IV Stormwater Management Pond Storage vs Release Rates Comparisons	12

DRAWINGS

DRAWING PS-1 Rev. 1	Preliminary Servicing Plan
DRAWING SA-1 Rev. 1	Sanitary Drainage Area Plan
DRAWING ST-1 Rev. 1	Storm Drainage Area Plan
DRAWING IT-1 Rev. 1	Infiltration Plan
DRAWING SWM-1	Stormwater Management Pond - Plan and Sections

REFERENCE DRAWINGS

Draft Plan of Subdivision prepared by Humphries Planning Group Inc., Drawing A1 dated March 2nd 2019, Revised December 28th 2020

CONTENTS (CONT'D)

APPENDICES

APPENDIX “A”	Excerpts from Comprehensive Environmental Impact Study and Management Plan, Palmer Environmental Consulting Group Inc. dated December 29th 2020 (Project No. 170163) Palmer Memorandum dated August 3rd 2020, Chickadee Lane Stormwater Management Options assessment, Alternative Outlet Evaluation
APPENDIX “B”	Geotechnical Investigation for Proposed Residential Development, Chickadee Lane and Glasgow Road, Town of Caledon, Soil Engineers Ltd., dated July 2018, Reference No. 1801-S032 Supplementary Slope Stability Assessment prepared by Soil Engineers Ltd. Dated August 31st 2020, Reference No. 1801-S032
APPENDIX “C”	Hydrogeological Investigation - Chickadee Lane Rounding Out Area “B”, Bolton Ontario, Palmer Environmental Consulting Group Inc., dated October 12th 2018, Project No. 170163
APPENDIX “D”	Figure 4 Subwatershed Boundaries - Humber River Watershed, Toronto and Region Conservation
APPENDIX “E”	Region of Peel, Figures 5 and 8, Bolton Residential Expansion Study, Infrastructure Report, Blue Plan Engineering Consultants Limited, June 16th 2014
APPENDIX “F”	Sanitary Sewer Design Sheets for Proposed Subdivision; Region of Peel <i>Connections Multi-Use Demand Tables</i>
APPENDIX “G”	Hydrant Flow Test Region of Peel Connections Multi-Use Demand Table
APPENDIX “H”	Storm Sewer Design Sheets Stormwater Management Calculations - OTTHYMO Modelling Water Balance Calculations

1. INTRODUCTION

The subject lands are comprised of several land parcels located at the northwest, southwest and southeast corners of Glasgow Road and Chickadee Lane, east of Emil Kolb Parkway in the Town of Caledon. In total, the lands comprises 10.04 ha and are municipally known as 13935, 13951, 13977 and 13999 Chickadee Lane, 0 King Street, and 550, 600 and 615 Glasgow Road, with a legal description of Part of Lot 10, Concessions 5 and 6, Town of Caledon. Figure 1 illustrates the Site Location.

This report has been prepared in support of a request for amendment to the Town of Caledon Official Plan and Zoning By-Law as well as Draft Plan of Subdivision approval on behalf of Zancor Homes (Bolton) Ltd. and addresses sanitary, water and storm drainage servicing and stormwater management.

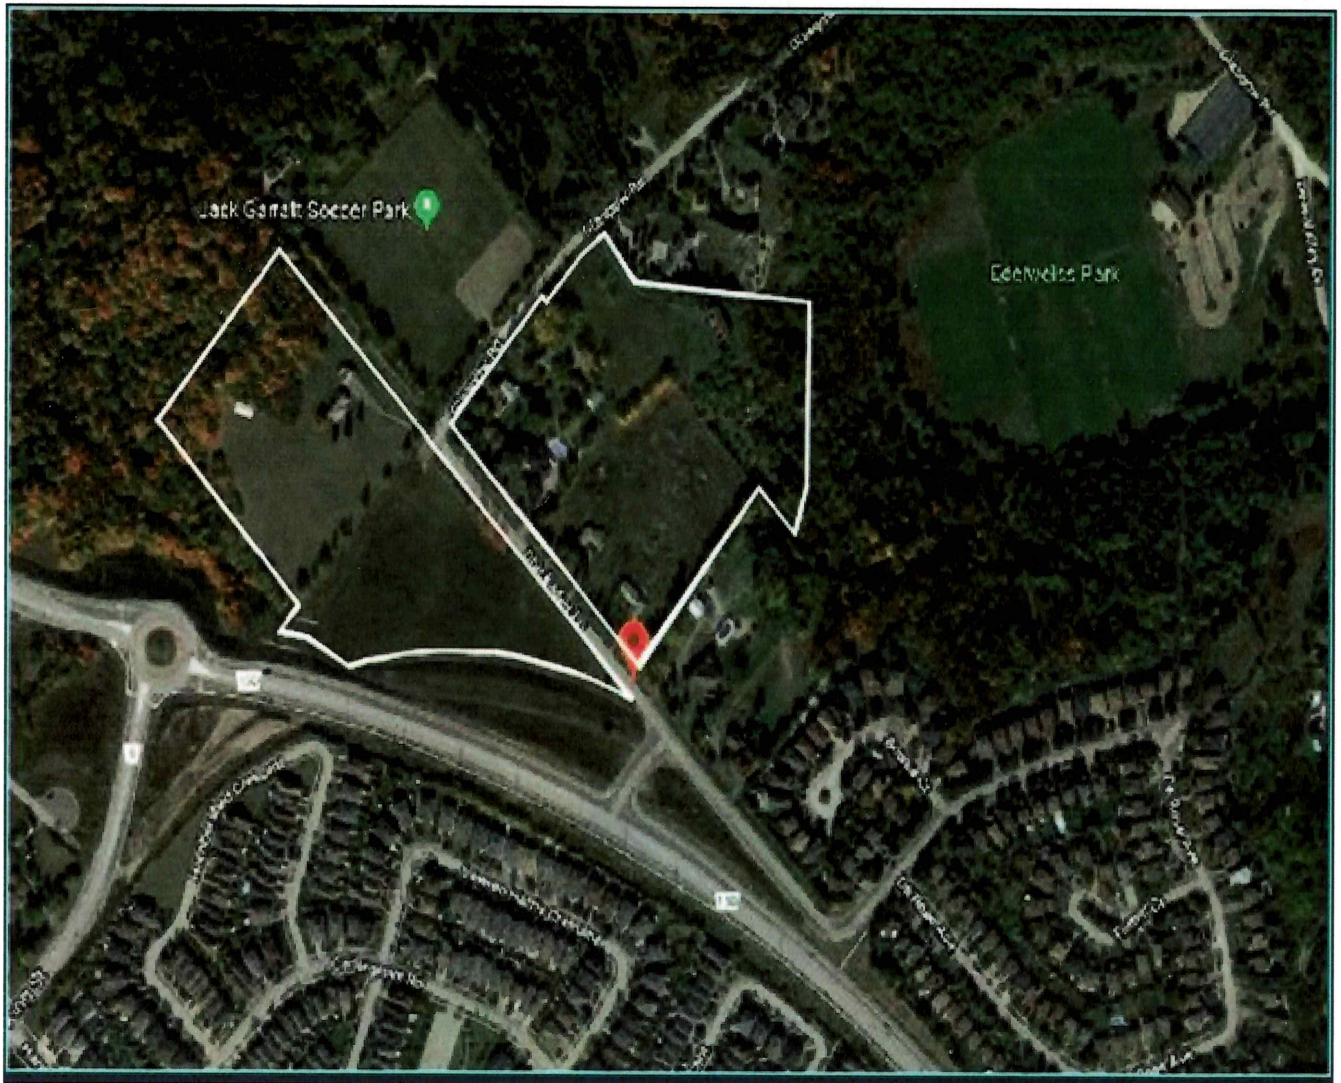


Figure 1

1. INTRODUCTION (CONT'D)

Zancor Homes (Bolton) Ltd. filed an appeal of Region of Peel Official Plan Amendment 30 (ROPA 30). By decision dated October 29th 2020, the Local Planning Appeal Tribunal (LPAT) granted approval of the appeal thereby including the subject lands within the Bolton Settlement Area.

2. PROPOSED DEVELOPMENT PLAN

The proposed Development is shown on the Draft Plan of Subdivision¹ prepared by Humphries Planning Group Inc. and comprises:

- Two (2) lots with existing residences
- Twenty five (25) Blocks with 140 Street Townhouses
- One (1) Stormwater Management Block
- One (1) Environmental Compensation/Restoration Block
- One (1) Park Block
- Three (3) Open Space Blocks

Four new roads (Streets A, B, C and D) are proposed; Street C includes a former part of Glasgow Road, between Chickadee Lane and Emil Kolb Parkway (closed when Emil Kolb Parkway was constructed).

¹ Drawing A1, dated March 2nd 2019 Revised December 28th 2020, prepared by Humphries Planning Group Inc.

3. BACKGROUND AND SITE SPECIFIC TECHNICAL STUDIES

3.1 Background Studies

The following Technical Studies which were prepared pursuant to the Bolton Residential Expansion are relevant to the sanitary and water servicing of the subject lands:

- Bolton Residential Expansion Study Infrastructure Report, prepared by Blue Plan Engineering Consultants Limited, dated June 16th 2014.
- Bolton Residential Expansion, Water and Wastewater Servicing Analysis - 2020 Update, Region of Peel Public Works (Water and Wastewater Infrastructure Planning), September 24th 2020.

3.2 Site Specific Studies

The following Studies were completed in support of the subject application:

- Geotechnical Investigation for proposed Residential Development, Chickadee Lane and Glasgow Road, Town of Caledon prepared by Soil Engineers Ltd., dated July 2018, Reference No. 1801-S032
- Chickadee Lane Rounding Out Area “B”, Comprehensive Environmental Impact Study and Management Plan prepared by Palmer Consulting Group Inc., dated March 21st 2019, Project No. 170163
- Hydrogeological Investigation - Chickadee Lane Rounding Out Area “B”, Bolton, Ontario prepared by Palmer Environment Consulting Group Inc., dated October 12th 2018, Project No. 170163
- Supplementary Slope Stability Assessment for proposed Residential Development, Chickadee Lane and Glasgow Road, prepared by Soil Engineers Ltd., dated August 31st 2020, Reference No. 1801-S032
- Memorandum dated August 3rd 2020 prepared by Palmer, Project #1701603, Chickadee Lane Stormwater Management Options Assessment Alternatives, Alternative Outlet Evaluation

4. EXISTING CONDITIONS

4.1 Land Use

The subject subdivision property, apart from the two residences being retained as part of the Draft Plan, comprise vacant (former rural residential holdings) and Agricultural lands.

4.2 Topography and Natural Features

The majority of the subject property is relatively flat, with the high point generally located at Chickadee Lane and gentle slopes to the southeast and northwest where there are significant forested valley features associated with the Humber River².

4.3 Physiography and Geotechnical Conditions

Geotechnical³ and Hydrogeological⁴ Studies were completed for the subject subdivision. Copies of the reports are included in Appendices “B” and “C” respectively.

The Geotechnical Investigation revealed that beneath a veneer of topsoil, the site is generally underlain by silty clay till with sandy silt till deposit at the deeper level.

The level of the water table ranges from 5m to 8m below the ground surface and the ground water flow follows the topography.

The Hydraulic Conductivity (K) values were calculated to range from 3.5×10^{-6} m/s to 4.4×10^{-8} m/s with a geometric mean of 6.1×10^{-7} m/s which is typical of the Halton Till Aquitard.

² Refer to Figures 8 and 9 of Comprehensive Environmental Impact Study and Management Plan included in Appendix “A”

³ Geotechnical Investigation for Proposed Residence Development, Chickadee Lane and Glasgow Road, Town of Caledon by Soil Engineers Ltd., dated July 2018, Reference No. 1801-S032

⁴ Hydrogeological Investigation, Chickadee Lane Rounding Out Area B, Bolton Ontario, by Palmer Environmental Consulting Group Inc., dated October 12th 2018, Project No. 170163

4. EXISTING CONDITIONS (CONT'D)

4.3 Physiography and Geotechnical Conditions (Cont'd)

Slope Stability Studies⁵ were conducted for the valley slopes at the northwest and southeast limits of the subject property and the long term stable slope lines were plotted and are graphically illustrated on the preliminary Servicing Plan (Drawing PS-1).

4.4 Storm Drainage

The subject subdivision property is located in Secondary Subwatershed No. 2 (Palgrave to Bolton) of the Main Humber River Watershed⁶. On a localized basis the property drains overland north westerly and south easterly to the valley systems of the Humber River.

⁵ Geotechnical Investigation Report dated July 2018 and Supplementary Slope Assessment Study dated August 31st 2020, included in Appendix "B".

⁶ Refer to Figure 4 Subwatershed Boundary included Appendix "D".

5. SANITARY AND WATER SERVICING

5.1 Sanitary

5.1.1 Existing Sanitary Services

As illustrated on the Preliminary Servicing Plan (Drawing PS-1) there are existing sanitary sewers on DeRose Avenue (250mm diameter) and Emil Kolb Parkway (375mm diameter). In consideration of the existing inverts and capacity, the existing 375mm diameter sewer on Emil Kolb Parkway is the preferred outlet. *[Refer to Figure 8 of the Town of Caledon, Bolton Residential Expansion Study, Water and Wastewater Servicing]*⁷.

5.1.2 Proposed Sanitary Servicing

The proposed sanitary sewer system is shown on Drawing PS-1; the sewer system also involves the construction of approximately 520m of an external sewer to connect to the existing 375mm diameter sewer on Emil Kolb Parkway. The sewer system is designed in accordance with the Region of Peel Criteria and Standards.

- The population density flow based on street townhouses is 75 persons/ha;
- A sanitary flow based on 302.8 Lpcd (Litres per capita per day);
- A Harmon Peaking Factor calculated based upon the Harmon Peaking Formula ($M = 1 + 14 / (4 + p^{0.5})$), where M = ratio of peak flow to average flow and P = the tributary population in thousands;
- An infiltration allowance of 0.2 L/s/ha.

The sanitary drainage areas for the subdivision are shown on Drawing SA-1 and a preliminary Sanitary Sewer Design Sheet is included in Appendix “F”.

A completed copy of the Region of Peel Connection Multi-Use Demand Table is included in Appendix “F”.

⁷ Included in Appendix “F”.

5. SANITARY AND WATER SERVICING (CONT'D)

5.2 Water

5.2.1 Existing Water Network

The proposed subdivision is located within the boundaries of Pressure Zone 6. As shown on the attached Figure 5 of the Town of Caledon (Bolton Residential Expansion Study - Water and Wastewater Servicing)⁸ and on Drawing PS-1, there is an existing 300mm diameter watermain on Glasgow Road and Chickadee Lane. There is also an existing water system in the subdivision on the west side of Emil Kolb Parkway. An hydrant flow test was conducted in April 2018 of the existing hydrants on Chickadee Lane (copy included in Appendix "G"). The flow test indicated a static pressure of 60 psi and a flow of 947 US GPM at a residual pressure of 48 psi (one hydrant port) and a flow of 1297 US GPM at a residual pressure of 44 psi (two hydrant ports).

5.2.2 Proposed Watermain System

As shown on Drawing PS-1, the proposed watermain system will connect to the existing 300mm diameter watermain on Glasgow Road and Chickadee Lane. A Water Network Analysis will be completed as part of the engineering design to determine if a second connection to the existing watermain system is desirable (system security and pressure).

⁸ Included in Appendix "E".

5. SANITARY AND WATER SERVICING (CONT'D)

5.2 Water (Cont'd)

5.2.2 Proposed Watermain System (Cont'd)

The proposed Subdivision will generate the following estimated water demand as given in Table I.

TABLE I
ESTIMATED WATER DEMAND

Description	Long Term Demand
Total Residential Units (Townhouses)	140
Population (based on 3.5 PPU)	490
Average Consumption Rate (L/cap/day)	280
Total Average Consumption (m ³ /day)	137.2
Peak Day Consumption (based on 2.0 peak day factor) m ³ /day	274.4
Peak Hour Consumption (based on 3.0 peak day factor) m ³ /day	411.6

A completed copy of the Region of Peel Connection Multi-Use Demand Table is included in Appendix "G".

6. STORM DRAINAGE AND STORMWATER MANAGEMENT

6.1 General

In the absence of a Subwatershed Study, the MOE Stormwater Management Manual⁹ was used to provide guidance on the design of stormwater management controls for the subject subdivision. The Humber River Hydrology Study Scenario Modelling and Analysis Report conducted by TRCA in 2008¹⁰ determined that future development without stormwater management quantity controls would significantly increase the magnitude of return-period flood flows in downstream areas. It was recommended that a Tributary-Based run off control strategy be implemented to provide detention basins in developments in certain Tributaries to control peak flows to pre-development levels, using unit flow criteria to ensure consistent application in all developing areas. It stated that the results indicated that return period flood flows in watercourses throughout the watershed are generally controlled to existing levels with this approach for all of the future conditions scenarios.

In consideration of the above, it is recommended that the proposed stormwater management is designed to be consistent with the requirements as recommended in the report *Humber River Hydrology Study Scenario Modelling Analysis Report*.

6.2 Storm Sewer System

The proposed storm sewer system is shown on Drawing PS-1. The sewer system will be designed in accordance with the Town of Caledon Standards to accommodate a 10 year storm event and will outlet to the proposed stormwater management pond. The sewer system and pipe sizing will be designed so that the hydraulic grade line in the sewers will be one (1) metre below the basement floor elevations. The storm drainage areas are shown on Drawing ST-1 and the related Storm Sewer Design Sheets are included in Appendix "G". Overland flow will be conveyed within the road rights (maximum ponding depth of 0.3m) to the proposed stormwater management pond.

⁹ Stormwater Management Planning and Design Manual, Ministry of the Environment, March 2003

¹⁰ Humber River Hydrology Study Scenario Modelling and Analysis Report conducted by TRCA in 2008

6. STORM DRAINAGE AND STORMWATER MANAGEMENT (CONT'D)

6.2 Storm Sewer System (Cont'd)

The rear yards will generally drain via swales to rear lot catch basins which will be designed to function with the proposed infiltration trenches. The rear yards and part roofs of Blocks 11, 12 and 13 will drain directly overland to the Environmental Compensation Block 34.

6.3 Stormwater Management

6.3.1 General

As shown on Drawing PS-1 a stormwater management pond is proposed in the northwest part of the subdivision. The stormwater management pond is designed to accommodate the 100-year post development flows. In accordance with Section 5.1, Humber River Unit Flow Equation for Sub-Basin 36 is used to determine the Release Rates.

TABLE II
PROPOSED STORMWATER MANAGEMENT POND OUTFLOW RATES

Drainage Area (ha)	Enhanced Protection Level (%)	SWM Type	Imperviousness (%)	Outflow Rates (L/s)			
				DRC*	2-Year	25-Year	100-Year
7.00	80% SS Removal	Wet Pond	75	9	57	135	178

Note: For West Humber River, the DRC Release Rate is 15% of 2-year release rate, Storage is 2/3rd of 2-year Storage

The net drainage area to SWM Pond (including the area of the SWM Pond and external drainage from Glasgow Road and Street C) is 7.0ha. The storage requirements for the SWM Pond were modelled using Visual OTTHYMO Version 6.2 Hydrologic Model for 2 to 100 Year storm events (AES 6 hour). A copy of the related outputs is included in Appendix "C" and summary of data is provided in Table III.

6. STORM DRAINAGE AND STORMWATER MANAGEMENT (CONT'D)

6.3 Stormwater Management (Cont'd)

6.3.1 General (Cont'd)

TABLE III
STORMWATER MANAGEMENT POND - PRELIMINARY DESIGN DATA

<i>Permanent Pool Storage Required = 1,353m³</i> <i>Permanent Pool Storage Provided = 1,504m³</i>				
Storm Event	SWM Pond Release Rate Target(m ³ /s)	VO Pond Release Rate (m ³ /s)	VO Pond Storage Volume Required (m ³)	Pond Elevation (m)
2-Year	0.057	0.056	1,613	255.48
25-Year	0.135	0.133	3,022	256.03
100-Year	0.178	0.176	3,725	256.23

6.3.2 Stormwater Management Pond - Storage Volumes

The storage volumes required (as per Table III) and being provided (as per Drawing SWM-1) are given in Table IV below.

TABLE IV
STORMWATER MANAGEMENT POND
STORAGE VS RELEASE RATES COMPARISONS

Storm Event	VO Storage Required (m ³)	Storage Provided (m ³)	Release Rate Required (m ³ /s)	Flows from Control Structure (m ³ /s)	Pond Elevation (m)
DRC	1,075	1,149	0.009	0.009	255.25
2-Year	1,613	1,623	0.057	0.036	255.48
25-Year	3,022	3,030	0.135	0.120	256.03
100-Year	3,725	3,760	0.178	0.177	256.23

6. STORM DRAINAGE AND STORMWATER MANAGEMENT (CONT'D)

6.3 Stormwater Management (Cont'd)

6.3.2 Stormwater Management Pond - Storage Volumes (Cont'd)

Related outflow calculations are included in Appendix "C" for proposed SWM Pond, orifice control will be required to control DRC outflow and broadcrested weir/orifice controls are proposed to control the outflows for the 2-year up to the 100-year storm events.

The following summarizes the outlet controls:

- DRC Release: 73mm diameter orifice;
- 2 to 100-Year Release: 73mm dia orifice and 0.33m wide and 0.15m high broadcrested weir/orifice combination;
- 10m wide emergency overflow weir is provided at elevation 256.02m.

The event storage conditions of the wet pond, supporting stage storage and discharge calculations are included in Appendix "C".

Preliminary design details of the proposed SWM Pond are illustrated on Drawing SWM-1. The configuration of pond and detailed design will be finalized as part of the Final Engineering Design.

6.4 Water Balance

The Hydrogeological Study¹¹ completed for the subject subdivision concluded that the development of the subject subdivision will result in an infiltration loss of 5,171 m³/year (i.e. pre to post development).

¹¹ Included in Appendix "C"

6. STORM DRAINAGE AND STORMWATER MANAGEMENT (CONT'D)

6.4 Water Balance (Cont'd)

To balance the deficit, it is proposed that the first 5mm of runoff from the rear half of the roof surfaces and the rear yards be infiltrated where feasible. The proposed locations of the infiltration trenches are shown on Drawing IT-1 and the related calculations are in Appendix "H".

Preliminary design details of the Infiltration trenches are also shown on Drawing IT-1.

The required length of infiltration trenches is 429.7m and the length of infiltration trenches as shown on Drawing IT-1 is 570m.

The Hydrogeological investigation assessed the permeability of the underlying soils to have a mean Hydraulic Conductivity of 6.1×10^{-7} .

To assist in the infiltration of stormwater it is proposed that in the locations of the proposed infiltration trenches the native subsoil is replaced with topsoil for a depth of 2m to 3m. The topsoil mass will facilitate the surface infiltration of stormwater (in the rear yard swales) and will also provide storage and an increased surface area of infiltration of stormwater into the surrounding subsoil.

The requirement to retain the first 5mm of runoff on-site was reviewed and the related calculations are as follows:

Subdivision Area = 7.03 ha

% Imperviousness taken as 75%

Impervious Area = $0.75 (7.03 \text{ ha}) = 5.27 \text{ ha}$

5mm Rainfall = 263.5m^3

Infiltration Trench = $1.2\text{m} \times 1.2\text{m}$

Storage Volume @ 40% void ratio = $0.573\text{m}^3/\text{m}$

Total Length of Trench required = 458m

Length of Trench provided = 570m

7. SEDIMENT AND EROSION CONTROL

Erosion and sedimentation are naturally occurring processes that involve particle detachment, sediment transport and deposition of soil particles. Construction activities commonly alter the landscapes where they are located, exacerbating these natural processes. One of the most significant alterations encountered during construction is the removal of the vegetation that stabilizes the subsoil. In the absence of the vegetation, the underlying soils are fully or partially exposed to various natural forces such as rain, flowing water, wind, and gravity¹².

The discharge of high sediment loads to natural watercourses has significant impacts on receiving waters and aquatic habitat. Some specific examples include:

- Degradation of water quality;
- Damage or destruction of fish habitat;
- Increased flooding.

In consideration of the above, it is necessary as part of the Final Design and implementation of infrastructure and development servicing to incorporate a comprehensive Erosion and Sediment Control Plan. The objectives are:

- (i) Minimize wherever possible the extent of vegetation removal;
- (ii) Provide appropriate sediment control measures to minimize the off-site transport of sediment;
- (iii) Minimize the extent of time that sites are devoid of stabilizing vegetation;
- (iv) Provide interim erosion control measures where permanent restoration is not feasible.
- (v) Provide permanent restoration to eliminate future erosion.

¹² *Erosion and Sediment Control Guidelines for Urban Construction*, December 2006, Greater Horseshoe Conservation Authorities.

7. **SEDIMENT AND EROSION CONTROL (CONT'D)**

The Erosion and Sediment Control Plan should consider the specific characteristics of each development site and address the requirements relating to the following typical construction stages:

- Topsoil Stripping and Site Pre-Grading
- Infrastructure Servicing
- Building Construction

A “treatment train” approach is recommended in the development of an appropriate Erosion and Sediment Control Plan in compliance with the *Erosion and Sediment Control Guidelines for Urban Construction*. Typical sediment control measures include:

- Installation of double silt fencing along the boundary of work areas adjacent to the NHS;
- Construction of vegetated cut off swales including sediment traps and rock check dams;
- Stabilization of temporary sediment traps and provision of vegetated filter strips adjacent to the NHS;
- Provision of catch basin sediment controls.



Inherent in the Erosion and Sediment Control Plan is a monitoring program with an Action Plan to implement remedial measures in a timely manner where required.

It is recommended that the Erosion and Sediment Control Plan be submitted at the Final Design Stage.



APPENDIX “A”

Excerpts from Comprehensive Environmental Impact Study and Management Plan, Palmer Environmental Consulting Group Inc. dated December 29th 2020 (Project No. 170163)

Palmer Memorandum dated August 3rd 2020, Chickadee Lane Stormwater Management Options Assessment, Alternative Outlet Evaluation

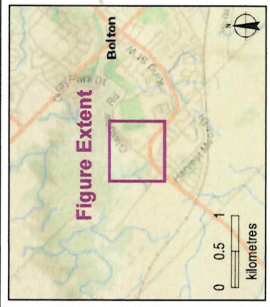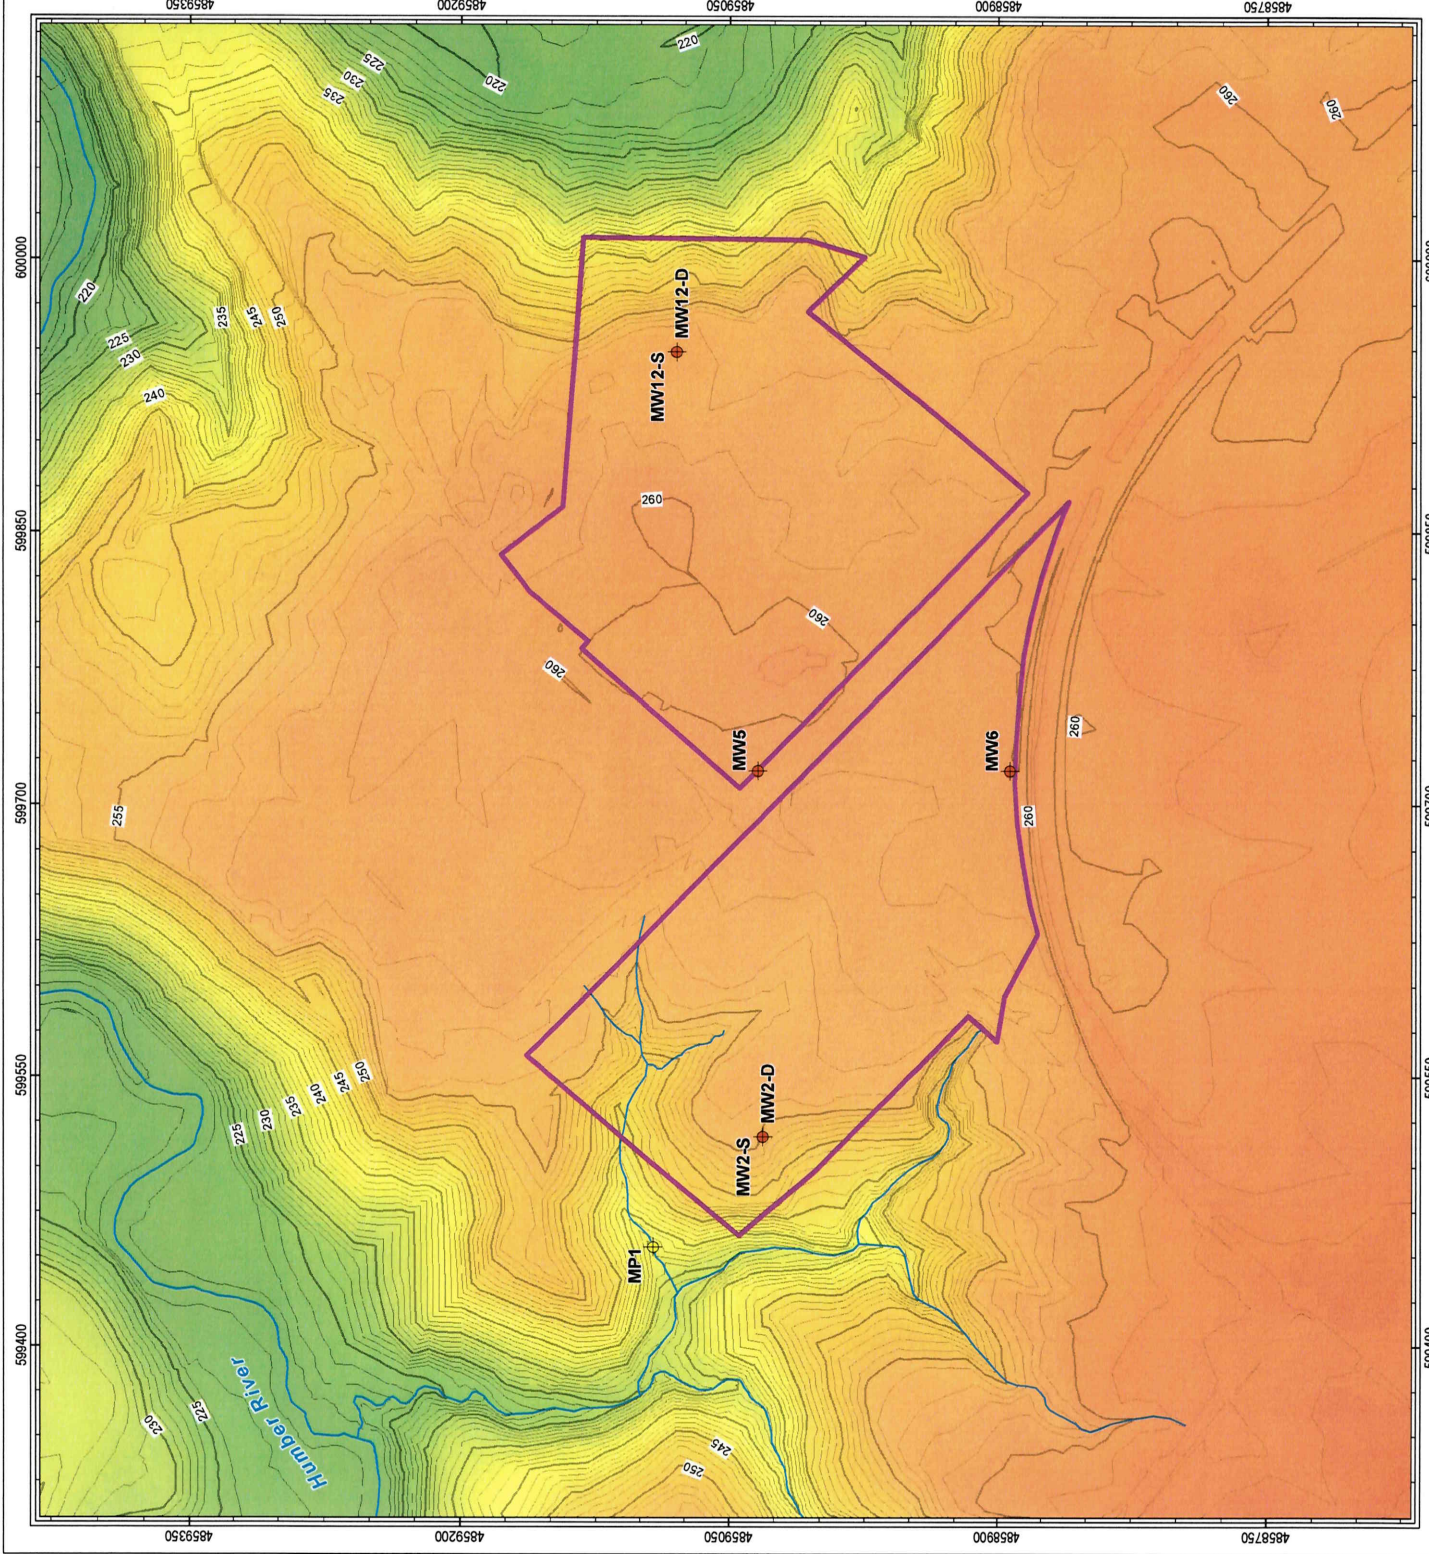

- Legend**
- Mini Piezometer
 - Monitoring Well
 - Watercourse
 - Contour (1 m)
 - Study Area




DRAWN: B. Elder
CHECKED: R. Rollick
PROJECT: 1701603
DATE: Dec 23, 2020
Data Sources: Lidar hillshade provided by TRCA web map service.

Prepared by:

Palmer™
CLIENT: Brook Valley Homes
PROJECT: Chickadee Lane Ecology and Hydrogeology

Topography

FIGURE 8

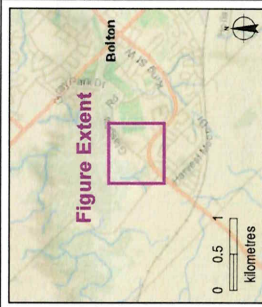


Legend

- Mini Piezometer
- Monitoring Well
- Watercourse
- Contour (1 m)
- Study Area

Land Cover

- Agriculture (8.23 ha)
- Forest (1.85 ha)



DRAWN: B. Elder
CHECKED: R. Rolick
PROJECT: 170163
DATE: Dec 23, 2020
Scale 1:4000
UTM Zone 17N
NAD 1983
Data Sources: Imagery ©2017 Google, Overview
basemap credits at page bottom.

Prepared by:

Palmer™

CLIENT: Brook Valley Homes
PROJECT: Chickadee Lane Ecology
and Hydrogeology

**Pre-development
Landuse**

FIGURE 9

Memorandum

Date: August 3, 2020

Project #: 1701603

To: Frank Filippo, Zancor Homes

From: Michael Brierley, M.Sc., and Robin McKillop, M.Sc, P.Geo

cc: Jason Cole, M.Sc, P.Geo, Diarmuid Horgan, P.Eng.

Re: Chickadee Lane Stormwater Management Options Assessment
Alternative Outlet Evaluation

1. Introduction

Palmer is pleased to provide Brookvalley Project Management Inc. (Brookvalley) on behalf of Zancor Homes Inc. (Zancor) the results of our options assessment for three proposed stormwater management (SWM) drainage alternatives to document the feasibility of each option from a fluvial geomorphological, Ecological and engineering perspective. The proposed SWM pond outlet locations will discharge into a well-defined network of gullies and channels, that descend into the Humber River Valley, draining the northwest corner of the subject property at the intersection of Chickadee Lane and Glasgow Road, in Bolton. This technical memorandum provides an overview of existing conditions, near each proposed outlet location, a brief description of the drainage alternatives and their evaluation. A photographic log is provided in **Appendix A**.

1.1 Background

Following submission of Palmer's (2019) *Chickadee Lane Rounding Out Area B Comprehensive Environmental Impact Study and Management Plan (CEISMP)* Toronto and Region Conservation Authority (TRCA) review comments, received 15 May 2020, expressed concern that a thorough assessment of existing conditions of the tributary was not previously completed. TRCA noted that an existing conditions assessment was required to inform proposed Stormwater Management (SWM) drainage options into the Humber River Valley. Palmer's Senior Fluvial geomorphologist, Candevcon Ltd. and Brookvalley went to the subject property on 26 May 2020, to discuss potential SWM Pond outlet alternatives, severe erosion was observed near potential outlet locations. Two additional drainage alternatives were identified during the site meeting, in addition, to the originally proposed outlet location. Each of the drainage alternatives were surveyed 15 June 2020, by KRCMAR Surveyors Ltd. An existing conditions assessment of the headwater tributary was completed on 30 June 2020.

2. Drainage Alternatives

A total of three drainage alternatives were identified during a field investigation on May 26 2020 (**Figure 1**). Two of the drainage alternatives are proposed to discharge into Tributary A catchment, located at the northeast corner of the subject property. The third alternative is proposed to discharge into Tributary D, located north of property boundary. An overview of proposed drainage alternatives and existing gully and channel conditions are provided below.

2.1 Alternative 1

Drainage alternative 1, originally proposed as part of Palmer's CEISMP submission, outlets directly into a V-shaped gully (Reach A4; Palmer 2020), which drains into Reach A5 approximately 60 m downstream. The gully exhibits signs of active erosion along its steep sidewalls. The gully has a high gradient (14%) and an irregular, stepped bed profile. Steep energy gradient increase velocity and shear stress along the gully bottom and walls. The banks are scoured and slightly undercut, exposing roots. All flows are confined to the V-shaped gully bottom without any floodplain available to attenuate floods. The bed and bank material consist of sandy silty-clay till, locally overlain by organic matter, sand, small gravels with cobbles and anthropogenic debris (i.e. concrete rubble). Also, woody debris and exposed tree roots impart structure and roughness along the bed. Alternative 1 would require the least amount of piping and terrestrial disturbance compared to options 2 and 3.

2.2 Alternative 2

Drainage alternative 2 would be piped from the proposed SWM pond¹ to and discharged into Reach A5 for approximately 90 m. The proposed alignment of the pond outlet is located along a naturally cleared corridor along the forested valley wall. The valley wall has a gentler gradient relative to slopes 50 m to the east and west along the proposed alignment. The pond will discharge into a reach that is transitional in its genesis and characteristics, exhibiting more influence from fluvial characteristics. The channel exhibits little sign of active erosion along sidewalls and no mass movement failures. The channel has a sinuous planform however, it is not a function of lateral erosion but forced by valley topography. The gully has a moderate-high gradient (10%). The bed and bank material consist of sandy silty-clay till, overlain by cobbles and boulders. Sand and small gravels are temporarily deposited upstream of boulder clusters and woody debris. Woody debris and exposed tree roots impart structure and roughness along the bed. Coarsening of the bed material moderates erosion and limited scour along the toe of the valley wall maintain relative stability along this reach.

2.3 Alternative 3

Drainage alternative 3 would be piped from the western side of the proposed SWM pond for approximately 90 m and outlet at the upstream extent of Reach D1. The proposed alignment follows an anthropogenic cut corridor for approx. 75 m before continuing through a treed section of valley wall for the final 15 m. The

¹ Following correspondence from TRCA on 15 May 2020, the proposed SWM pond will need to be relocated outside of the delineated Long-Term Stable Top of Slope (LTSTOS) and associated allowances, which represents the limit of the Significant Valleyland as a KNHF under the Greenbelt Plan 15 m development buffer established based on habitat delineation.

Memorandum

Page 3 | August 3, 2020

Chickadee Lane Stormwater Management Options Assessment
Error! Reference source not found.



valley wall slopes gently to a small flat 'landing' before rapidly descending into the channel. The toe of the valley wall has eroded leaving a nearly 4 m high vertical face separating the channel and crest of treed slope. The proposed drainage outlet discharges into a transitional area along the upstream extent of Reach D1. The channel is confined on both sides by prominent valley walls along its upstream extent. The channel has incised below its floodplain and become entrenched. Entrenchment has concentrated shear stress along the channel boundary, which in turn leads to further degradation and instability. Higher peak flows from increase stormwater entering the channel has eroded the channel banks and toe of valley wall enlarging the channel cross-section. The average bed gradient along the reach is 5%. Bed morphology is poorly defined due to active degradation. Bed materials are dominated by gravels and cobbles overlaid with deposited sand. Bed material is readily entrained due to the high energy gradient along the reach. Till is exposed locally along the bed, mostly along at thalweg position, and extensively along the lower banks. The entire length of Tributary D is susceptible to scour and erosion resulting from historical changes to its hydrologic and hydraulic regimes.

Memorandum

Page 4 | August 3, 2020

Chickadee Lane Stormwater Management Options Assessment

Error! Reference source not found.



Figure 1. Site Overview and Drainage Alternative Alignments

3. Evaluation of Alternatives

Drainage alternatives are evaluated from an erosion, ecology, slope stability, civil engineering, and cost perspective (**Table 1**) to determine the preferred alignment and outlet location.

Table 1. Evaluation of proposed drainage alternatives

Discipline	Criteria	Proposed Alternative		
		Alternative 1	Alternative 2	Alternative 3
Fluvial Geomorphology	Erosion (Impact on soils, geology, rate of erosion)	Expansion of the gully's catchment area and regulation of its hydrological regime have the potential to exacerbate erosion through a positive feedback mechanism. The steepness and confinement of the gully bottom yield a naturally erosive environment.	Expansion of the gully's catchment area and regulation of its hydrological regime have the potential to exacerbate erosion along this reach. This section of channel is relatively stable with till underlaid by cobbles, boulders and woody debris along the bed and no observed valley wall instability.	Expansion of the gully's catchment area and regulation of its hydrological regime have the potential to exacerbate erosion along this unstable section of channel. The steepness and confinement of the channel bottom yield a naturally erosive environment.
	Score			
Ecology	Aquatic (Impact on connectivity, diversity and sustainability)	Approx. 0.5 wide in this section. 1-6 cm deep, slow flow (with sinks) flowing north. Silty/clay bottom with wood debris and localized boulders. Gully spanning tree roots. Steep and unlikely suitable for fish species. No groundwater influence along this section	Approx. 2 m wide in this section. 0-3 cm deep, slight trickle of water flowing east west. Silty/clay bottom, some large rocks. Steep and unlikely suitable for fish species. No groundwater influence along this section	Approx. 2 m wide in this section. 0-5 cm deep, slow trickle of water flowing north. Sand bottom with some gravels and cobbles present. Steep and unlikely suitable for fish species. limited groundwater influence along this section
	Score			
	Terrestrial (Impact on connectivity, diversity and sustainability)	Area provides potential suitable habitat for bats and salamanders. Large, tall deciduous trees provide canopy cover. The woodlands also provide confirmed habitat for Wood Thrush and Eastern Wood-pewee, both Species at Risk birds in Ontario.	Area provides potential suitable habitat for bats and salamanders. Large, tall deciduous trees provide canopy cover. The woodlands also provide confirmed habitat for Wood Thrush and Eastern Wood-pewee, both Species at Risk birds in Ontario.	This area would cause the least ecological impact. This section is primarily dominated by European Buckthorn (highly invasive, non-native) and Ash populations here have already declined with few live trees left. At the woodland edge, clearing this area would not fragment the forest.
	Regulatory Agency Acceptance (Satisfy TRCA, DFO and MNRF Mandates)	Identified as significant valley land under the Greenbelt Plan with potential for species at risk present would require approvals from TRCA and MNRF.		
	Score			
		The gully exhibits little sign of active erosion with sloped sidewalls and no	The valley wall exhibits little sign of active erosion along sloped	Signs of active erosion with mass movement failures and seepage

Memorandum

Page 6 | August 3, 2020

Chickadee Lane Stormwater Management Options Assessment
Error! Reference source not found.



Slope Stability ²		mass movement failures. No headward cut or seepage areas were observed. The gully sidewalls appear to be relatively stable, however, continued incision along the gully bottom highlight potential for future sidewall instability.	sidewalls and no mass movement failures. No seepage areas were observed. The toe of the valley walls are scoured and slightly undercut, exposing roots and silty-till, however, no instability was noted.	areas (resulting from the presence of a perched water table (Palmer 2019)) were present along the valley wall. Severe erosion along the channels bed and banks have further contributed to valley wall instability
	Score			
Engineering	Design			
	Score			
Cost	Construction and Monitoring			
	Score			
Overview				

4. Recommendations

Prepared By:

Employee Name, Designation
Title

Reviewed By:

Employee Name, Designation
Title

Approved By:

Employee Name, Designation
Title

² A long-term slope stability assessment has not been completed along the proposed drainage alternative alignments. Slope stability was evaluated based on the composition of table land and observed mass wasting or seepage areas in proximity to the proposed alignments.

Memorandum

Page 7 | August 3, 2020

Chickadee Lane Stormwater Management Options Assessment


Error! Reference source not found.



References

Ministry of Transportation, 1990: (shift enter here to ensure this line remains with rest of reference)

This is an example reference. Please delete (Short Cut Code: Alt + RL)

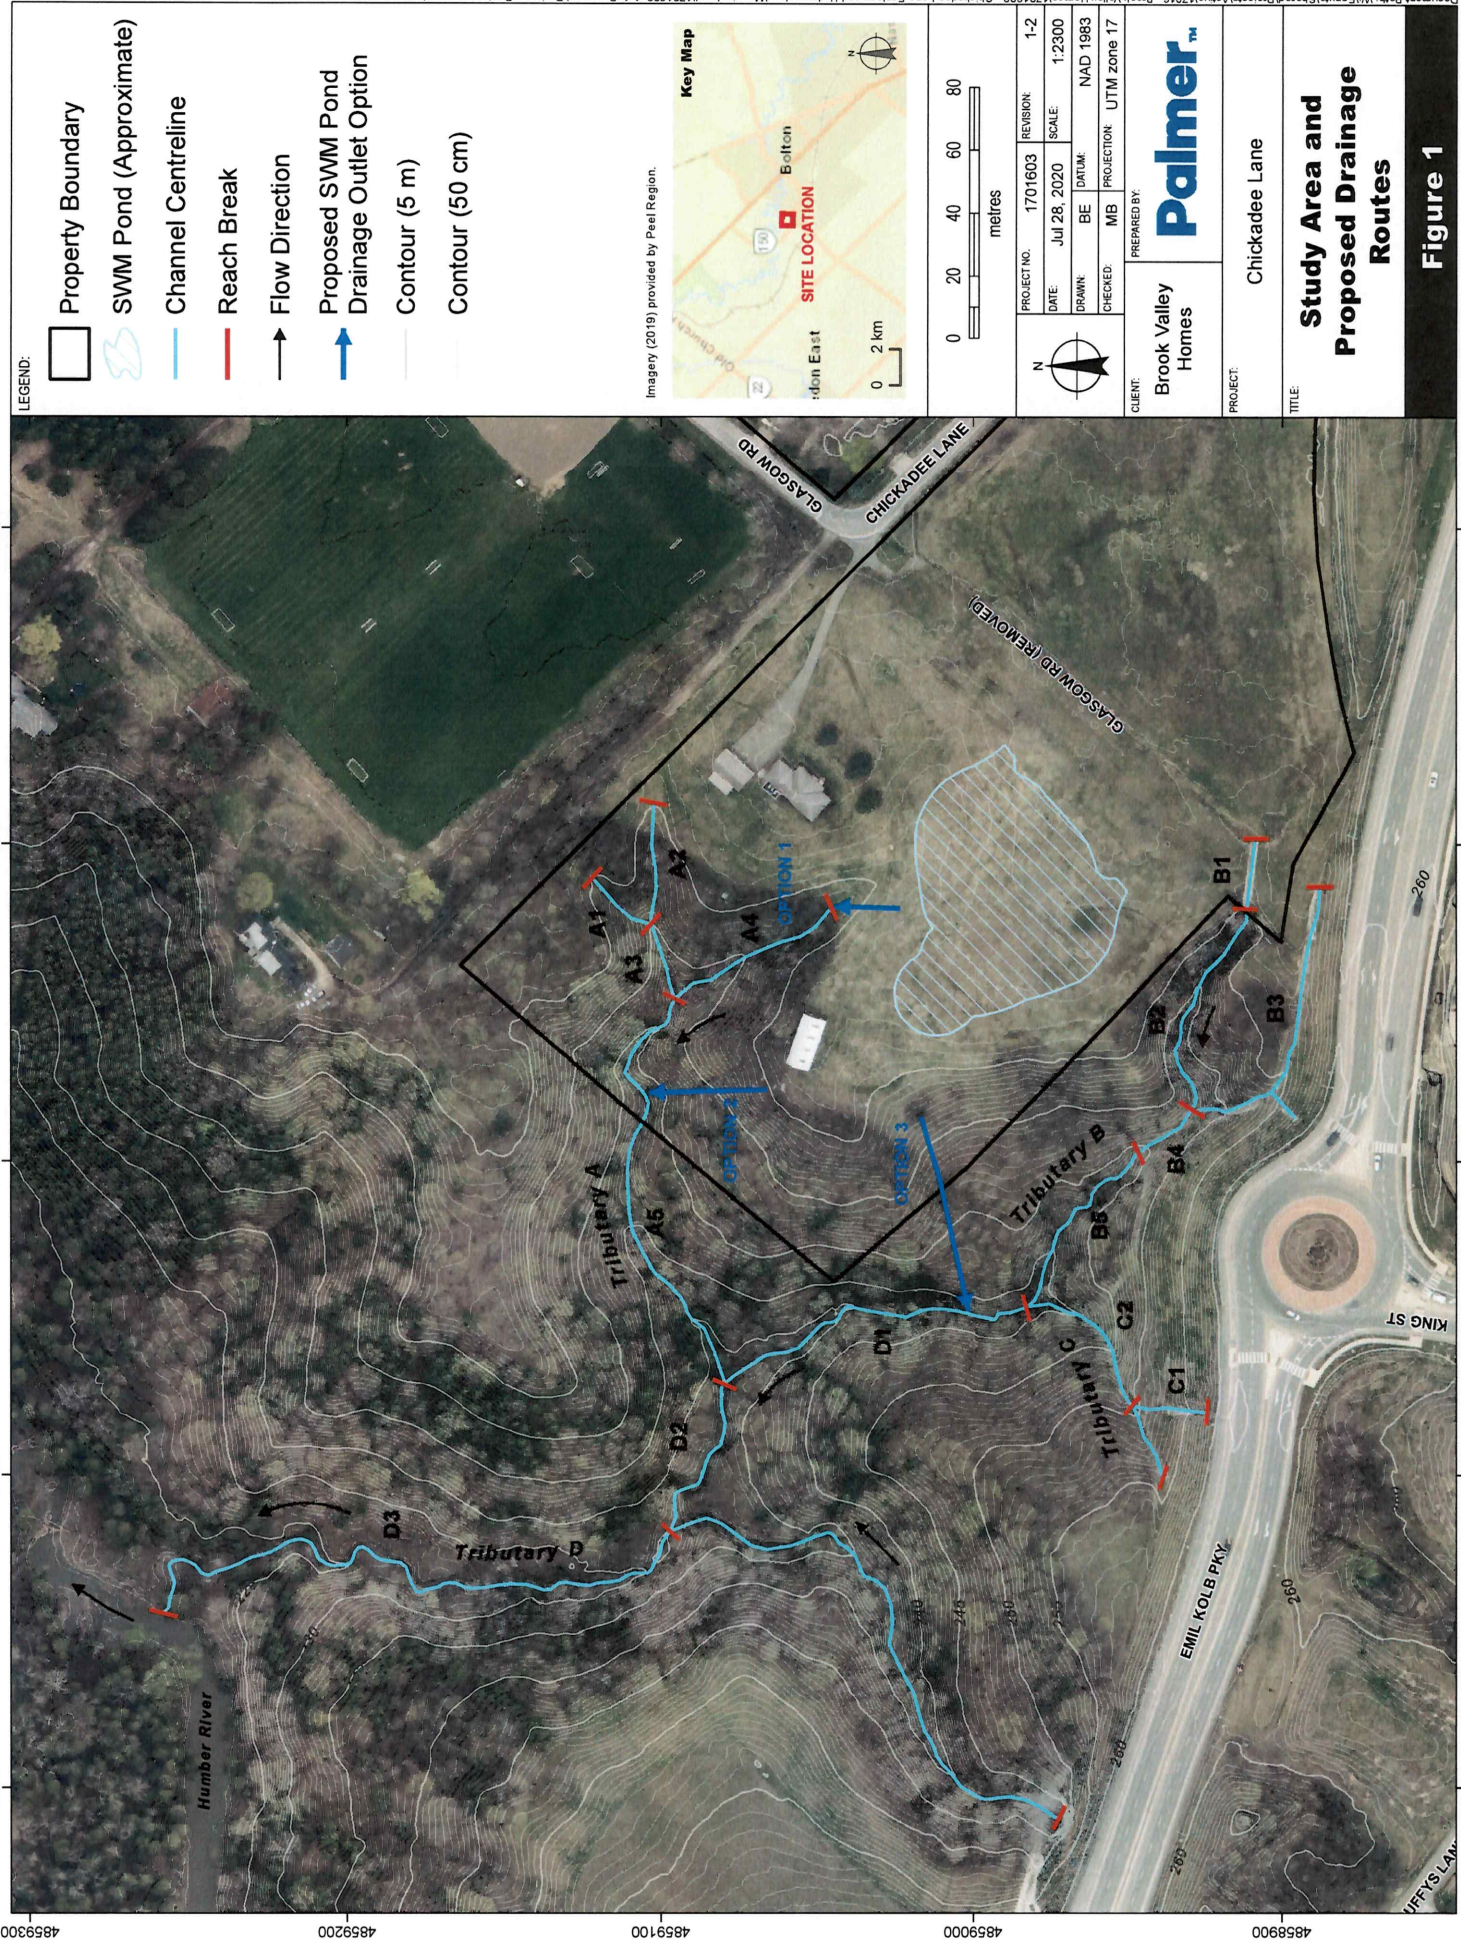

APPENDIX “B”

Geotechnical Investigation for Proposed Residential Development, Chickadee Lane and Glasgow Road, Town of Caledon, Soil Engineers Ltd., dated July 2018, Reference No. 1801-S032

Supplementary Slope Stability Assessment prepared by Soil Engineers Ltd. Dated August 31st 2020, Reference No. 1801-S032



Soil Engineers Ltd.

CONSULTING ENGINEERS

GEOTECHNICAL • ENVIRONMENTAL • HYDROGEOLOGICAL • BUILDING SCIENCE

90 WEST BEAVER CREEK ROAD, SUITE #100, RICHMOND HILL, ONTARIO L4B 1E7 • TEL (416) 754-8515 • FAX (905) 881-8335

BARRIE	MISSISSAUGA	OSHAWA	NEWMARKET	GRAVENHURST	PETERBOROUGH	HAMILTON
TEL: (705) 721-7863	TEL: (905) 542-7605	TEL: (905) 440-2040	TEL: (905) 853-0647	TEL: (705) 684-4242	TEL: (905) 440-2040	TEL: (905) 777-7956
FAX: (705) 721-7864	FAX: (905) 542-2769	FAX: (905) 725-1315	FAX: (905) 881-8335	FAX: (705) 684-8522	FAX: (905) 725-1315	FAX: (905) 542-2769

**A REPORT TO
BROOKVALLEY PROJECT MANAGEMENT INC.**

**A GEOTECHNICAL INVESTIGATION FOR
PROPOSED RESIDENTIAL DEVELOPMENT**

CHICKADEE LANE AND GLASGOW ROAD

TOWN OF CALEDON

REFERENCE NO. 1801-S032

JULY 2018

DISTRIBUTION

3 Copies - Brookvalley Project Management Inc.
1 Copy - Soil Engineers Ltd. (Richmond Hill)



TABLE OF CONTENTS

1.0 INTRODUCTION	1
2.0 SITE AND PROJECT DESCRIPTION	2
3.0 FIELD WORK	3
4.0 SUBSURFACE CONDITIONS	4
4.1 Topsoil.....	4
4.2 Earth Fill.....	5
4.3 Silty Clay Till.....	5
4.4 Sandy Silt Till	7
4.5 Compaction Characteristics of the Revealed Soils.....	8
5.0 Groundwater Conditions	11
6.0 Slope Stability Study	13
7.0 DISCUSSION AND RECOMMENDATIONS.....	17
7.1 Site Preparation	18
7.2 Foundations	19
7.3 Engineered Fill	21
7.4 Underground Services.....	23
7.5 Backfilling in Trenches and Excavated Areas.....	24
7.6 Garages, Driveways and Landscaping.....	26
7.7 Pavement Design.....	27
7.8 Soil Parameters.....	28
7.9 Excavation.....	29
8.0 LIMITATIONS OF REPORT	30



TABLES

Table 1 - Estimated Water Content for Compaction	9
Table 2 - Groundwater Levels	11
Table 3 - Soil Strength Parameters	14
Table 4 - Factors of Safety Against Slope Failure.....	15
Table 5 - Pavement Design.....	27
Table 6 - Soil Parameters.....	28
Table 7 - Classification of Soils for Excavation.....	29

DIAGRAM

Diagram 1 - Evidence of toe erosion scars along Humber River	13
Diagram 2 - Frost Protection Measures (Foundations)	20

ENCLOSURES

Borehole Logs	Figures 1 to 12
Grain Size Distribution Graphs.....	Figures 13 and 14
Borehole Location Plan and Cross Sections	Drawing No. 1
Subsurface Profile	Drawing Nos. 2 and 3
Cross Sections A-A, B-B and C-C.....	Drawing Nos. 4 to 6
Long Term Stable Slope Line and Erosion Hazard Limit.....	Drawing No. 7



1.0 **INTRODUCTION**

In accordance with the written authorization dated November 13, 2017, from Mr. Frank Filippo of Brookvalley Project Management Inc., a geotechnical investigation was conducted at a parcel of property located in the area of Chickadee Lane and Glasgow Road in the Town of Caledon.

The purpose of the investigation was to reveal the subsurface conditions and to determine the engineering properties of the disclosed soils for the design and construction of a residential development project. Since the property is located in close proximity of the Humber River, a slope stability study was also completed for the development. The findings and resulting recommendations are presented in this Report.



2.0 **SITE AND PROJECT DESCRIPTION**

The site is located at the south sector of the Town of Caledon, which is situated on Peel-Markham till plain where the drift dominates the soil stratigraphy. In places, lacustrine sand, silt, clay and drift which has been reworked by the water action of Peel Ponding (glacial lake) have modified the drift stratigraphy.

The subject property, approximately 10.91 hectares in area, is located beside the intersection of Chickadee Lane and Glasgow Road in the Town of Caledon. The existing site gradient is relatively flat, with sloping ground to the north and east of the property towards the vicinity of Humber River. The valley land is well vegetated with trees and bushes.

At the time of investigation, part of the property was an open field, with dwellings on the southeast and northwest of the road intersection.

The proposed development will consist of a residential subdivision on the south portion of the property, with municipal services and access roadways meeting the municipal standards.



3.0 **FIELD WORK**

The field work, consisting of twelve (12) sampled boreholes, was performed between January 23 and 29, 2018, at the locations shown on the Borehole Location Plan of Drawing No. 1. Boreholes 2 and 12, located close to the top of slope, extended to a depth of 19.8 m and 32.0 m from the prevailing ground surface. The remaining boreholes were terminated at a depth of 6.5 m or 8.1 m from the prevailing ground level.

The holes were advanced at intervals to the sampling depths by a track-mounted, continuous-flight power-auger machine equipped for soil sampling. Standard Penetration Tests, using the procedures described on the enclosed “List of Abbreviations and Terms”, were performed at the sampling depths. The test results are recorded as the Standard Penetration Resistance (or ‘N’ values) of the subsoil. The relative density of the granular strata and the consistency of the cohesive strata are inferred from the ‘N’ values. Split-spoon samples were recovered for soil classification and laboratory testing.

Upon completion of borehole drilling and sampling, monitoring wells were completed at the location of Boreholes 2, 5, 6 and 12 for hydrogeological study. The wells at Boreholes 5 and 6 were installed at a depth of 6.0 m. At the locations of Boreholes 2 and 12, nested wells were installed at a depth of 7.6 m and at the deeper levels of 19.8 m and 32.0 m, respectively. The locations and depths of the monitoring wells were specified by Palmer Environmental Consulting Group Inc., who will also be monitoring the wells.

The ground elevation at each borehole and monitoring well location was interpolated from the spot elevations shown on the Plan of Survey prepared by KRCMAR Surveyors Ltd. dated March 2017.



4.0 **SUBSURFACE CONDITIONS**

The boreholes revealed that beneath a veneer of topsoil and a layer of earth fill in places, the site is underlain by silty clay till with sandy silt till deposit at the deeper level. Detailed descriptions of the subsurface conditions are presented on the Borehole Logs, comprising Figures 1 to 12, inclusive. The revealed stratigraphy is plotted on the Subsurface Profile in Drawing Nos. 2 and 3. The engineering properties of the disclosed soils are discussed herein.

4.1 **Topsoil** (All Boreholes)

The revealed topsoil is 16 cm to 46 cm in thickness. Thicker topsoil layers are expected to occur in places, especially in the treed area and the low-lying drainage area.

The topsoil is dark brown in colour, indicating appreciable amounts of roots and humus. These materials are unstable and compressible under loads; therefore, the topsoil can only be used for general landscaping purposes. Its suitability for planting and sodding purposes must be further assessed by fertility testing.

Due to the humus content, the topsoil may produce volatile gases and generate an offensive odour under anaerobic conditions. Therefore, the topsoil must not be buried below any structures or deeper than 1.2 m below the finished grade, so that it will not have an adverse impact on the environmental well-being of the developed areas.



4.2 **Earth Fill** (Boreholes 4, 5, 7, 9 and 11)

A layer of earth fill, consisting of brown and grey silty clay, with sand and gravel, occasional rootlets, topsoils inclusions wood and brick fragments, was contacted in some of the boreholes. The fill extends to a depth of 0.6 m to 2.4 m from the prevailing ground surface. It may be placed for site grading when the road and the existing houses were constructed in the past.

The water content of the earth fill samples was determined, ranging from 19% to 34%, indicating moist to wet conditions.

The obtained 'N' values range from 3 to 30, with a median of 6 blows per 30 cm of penetration, showing the fill is non-uniform in compaction and is unsuitable to support any structures sensitive to movement. For structural uses, the existing earth fill must be subexcavated, sorted free of topsoil and any deleterious material, aerated and properly compacted in layers.

One must be aware that the samples retrieved from boreholes 10 cm in diameter may not be truly representative of the geotechnical quality of the fill, and do not indicate whether the topsoil beneath the earth fill was completely stripped. This should be further assessed by test pits.

4.3 **Silty Clay Till** (All Boreholes)

The native silty clay till deposit is heterogeneous in structure and amorphous in places. Some of the clay till samples were found to contain sand seams and clay layers. Grain size analyses were performed on 3 representative samples and the results are plotted on Figure 13.



Intermittent hard resistance to augering was encountered, indicating the presence of cobbles and boulders in the stratum.

The silty clay till deposit was found to be weathered at the upper layer in some of the boreholes, up to a depth of 0.6 m to 0.8 m from grade. The obtained 'N' values range from 2 to 69 blows, with a median of 27 blows per 30 cm of penetration.

This indicates that the consistency of the clay till is soft to hard, having the soft till in the weathered zone near the ground surface only. The consistency of the clay till is generally very stiff.

The Atterberg Limits of 4 representative samples and the water content values for all the clay till samples were determined. The results are plotted on the Borehole Logs and summarized below:

Liquid Limit	42, 38, 37, 36
Plastic Limit	21, 21, 19, 20
Natural Water Content	12% to 32% (median 17%)

The above results show that the clay till is cohesive, with medium plasticity. The natural water content values are mostly below the plastic limit, confirming the generally very stiff consistency of the clay as determined from the 'N' values. The higher water content samples were obtained near the ground surface which could have been disturbed by weathering.

Based on the above findings, the engineering properties of the clay till pertaining to the project design are given below:

- Highly frost susceptible and soil adfreezing potential.
- Low water erodibility.



- Very low in permeability, with an estimated coefficient of permeability of 10^{-7} cm/sec and runoff coefficients of:

Slope

0% - 2%	0.15
2% - 6%	0.20
6% +	0.28

- A cohesive-frictional soil, its shear strength is derived from consistency and is augmented by internal friction, thus being inversely moisture dependent and, to a lesser extent, dependent on soil density.
- In excavation, the clay till will be stable in relatively steep slopes; however, prolonged exposure will allow infiltrating precipitation to saturate the fissures and sand layers in the till, causing localized sloughing.
- A poor pavement-supportive material, with an estimated California Bearing Ratio (CBR) value of 5%.
- Moderate corrosivity to buried metal, with an estimated electrical resistivity of 3500 ohm·cm.

4.4 **Sandy Silt Till** (Boreholes 2 and 12)

The sandy silt till was contacted below 16.5 m and 22.5 m at Boreholes 2 and 12, respectively. It is heterogeneous in structure with occasional sand seams, cobbles and boulders.

The obtained 'N' values range from 28 to 78, with a median of 39 blows per 30 cm of penetration. This indicates that the relative density of the silt till is compact to very dense, generally in the dense range.

The water content values for the silt till samples were determined; the results are plotted on the Borehole Logs, ranging from 12% to 15%.



Based on the above findings, the properties of the silt till pertaining to the project are given below:

- Moderately frost susceptibility, with high soil adfreezing potential.
- Low water erodibility.
- Relatively low in permeability, with an estimated coefficient of permeability of 10^{-6} cm/sec and runoff coefficients of:

Slope

0% - 2%	0.15
2% - 6%	0.20
6% +	0.28

- A cohesive-frictional soil, its shear strength is derived from consistency and is augmented by internal friction, thus being inversely moisture dependent and, to a lesser extent, dependent on soil density.
- In excavation, the silt till will be stable in relatively steep slopes; however, prolonged exposure will allow infiltrating precipitation to saturate the sand layers causing localized sloughing.
- A poor pavement-supportive material, with an estimated CBR value of 8%.
- Moderate corrosivity to buried metal, with an estimated electrical resistivity of 4000 ohm·cm.

4.5 **Compaction Characteristics of the Revealed Soils**

The obtainable degree of compaction is primarily dependent on the soil moisture and, to a lesser extent, on the type of compactor used and the effort applied. As a general guide, the typical water content values of the revealed soils for Standard Proctor compaction are presented in Table 1.

**Table 1 - Estimated Water Content for Compaction**

Soil Type	Determined Natural Water Content (%)	Water Content (%) for Standard Proctor Compaction	
		100% (optimum)	Range for 95% or +
Earth Fill	19 to 34	19	15 to 22
Silty Clay Till	12 to 32 (median 17)	18	14 to 22
Sandy Silt Till	12 to 15 (median 13)	14	10 to 17

Based on the above findings, the on-site materials are mostly suitable for 95% or + Standard Proctor compaction. However, some of the earth fill and the weathered soils are relatively too wet, which will require mixing with dry soils or aeration during dry and warm weather before compaction.

Any use of the existing earth fill should be reviewed, sorted free of organics and deleterious material, aerated, before reuse for structural backfill.

The on-site material should be compacted using a heavy-weight, kneading-type roller. The lifts for compaction should be limited to 20 cm, or to a suitable thickness as assessed by test strips performed by the equipment which will be used at the time of construction.

When compacting the onsite material with cementation, the compactive energy will frequently bridge over the chunks in the soil and be transmitted laterally in the soil mantle. Therefore, the lifts of this soil must be limited to 20 cm or less (before compaction). It is difficult to monitor the lifts of backfill placed in deep trenches; therefore, it is preferable that the compaction of backfill at depths over 1.0 m below the pavement subgrade be carried out on the wet side of the optimum. This would allow a wider latitude of lift thickness.



If the compaction of the soils is carried out with the water content within the range for 95% Standard Proctor dry density but on the wet side of the optimum, the surface of the compacted soil mantle will roll under the dynamic compactive load. This is unsuitable for pavement construction since each component of the pavement structure is to be placed under dynamic conditions which will induce the rolling action of the subgrade surface and cause structural failure of the new pavement.

The foundation or bedding of the sewer and slab-on-grade will be placed on a subgrade which will not be subjected to impact loads. Therefore, the structurally compacted soil mantle with the water content on the wet side or dry side of the optimum will provide an adequate subgrade for the construction.



5.0 GROUNDWATER CONDITIONS

Groundwater seepage encountered during augering of boreholes was recorded on the field logs. Upon completion, the level of groundwater and cave-in were measured in the boreholes; the data are plotted on the Borehole Logs and listed in Table 2.

Table 2 - Groundwater Levels

Borehole/ Monitoring Well No.	Ground Elevation (m)	Borehole Depth (m)	Soil Colour Changes Brown to Grey		Measured Groundwater/ Cave-In* Level On Completion	
			Depth (m)	Elevation (m)	Depth (m)	Elevation (m)
1	256.5	8.1	5.6	250.9	dry	-
2**	255.7	19.8/7.6	6.3	249.4	3.0	252.7
3	255.8	6.5	6.3	249.5	dry	-
4	258.9	6.5	5.4	253.5	dry	-
5	259.5	6.5	> 6.5	-	3.8	255.7
6	259.9	6.5	5.3	254.6	4.0	255.9
7	260.0	6.5	4.6	255.4	0.3	259.7
8	259.5	6.5	5.8	253.7	dry	-
9	260.0	6.5	4.3	255.7	1.5/4.0*	258.5/256.0*
10	257.8	6.5	3.4	254.4	dry	-
11	259.3	6.5	2.9	256.4	dry	-
12**	258.3	32.0/7.6	7.6	250.7	6.1	252.2

* Cave-in level upon completion of drilling

** With nested Monitoring Wells at shallow and deep level

Groundwater was recorded in six boreholes, at a depth of 0.3 m to 6.1 m from the ground surface, or El. 252.2 m to 259.7 m. The other six boreholes were dry throughout the investigation process.

The recorded water level in the open boreholes may represent perched groundwater



in the earth fill or sand seams within the till stratum. It will fluctuate with the seasons.

In excavation, any groundwater yield is anticipated to be slow in rate and limited in quantity. It can be collected into a sump and remove by conventional pumping.

Palmer Environmental Consulting Group Inc., retained by Brookvalley Project Management Inc., will be monitoring the wells.




6.0 SLOPE STABILITY STUDY

A slope stability study was conducted for the valley land to the north and east of the subject property. It includes a visual inspection of the slope and stability analysis using force-moment-equilibrium criteria of the Bishop's method.

A visual inspection of the slope was performed on March 20, 2018. The inspection revealed that the sloping ground is generally covered with mature trees or vegetation, with isolated bare spots covered with fallen leaves and wood branches. Most of the trees appeared in the upright position. There were no signs of water seepage or surface erosion along the slope surface, except multiple gullies and surface erosion were present to the north and west of the property. Toe erosion scars were also evident along Humber River, as seen in Diagram 1.

Diagram 1 - Evidence of toe erosion scars along Humber River

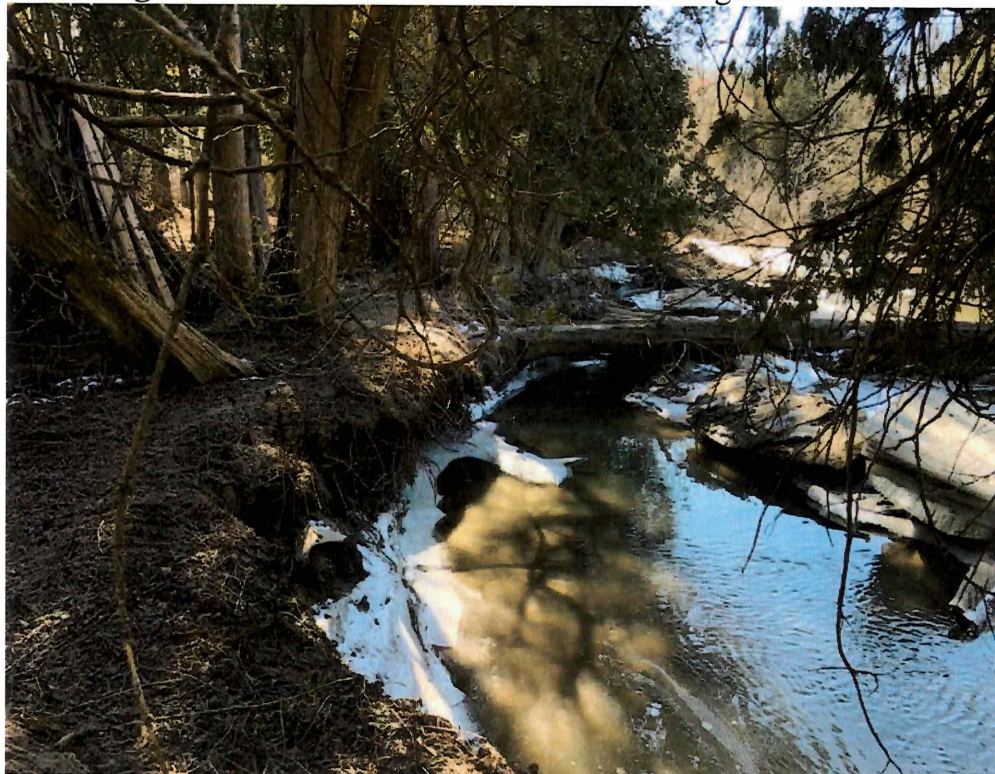



Towards the east of the property, the bottom of slope is a park vicinity with no erosion hazard.

Three slope sections were selected for stability analysis, based on the field observation and the contours of slope inclination. The locations of these sections are shown on Drawing No. 1. Each slope section has a height of 20 to 30 m, with an inclination between 1 vertical (V) : 2 horizontal (H) and 1V : 3H.

The slope profiles are interpreted from the contours on the topographic plan obtained from First Base Solutions. The subsurface profiles of the slope sections were interpreted from the findings of the nearby Boreholes 2 and 12 (Enclosure Nos. 2 and 12). The groundwater level recorded in these boreholes, at a depth of 3.0 m and 6.1 m, was used as the phreatic groundwater along the slope, although it was discontinuous and was considered as the perched water in the boreholes. The soil strength parameters of each soil layer are presented in Table 3.

Table 3 - Soil Strength Parameters

Soil Type	Unit Weight γ (kN/m ³)	Shear Strength Parameters	
		c' (kPa)	ϕ' (degree)
Silty Clay Till, very stiff	22.0	5	28
Silty Clay Till, stiff	21.5	5	25
Sandy Silt Till, dense	22.0	5	30

The stability analysis was completed using “SLIDE”, developed by Rocscience Inc. The results are illustrated on Drawing Nos. 4 to 6 and summarized in Table 4. The Technical Guide “River and Stream Systems: Erosion Hazard Limit” of Ministry of Natural Resources and Forestry (MNRF Guideline) was used for the management of erosion hazards along the bank.

**Table 4 - Factors of Safety of Slope Sections**

Slope Section	Minimum Factor of Safety of Existing Slope
A-A	1.393
B-B	1.496
C-C	1.509

The minimum Factors of Safety (FOS) in Table 4 meets the Design Minimum Factor of Safety (Table 4.3 in the guideline) of 1.3 to 1.5 for Active Landuse (habitable or occupied structures near slope; residential, commercial and industrial buildings, retaining walls, storage warehousing of non-hazardous substances).

Due to the low permeability of subsoil, the water penetration into the subsoil during regional flooding is local. Any instability due to saturation of subsoil during rapid drawdown is considered insignificant.

To establish the long-term stable slope line (LTSSL), a 5 m toe erosion allowance is recommended along the gullies and river bank where there are signs of erosion, according to Table 3 of MNRF Guideline. The LTSSL is shown on Drawing No. 7.

Any new development will have to set back a minimum of 6 m from the LTSSL. The Erosion Hazard Limit, including the 6 m setback from the LTSSL is also shown on Drawing No. 7.

In order to maintain the safety of slope from erosion, the following geotechnical constraints should be stipulated for any development next to the slope:

1. The prevailing vegetative cover must be maintained, since its extraction would deprive the slope of the rooting system that acts as reinforcement against soil erosion by weathering. If for any reason the vegetation cover is



stripped, it must be reinstated to its original, or better than its original, protective condition.

2. The leafy topsoil cover on the slope face should not be disturbed, since this provides insulation and screen against frost wedging and rainwash erosion.
3. Grading of the land adjacent to the slope must be such that concentrated runoff is not allowed to drain onto the slope face. Landscaping features, which may cause runoff to pond at the top of the slope, such as infiltration trenches, as well as soil saturation at the tableland must not be permitted.
4. Where development is carried out near the top of the slope, there are other factors to be considered related to possible human environmental abuse. These include soil saturation from frequent watering to maintain of landscaping features, stripping of topsoil or vegetation, and dumping of loose fill and material storage close to the top of slope; none of these should be permitted.



7.0 **DISCUSSION AND RECOMMENDATIONS**

The investigation revealed that beneath a veneer of topsoil and a layer of earth fill in places, the site is underlain by soft to hard, generally very stiff silty clay till stratum and compact to very dense, generally dense sandy silt till deposit at the deeper level. Groundwater was recorded in six boreholes, at a depth of 0.3 m to 6.1 m from the ground surface. It represents a perched groundwater in the earth fill or sand seams within the till stratum.

The existing slope inclination has the minimum Factors of Safety (FOS) above 1.3 to 1.5, meeting the Design Minimum Factor of Safety (Table 4.3 in the MNRF guideline) for Active Landuse. A 5 m Toe Erosion Allowance is recommended along the gullies and river bank where there are signs of erosion. Any new development will have to set back a minimum of 6 m for the Erosion Access Allowance. The Erosion Hazard Limit, including the 5 m setback for the Toe Erosion Allowance and 6 m setback for the Erosion Access Allowance is shown on Drawing No. 7.

The geotechnical findings which warrant special consideration are presented below:

1. The existing topsoil must be removed for the development. The revealed thickness of topsoil at the borehole locations is between 16 cm and 46 cm. Thicker topsoil layer can occur, especially in depressed areas.
2. After demolition of existing area, the foundation and debris should be removed and disposal off-site. The cavity should be backfilled with an engineered fill for development.
3. The topsoil is void of engineering value and should be stripped and removed for the project construction. It must not be buried within the building envelope or deeper than 1.2 m below the exterior finished grade of the



development.

4. Engineered fill and sound natural soils are suitable for normal spread and strip footing construction for the proposed development. The footings must be designed in accordance with the recommended bearing pressures in Section 7.2 and the footing subgrade must be inspected by a geotechnical engineer to ensure that its condition is compatible with the design of the foundations.
5. For slab-on-grade construction, the slab should be constructed on a granular base, 20 cm thick, consisting of 20-mm Crusher-Run Limestone, or equivalent, compacted to its maximum Standard Proctor dry density.
6. A Class 'B' bedding, consisting of compacted 20-mm Crusher-Run Limestone, is recommended for the construction of the underground services. Where water-bearing soil is present, a Class 'A' concrete bedding should be used.
7. Excavation should be carried out in accordance with Ontario Regulation 213/91.

The recommendations appropriate for the project described in Section 2.0 are presented herein. One must be aware that the subsurface conditions may vary between boreholes. Should this become apparent during construction, a geotechnical engineer must be consulted to determine whether the following recommendations require revision.

7.1 **Site Preparation**

The property is an open field, with existing dwellings on the southeast and northwest of the road intersection. For site preparation of development, the existing topsoil must be removed and the site can be regraded with an engineered fill for normal footing, sewer and pavement construction. After demolition of the existing dwellings, the foundation cavity should be subexcavated to undisturbed soil



stratum, followed by backfilling with engineered fill, compacted in layers. The requirements for engineered fill construction are discussed in Section 7.3.

The existing earth fill should also be sub-excavated. Test pits may be excavated to evaluate the depth and the extent of earth fill for removal. The fill should be sorted free of topsoil, organic inclusion, debris, wood and other deleterious material, prior to reuse for engineered fill or structural backfill.

7.2 **Foundations**

The development will consist of residential houses with a normal depth basement. Based on the borehole findings, the houses can be built on conventional footings founded on sound natural silty clay till or engineered fill.

The recommended soil bearing pressures of 150 kPa (SLS) and 250 kPa (ULS) should be used for the design of normal spread and strip footings, founded on sound native soils or engineered fill. The total and differential settlements of the footings are estimated to be 25 and 15 mm, respectively.

Higher design bearing pressures may be available for individual buildings at designated area. The building foundations can be reviewed by the geotechnical engineer after the site grading plan and the details of the proposed development is finalized.


The footing subgrade must be confirmed by inspection performed by a geotechnical engineer or a geotechnical technician under the supervision of a geotechnical engineer, to ensure that the revealed conditions are compatible with the foundation requirements.



Footings exposed to weathering, or in unheated areas, should have at least 1.2 m of earth cover for protection against frost action.

Some of the in situ soils have high soil-adfreezing potential. In order to alleviate the risk of frost damage, the foundation walls must be constructed of concrete and either the backfill must consist of non-frost-susceptible granular material, or the foundation walls must be shielded with a polyethylene slip-membrane between the concrete wall and the backfill. The recommended measures are schematically illustrated in Diagram 2.

Diagram 2 - Frost Protection Measures (Foundations)

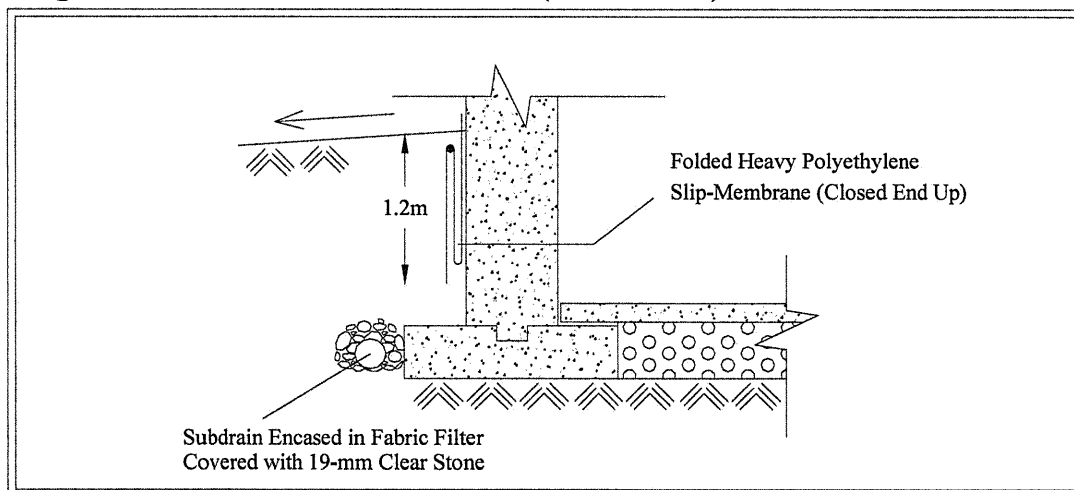

Perimeter subdrains and dampproofing of the foundation walls will be required. All subdrains must be encased in a fabric filter to protect them against blockage by silting.

The building foundation must meet the requirements specified in the latest Ontario Building Code. As a guide, the structures founded on the sound native soils or engineered fill can be designed to resist an earthquake force using Site Classification 'D' (stiff soil).



7.3 **Engineered Fill**

Where earth fill is required to raise the site, it is generally more economical to place engineered fill for normal footing, underground service pipes and road construction. The engineering requirements for a certifiable fill for road construction, municipal services, and footings designed with a Maximum Allowable Soil Pressure (SLS) of 150 kPa and a Factored Ultimate Soil Bearing Pressure (ULS) of 250 kPa are presented below:

1. All the topsoil must be removed, and the subgrade must be inspected and proof-rolled prior to any fill placement. The weathered soils and earth fill must be subexcavated, inspected, sorted free of organics and topsoil, aerated and properly compacted in layers.
2. The in situ organic-free soils can be used, and they must be uniformly compacted in 20 cm thick lifts to 98% or + of their maximum Standard Proctor dry density, up to the proposed lot grade and/or road subgrade. The soil moisture must be properly controlled near the optimum.
3. If the foundations are to be built soon after the fill placement, the densification process for the engineered fill must be increased to 100% of the maximum Standard Proctor compaction.
4. If imported fill is to be used, it should be inorganic soils, free of deleterious material with environmental issue (contamination). Any potential imported earth fill from off site must be reviewed for geotechnical and environmental quality by the appropriate personnel as authorized by the developer or agency, before it is hauled to the site.
5. If the engineered fill is to be left over the winter months, adequate earth cover, or equivalent, must be provided for protection against frost action.
6. The engineered fill must extend over the entire graded area; the engineered fill envelope and the finished elevations must be clearly and accurately defined in



the field, and they must be precisely documented by qualified surveyors.

7. Foundations partially on engineered fill must be reinforced by two 15-mm steel reinforcing bars, depending on the thickness of the fill, in the footings and upper section of the foundation walls, or be designed by a structural engineer to properly distribute the stress induced by the abrupt differential settlement (estimated to be $15 \pm$ mm) between the natural soils and engineered fill.
8. The engineered fill must not be placed during the period from late November to early April, when freezing ambient temperatures occur either persistently or intermittently. This is to ensure that the fill is free of frozen soils, ice and snow.
9. The fill operation must be inspected on a full-time basis by a technician under the direction of a geotechnical engineer.
10. Where the fill is to be placed on a bank steeper than 1 vertical:3 horizontal, the face of the bank must be flattened to 3 + so that it is suitable for safe operation of the compactor and the required compaction can be obtained.
11. Where the ground is wet due to subsurface water seepage, an appropriate subdrain scheme must be implemented prior to the fill placement, particularly if it is to be carried out on sloping ground.
12. The fill operation must be fully supervised and monitored by a technician under the direction of a geotechnical engineer.
13. The footings and underground services subgrade must be inspected by the geotechnical consulting firm that inspected the engineered fill placement. This is to ensure that the foundations are placed within the engineered fill envelope, and the integrity of the fill has not been compromised by interim construction, environmental degradation and/or disturbance by the footing excavation.
14. Any excavation carried out in certified engineered fill must be reported to the geotechnical consultant who inspected the fill placement in order to document



the locations of excavation and/or to inspect reinstatement of the excavated areas to engineered fill status. If construction on the engineered fill does not commence within a period of 2 years from the date of certification, the condition of the engineered fill must be assessed for re-certification.

15. Despite stringent control in the placement of the engineered fill, variations in soil type and density may occur in the engineered fill. Therefore, the foundations must be properly reinforced and designed by structural engineer for the project. The total and differential settlements of 25 mm and 15 mm, respectively, should be considered in the design of the foundations founded on engineered fill. In sewer construction, the engineered fill is considered to have the same structural proficiency as a natural inorganic soil.

7.4 **Underground Services**

The subgrade for the underground services should consist of natural soils or engineered fill. In areas where the subgrade consists of earth fill and/or weathered soil or loose soils, these soils should be subexcavated and replaced with properly compacted inorganic soil and/or bedding material compacted to at least 95% or + of their Standard Proctor compaction.

Where the sewers are to be constructed using the open-cut method, the construction must be carried out in accordance with Ontario Regulation 213/91. In areas where a vertical cut is necessary, the use of a trench box is appropriate.

A Class 'B' bedding is recommended for construction of the underground services. The bedding material should consist of compacted 20-mm Crusher-Run Limestone, or equivalent, as approved by a geotechnical engineer. Where water bearing soil is present, a Class 'A' bearing should be used. This can be determined at the time of construction.



In order to prevent pipe floatation when the sewer trench is deluged with water, a soil cover with a thickness equal to the diameter of the pipe should be in place at all times after completion of the pipe installation.

Openings to subdrains and catch basins should be shielded with a fabric filter to prevent blockage by silting.

The subgrade of the underground services will generally consist of silty clay till of moderate corrosivity. The underground services should be protected against soil corrosion. For estimation of anode weight requirements, the estimated electrical resistivity of 3500 ohm·cm can be used. This, however, should be confirmed by testing the soil along the water main alignment at the time of sewer construction.

7.5 **Backfilling in Trenches and Excavated Areas**

The backfill in service trenches should be compacted to at least 95% of its maximum Standard Proctor dry density and increased to 98% below the floor-slab.

In the zone within 1.0 m below the road subgrade, the material should be compacted with the water content 2% to 3% drier than the optimum; and the compaction should be increased to 98% of the respective maximum Standard Proctor dry density to provide the required stiffness for pavement construction.

Most of the in situ inorganic soils are generally suitable for use as trench backfill; however, where the soil is too wet for a 95% or + Standard Proctor compaction, it can be aerated by spreading it thinly on the ground for drying prior to structural compaction. In cases where the material is too dry to compact, it may require the addition of water or mixing with a wet material.



In normal construction practice, the problem areas of settlement largely occur adjacent to foundation walls, columns, manholes, catch basins and services crossings. In areas which are inaccessible to a heavy compactor, sand backfill should be used. Unless compaction of the backfill is carefully performed, settlement will occur. Often, the interface of the native soils and sand backfill will have to be flooded for a period of several days.

Narrow trenches for services crossings should be cut at 1V:2H, so that the backfill in the trenches can be effectively compacted. Otherwise, soil arching in the trenches will prevent the achievement of proper compaction. The lift of each backfill layer should either be limited to a thickness of 20 cm, or the thickness should be determined by test strips.

One must be aware of possible consequences during trench backfilling and exercise caution as described below:

- When construction is carried out in freezing winter weather, allowance should be made for these following conditions. Despite stringent backfill monitoring, frozen soil layers may inadvertently be mixed with the structural trench backfill. Should the in situ soil have a water content on the dry side of the optimum, it would be impossible to wet the soil due to the freezing condition, rendering difficulties in obtaining uniform and proper compaction. Furthermore, the freezing condition will prevent flooding of the backfill when it is required, such as when the trench box is removed. The above will invariably cause backfill settlement that may become evident within 1 to several years, depending on the depth of the trench which has been backfilled.
- In areas where the underground services construction is carried out during winter months, prolonged exposure of the trench walls will result in frost heave within the soil mantle of the walls. This may result in some settlement



- as the frost recedes, and repair costs will be incurred prior to final surfacing of the new pavement.
- To backfill a deep trench, one must be aware that future settlement is to be expected, unless the side of the cut is flattened to at least $1V:1.5+H$, and the lifts of the fill and its moisture content are stringently controlled; i.e., lifts should be no more than 20 cm (or less if the backfilling conditions dictate) and uniformly compacted to achieve at least 95% of the maximum Standard Proctor dry density, with the moisture content on the wet side of the optimum.
 - It is often difficult to achieve uniform compaction of the backfill in the lower vertical section of a trench which is an open cut or is stabilized by a trench box, particularly in the sector close to the trench walls or the sides of the box. These sectors must be backfilled with sand. In a trench stabilized by a trench box, the void left after the removal of the box will be filled by the backfill. It is necessary to backfill this sector with sand, and the compacted backfill must be flooded for 1 day, prior to the placement of the backfill above this sector, i.e., in the upper sloped trench section. This measure is necessary in order to prevent consolidation of inadvertent voids and loose backfill which will compromise the compaction of the backfill in the upper section. In areas where groundwater movement is expected in the sand fill mantle, anti-seepage collars should be provided.

7.6 **Garages, Driveways and Landscaping**

Due to moderately high frost susceptibility of the underlying soil, heaving of the pavement is expected to occur during the cold weather. The driveways at the entrances to the garages must be backfilled with non-frost-susceptible granular material, with a frost taper at a slope of $1V:1H$.

The slab-on-grade in open areas should be designed to tolerate frost heave, and the



grading around the slab-on-grade must be such that it directs runoff away from the surface.

Interlocking stone pavement and slab-on-grade to be constructed in areas susceptible to ground movement must be constructed on a free-draining granular base at least 1.0 m thick, with proper drainage, which will prevent water from ponding in the granular base.

7.7 **Pavement Design**

In preparation of the pavement subgrade, topsoil and earth fill must be removed and the entire area should be proofrolled. Any soft spots should be subexcavated, and replaced by properly compacted inorganic earth fill. New fill should consist of organic free material, compacted to 95% or + of its maximum Standard Proctor dry density. In the zone within 1.0 m below the pavement subgrade, the backfill should be compacted to 98% or + of its maximum Standard Proctor dry density, with the water content 2% to 3% drier than the optimum. The pavement design for local residential roadway and collectors is presented in Table 5.

Table 5 - Pavement Design

Course	Thickness (mm)	OPS Specifications
Asphalt Surface	40	HL-3
Asphalt Binder	60	HL-8
Granular Base	150	OPSS Granular 'A'
Granular Sub-Base	350	OPSS Granular 'B'

All the granular bases should be compacted to their maximum Standard Proctor dry density.



The pavement subgrade will suffer a strength regression if water is allowed to infiltrate prior to paving. The following measures should therefore be incorporated into the construction and pavement design:

- If the pavement construction does not immediately follow the trench backfilling, the subgrade should be properly crowned and smooth-rolled to allow interim precipitation to be properly drained.
- Lot areas adjacent to the roads should be properly graded to prevent the ponding of large amounts of water during the interim construction period.
- If the roads are to be constructed during the wet seasons and extremely soft subgrade occurs, the granular sub-base may require thickening. This can be further assessed during construction.
- Fabric filter-encased curb subdrains are required to meet the Town requirements. These subdrains should be collected to catch basins or positive outlets where water can be removed by gravity.

7.8 Soil Parameters

The recommended soil parameters for the project design are given in Table 6.

Table 6 - Soil Parameters

<u>Unit Weight and Bulk Factor</u>	<u>Unit Weight</u> <u>(kN/m³)</u>	<u>Estimated</u> <u>Bulk Factor</u>	
	Bulk	Loose	Compacted
Earth Fill	21.0	1.25	1.00
Silty Clay Till / Sandy Silt Till	22.0	1.33	1.05
<u>Lateral Earth Pressure Coefficients</u>	Active K_a	At Rest K_o	Passive K_p
Compacted Earth Fill	0.43	0.60	2.30
Silty Clay Till / Sandy Silt Till	0.36	0.53	2.70

**Table 6 - Soil Parameters (cont'd)**

<u>Coefficients of Friction</u>	
Between Concrete and Granular Base	0.50
Between Concrete and Sound Natural Soils	0.40

7.9 **Excavation**

Excavation should be carried out in accordance with Ontario Regulation 213/91.

For excavation purposes, the types of soils are classified in Table 7.

Table 7 - Classification of Soils for Excavation

Material	Type
Silty Clay Till / Sandy Silt Till	2
Earth Fill	3

Excavation into the till containing cobbles and boulders will require extra effort and the use of heavy-duty equipment.

In excavation, any groundwater yield is anticipated to be slow in rate and limited in quantity. It can be collected into a sump and remove by conventional pumping.

Prospective contractors must be asked to assess the in situ subsurface conditions for soil cuts by digging test pits to at least 0.5 m below the sewer subgrade. These test pits should be allowed to remain open for a period of at least 4 hours to assess the trenching conditions.



8.0 LIMITATIONS OF REPORT

This report was prepared by Soil Engineers Ltd. for the account of Brookvalley Project Management Inc., for review by the designated consultants, financial institutions, and government agencies. Use of this report is subject to the conditions and limitations of the contractual agreement. The material in the report reflects the judgment of Adrian Lo, B.Sc. and Bennett Sun, P.Eng., in light of the information available to it at the time of preparation. Any use which a Third Party makes of this report, or any reliance on decisions to be made based on it, are the responsibility of such Third Parties. Soil Engineers Ltd. accepts no responsibility for damages, if any, suffered by any Third Party as a result of decisions made or actions based on this report.

SOIL ENGINEERS LTD.

Adrian Lo, B.Sc.

Bennett Sun, P.Eng.
AL/BS

LIST OF ABBREVIATIONS AND DESCRIPTION OF TERMS

The abbreviations and terms commonly employed on the borehole logs and figures, and in the text of the report, are as follows:

SAMPLE TYPES

AS Auger sample
 CS Chunk sample
 DO Drive open (split spoon)
 DS Denison type sample
 FS Foil sample
 RC Rock core (with size and percentage recovery)
 ST Slotted tube
 TO Thin-walled, open
 TP Thin-walled, piston
 WS Wash sample

SOIL DESCRIPTION

Cohesionless Soils:

<u>'N' (blows/ft)</u>	<u>Relative Density</u>
0 to 4	very loose
4 to 10	loose
10 to 30	compact
30 to 50	dense
over 50	very dense

Cohesive Soils:

PENETRATION RESISTANCE

Dynamic Cone Penetration Resistance:

A continuous profile showing the number of blows for each foot of penetration of a 2-inch diameter, 90° point cone driven by a 140-pound hammer falling 30 inches.

Plotted as '—●—'

Undrained Shear

<u>Strength (ksf)</u>	<u>'N' (blows/ft)</u>	<u>Consistency</u>
less than 0.25	0 to 2	very soft
0.25 to 0.50	2 to 4	soft
0.50 to 1.0	4 to 8	firm
1.0 to 2.0	8 to 16	stiff
2.0 to 4.0	16 to 32	very stiff
over 4.0	over 32	hard

Standard Penetration Resistance or 'N' Value:

The number of blows of a 140-pound hammer falling 30 inches required to advance a 2-inch O.D. drive open sampler one foot into undisturbed soil.

Plotted as '○'

WH Sampler advanced by static weight
 PH Sampler advanced by hydraulic pressure
 PM Sampler advanced by manual pressure
 NP No penetration

Method of Determination of Undrained Shear Strength of Cohesive Soils:

x 0.0 Field vane test in borehole; the number denotes the sensitivity to remoulding

△ Laboratory vane test

□ Compression test in laboratory

For a saturated cohesive soil, the undrained shear strength is taken as one half of the undrained compressive strength

METRIC CONVERSION FACTORS

1 ft = 0.3048 metres

1lb = 0.454 kg

1 inch = 25.4 mm

1ksf = 47.88 kPa



Soil Engineers Ltd.


CONSULTING ENGINEERS

GEOTECHNICAL • ENVIRONMENTAL • HYDROGEOLOGICAL • BUILDING SCIENCE

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 1


FIGURE NO.: 1

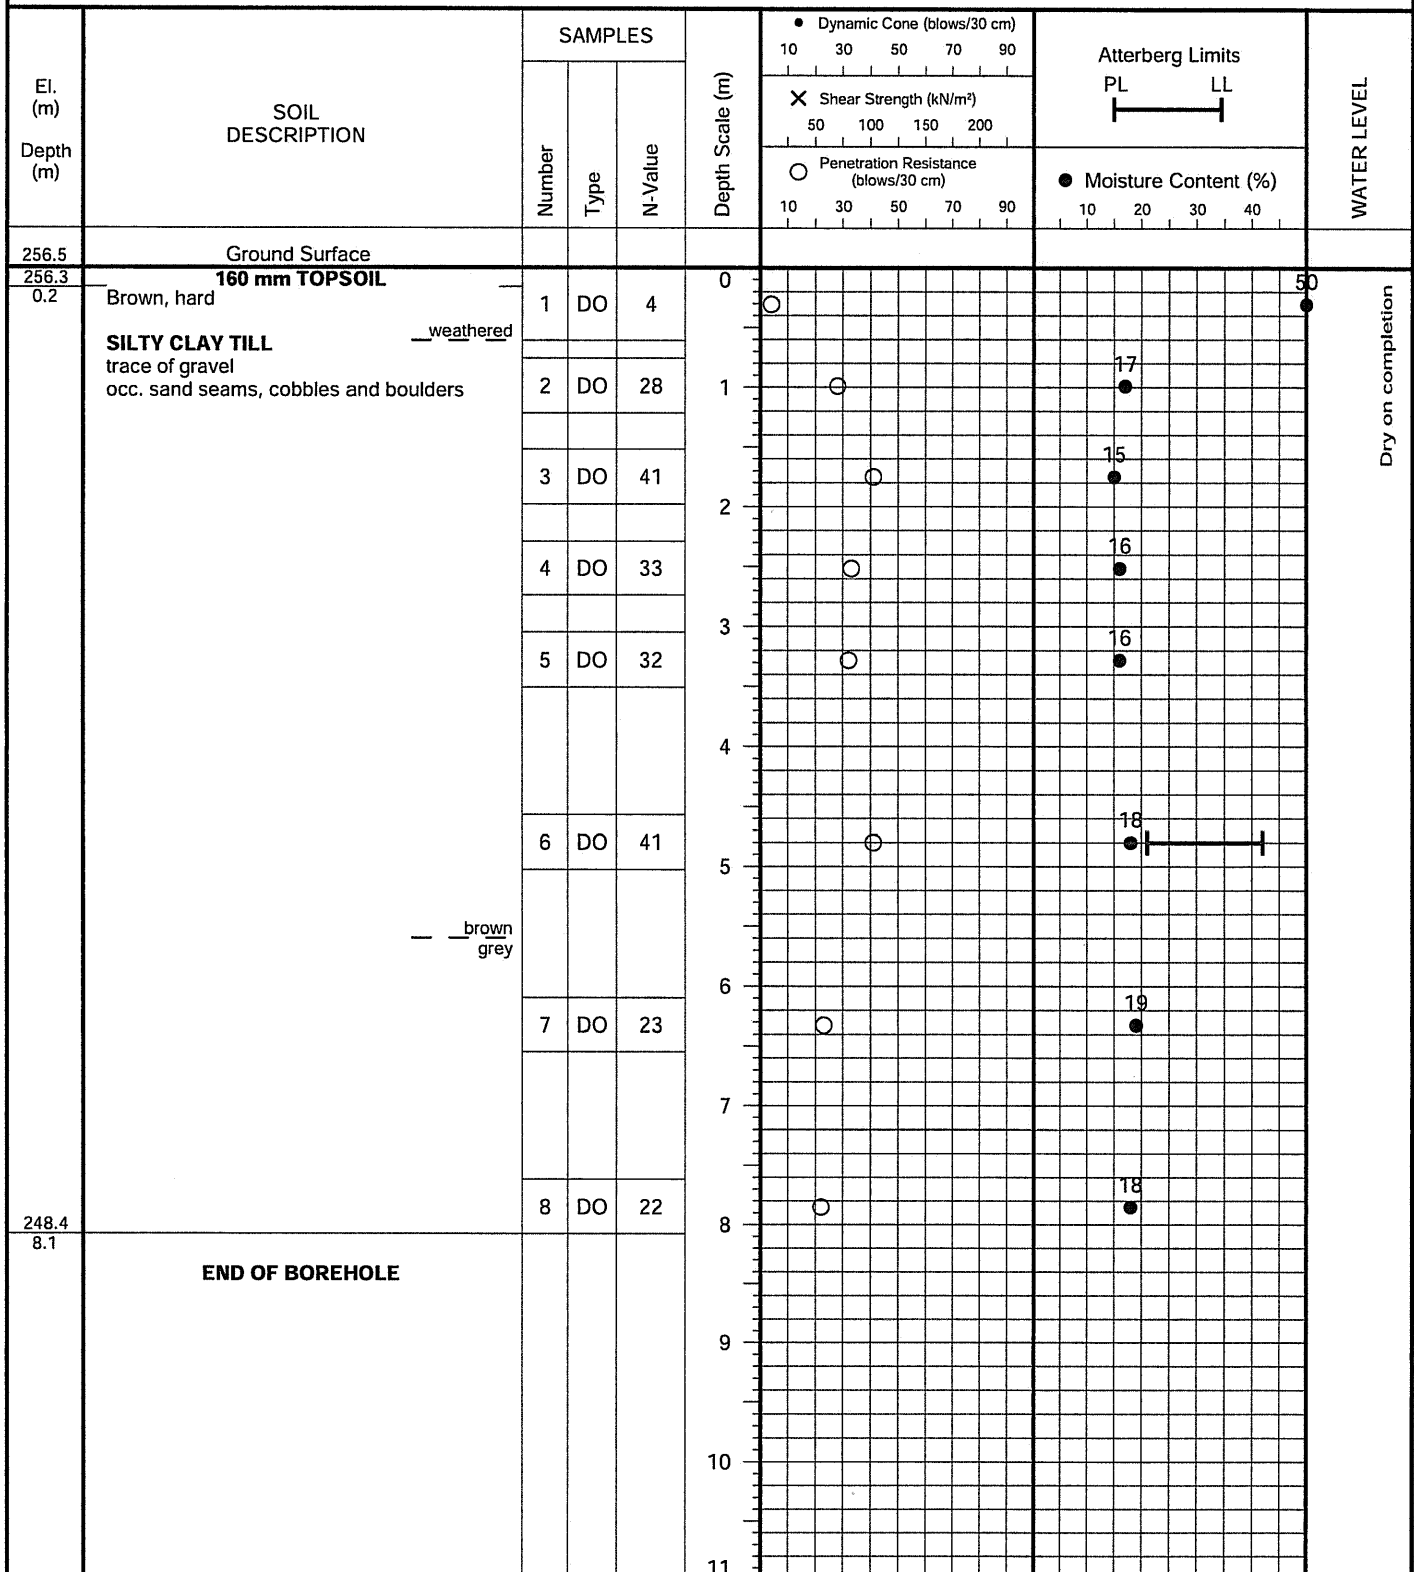PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 2


FIGURE NO.: 2

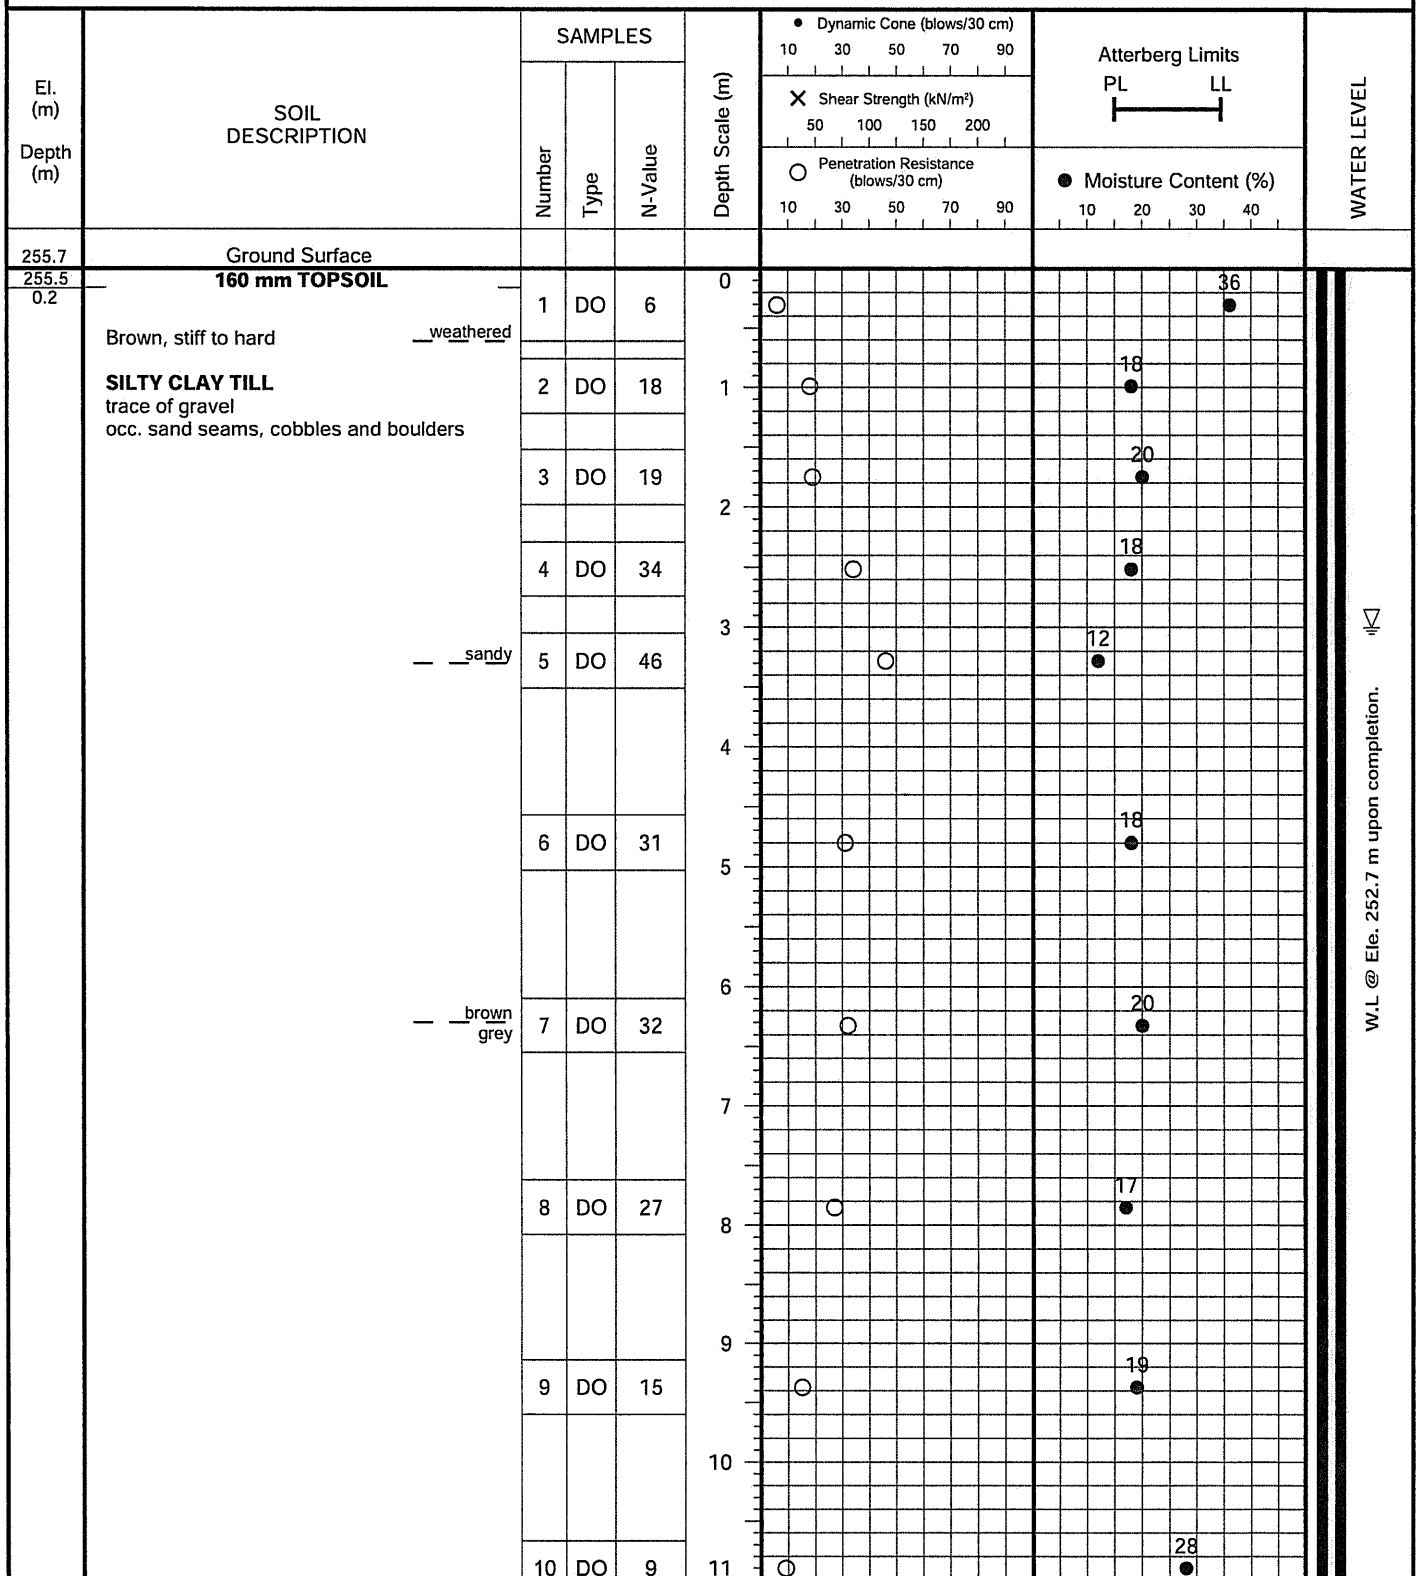PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 2


FIGURE NO.: 2

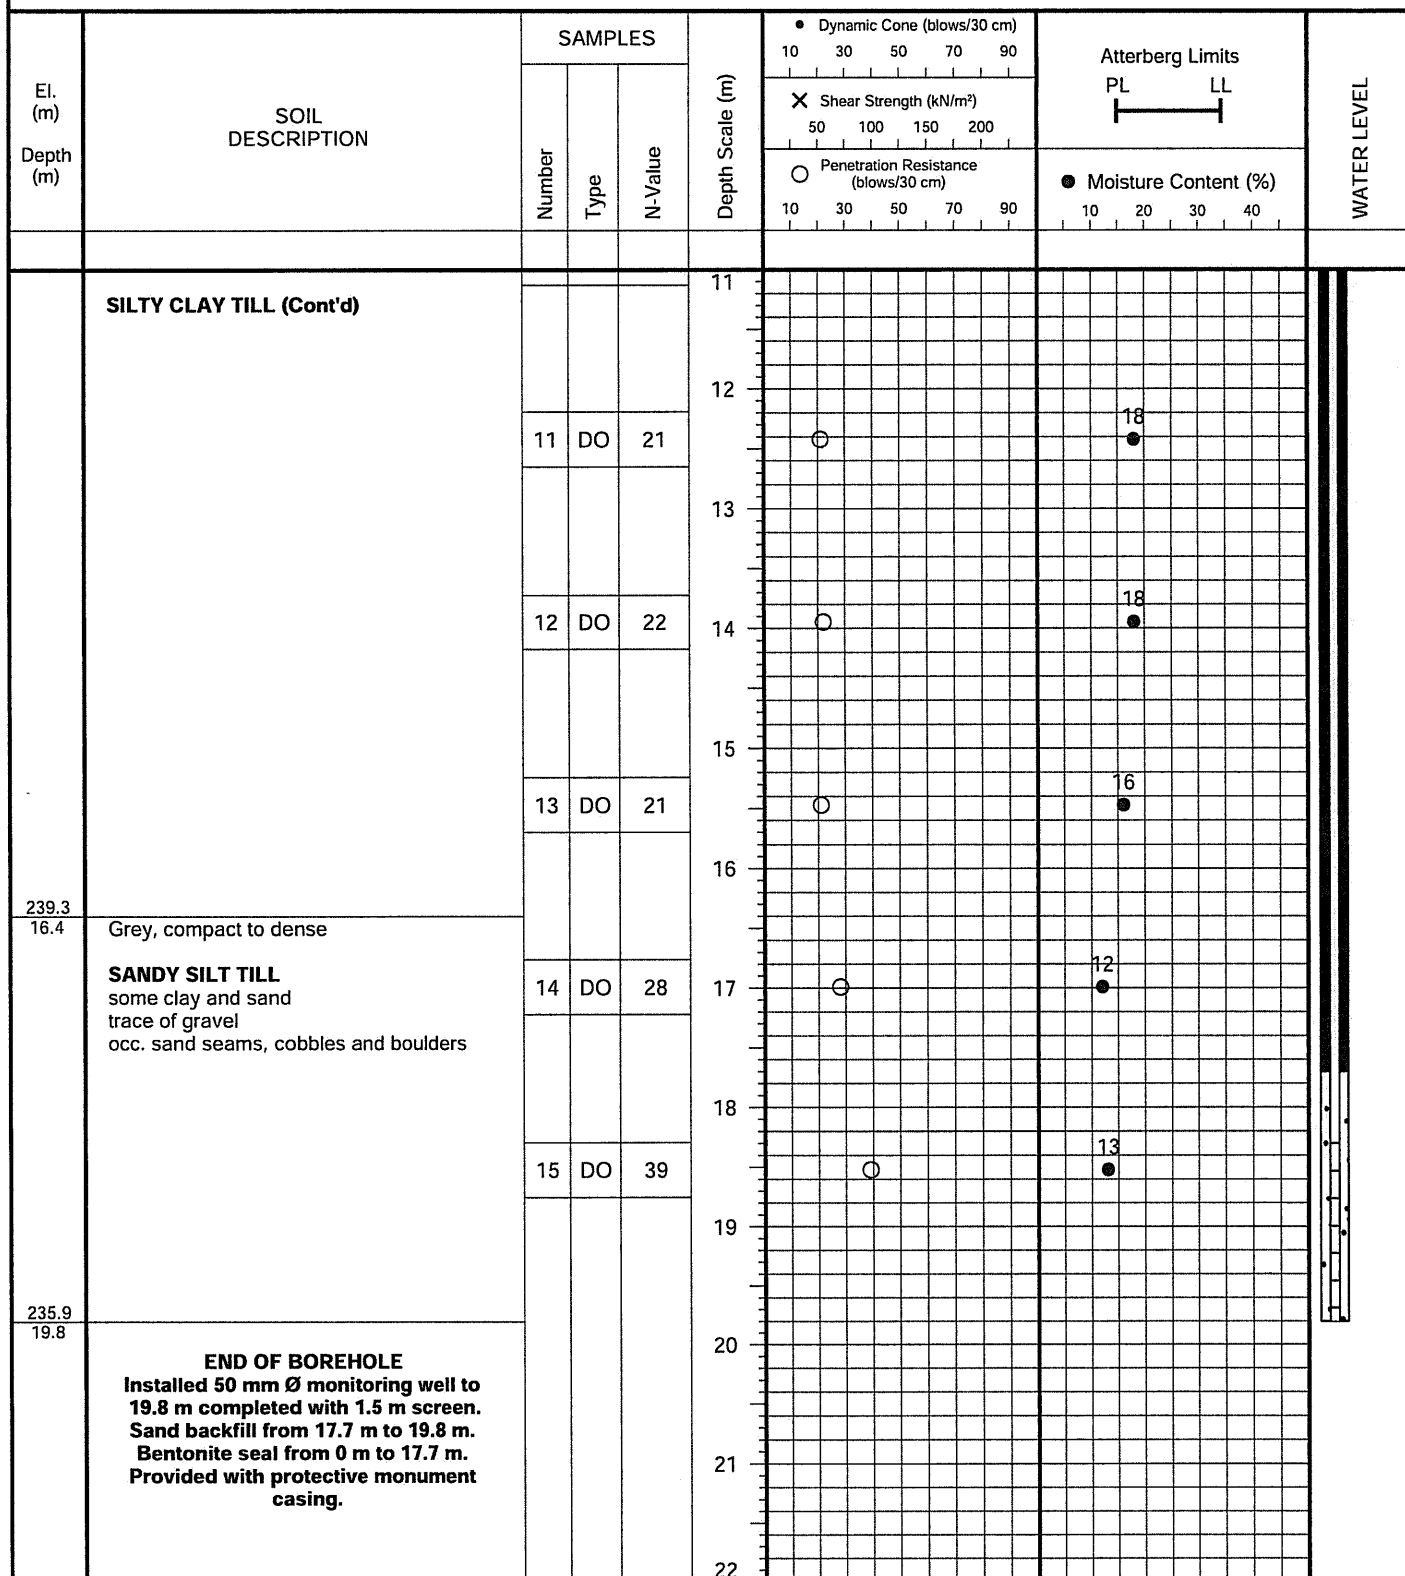PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 2N


FIGURE NO.: 2

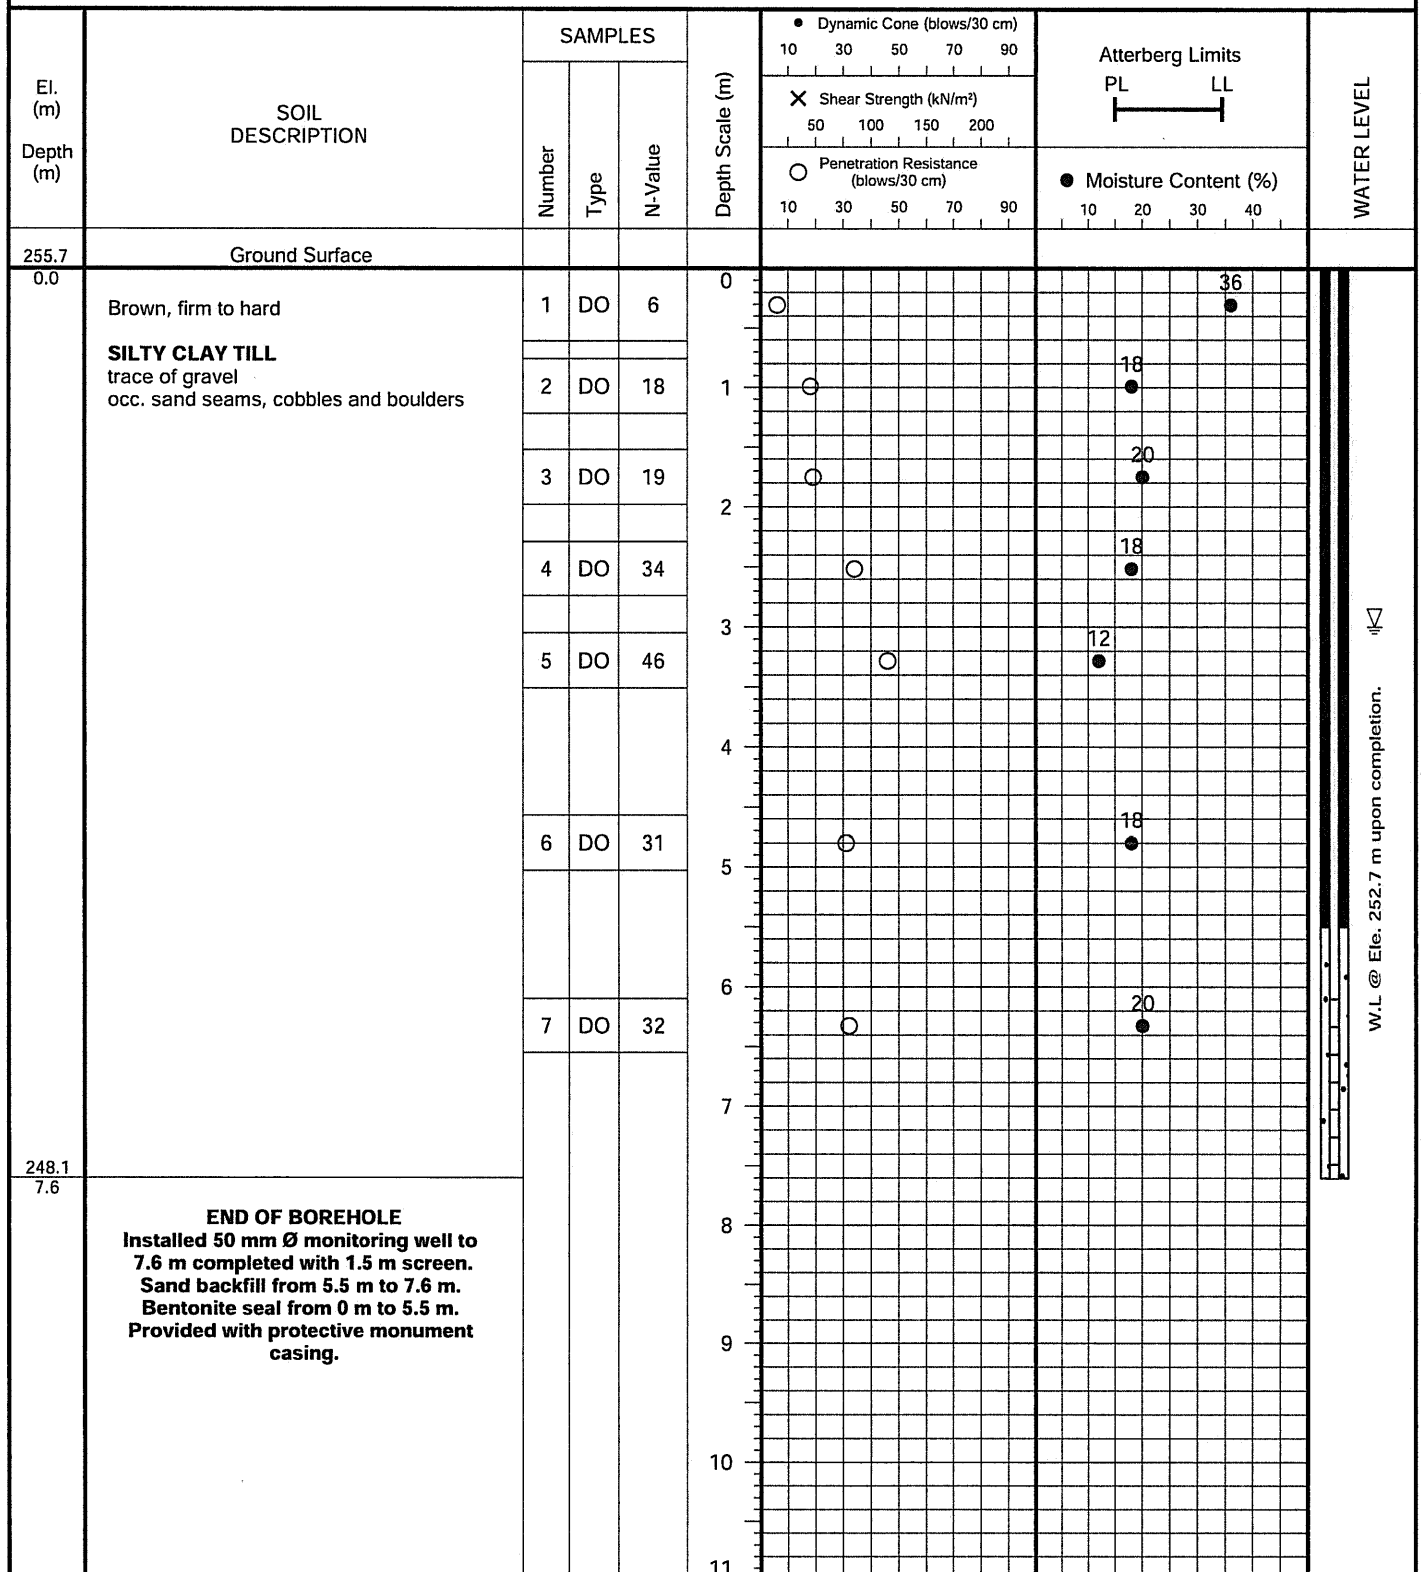PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 3


FIGURE NO.: 3

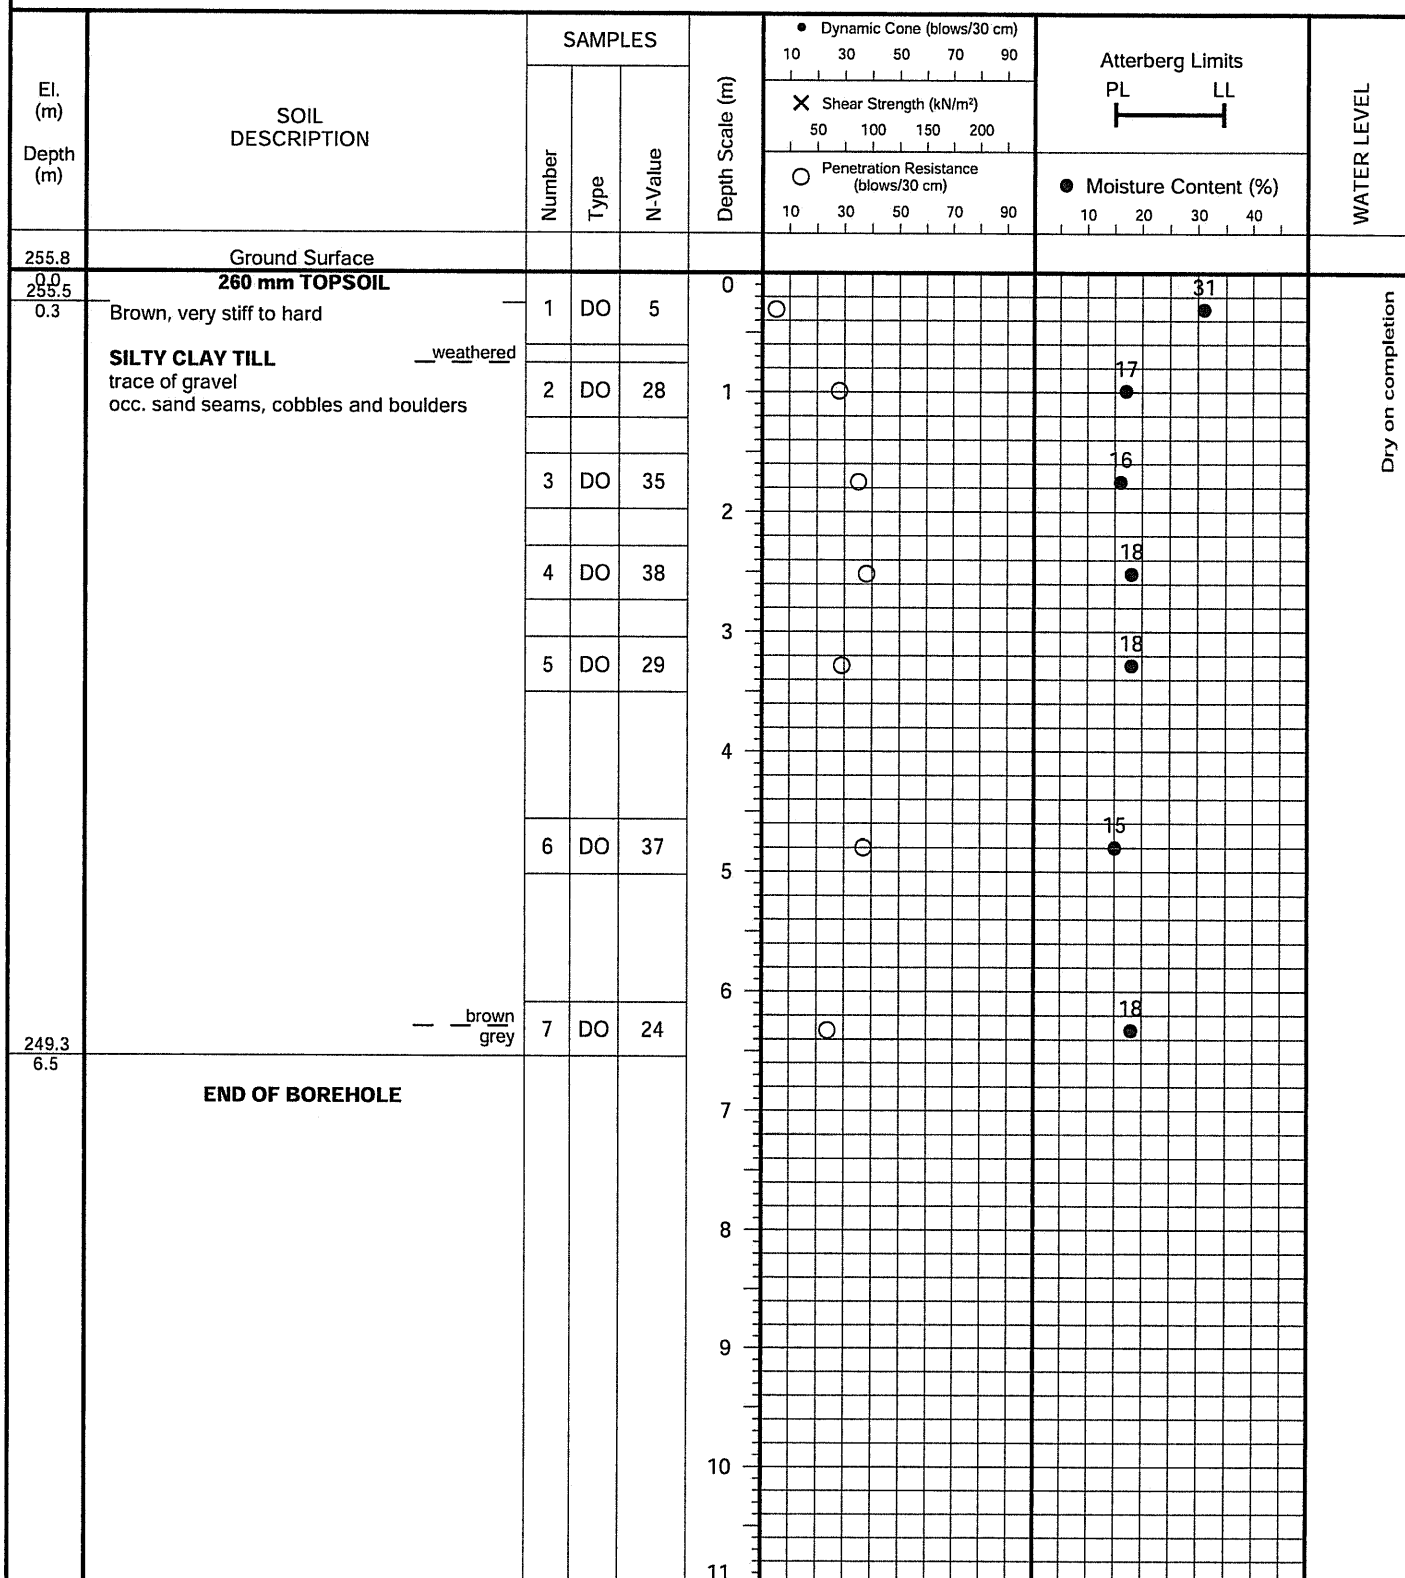PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 4


FIGURE NO.: 4

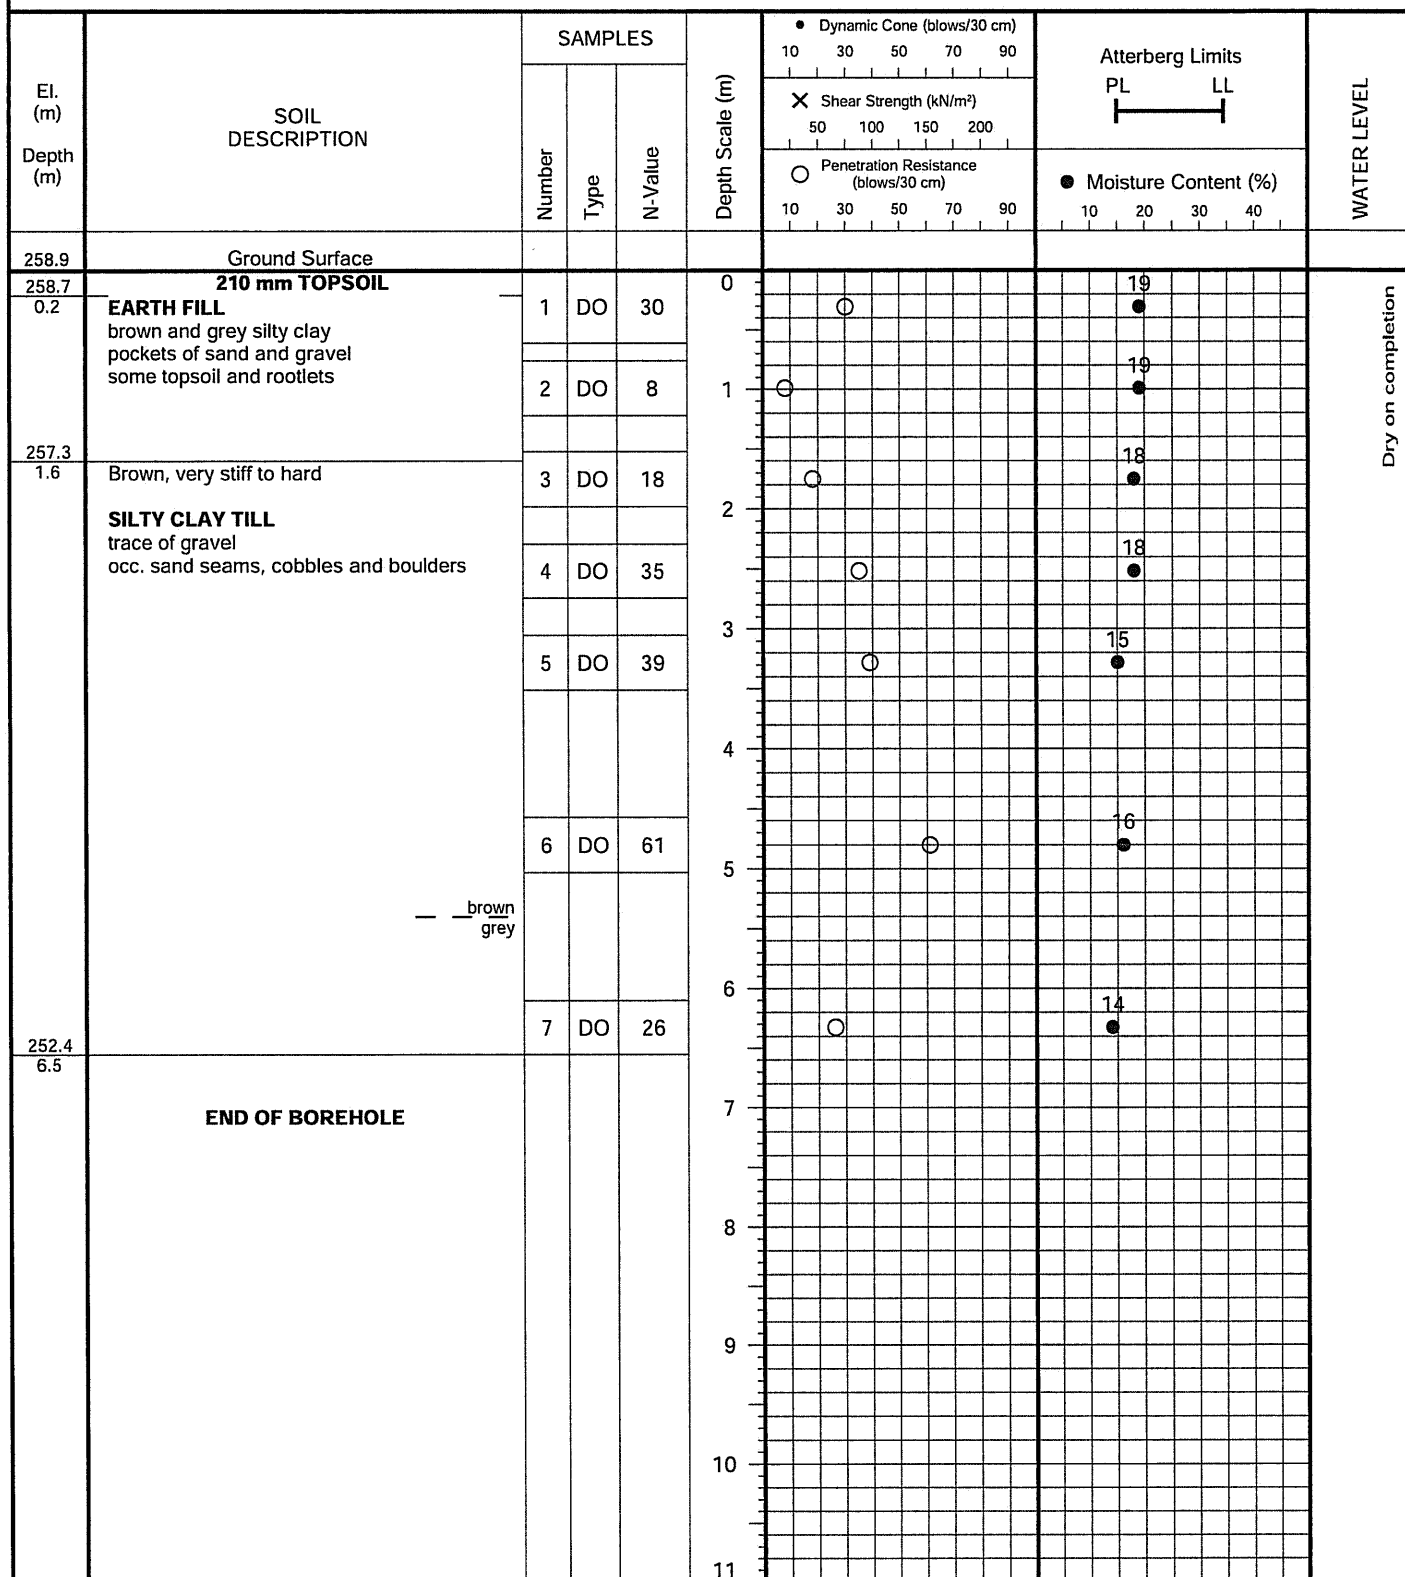PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 29, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 5


FIGURE NO.: 5

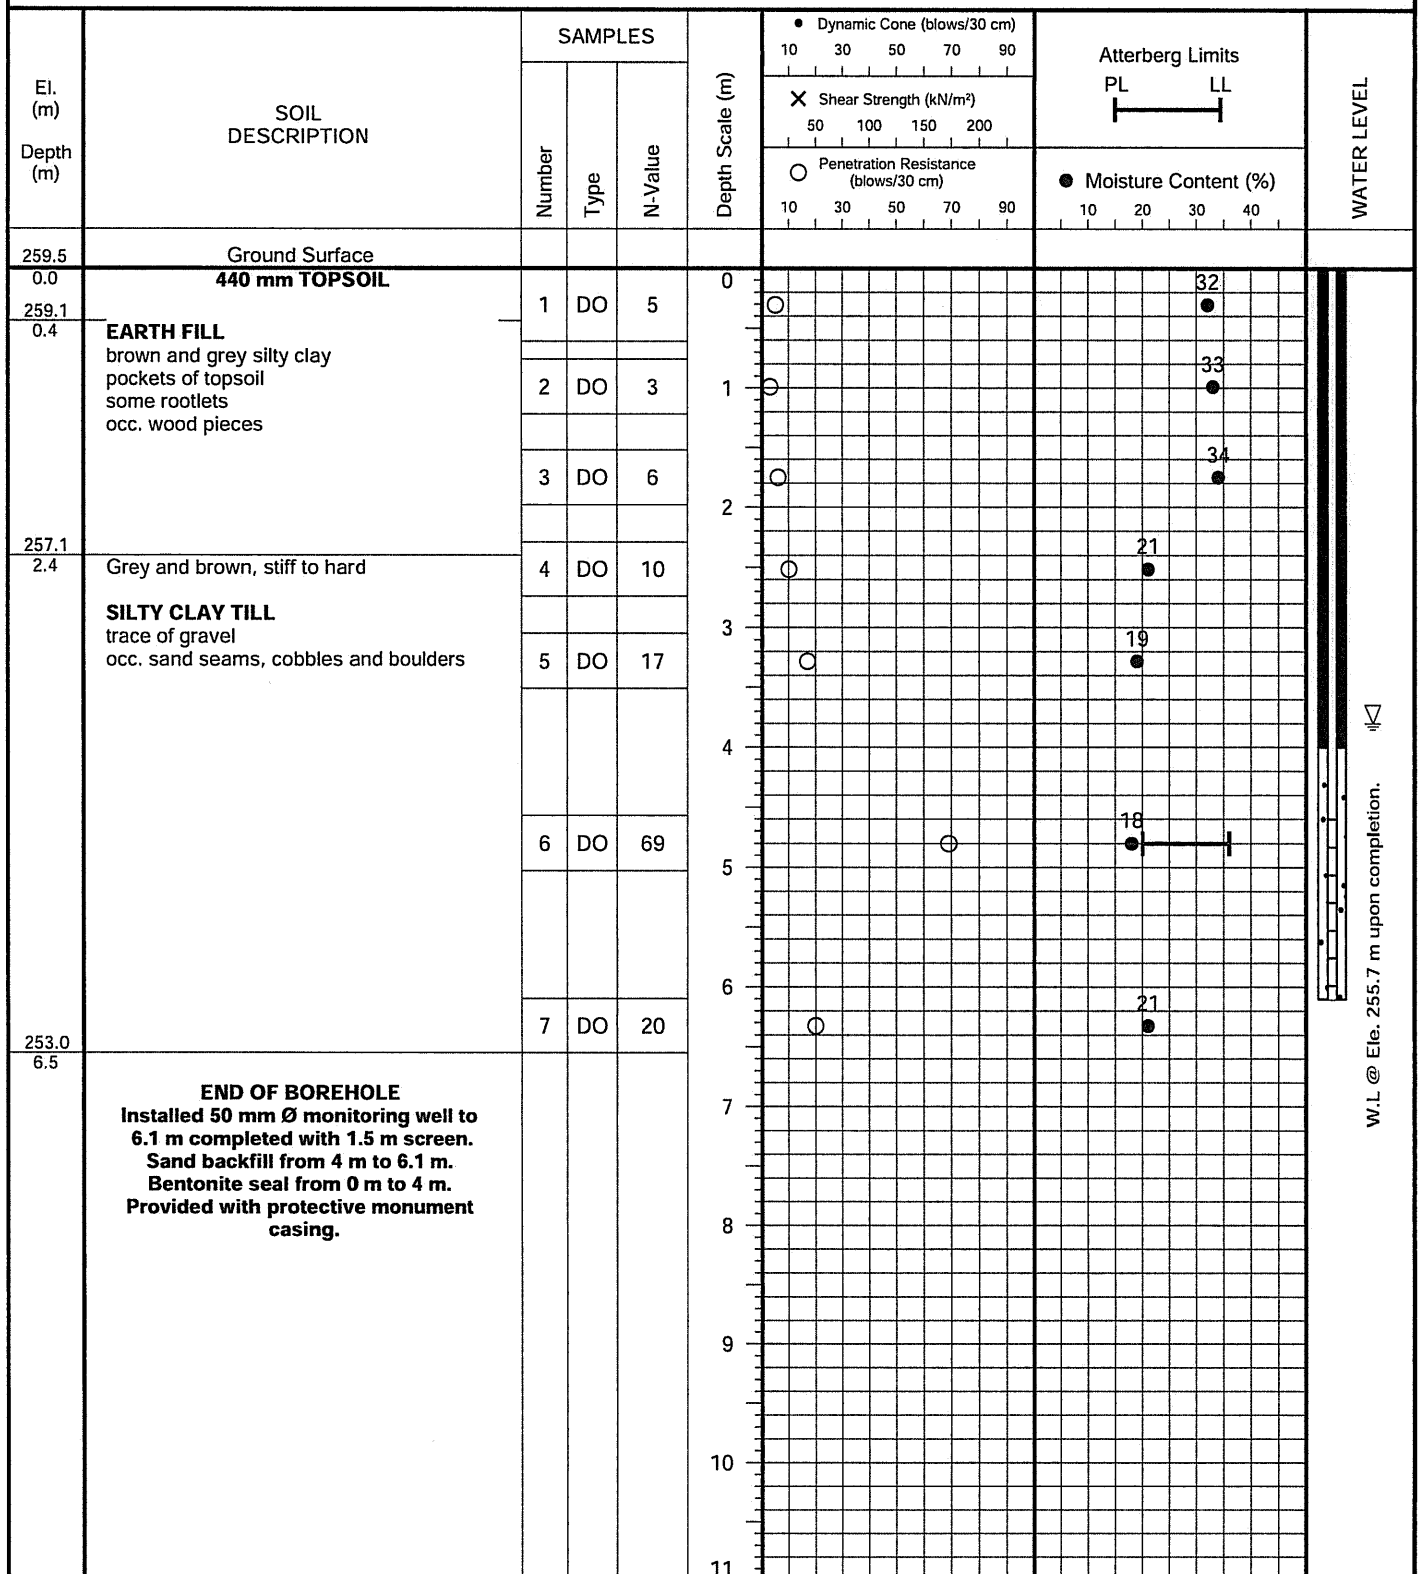PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 29, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 6


FIGURE NO.: 6

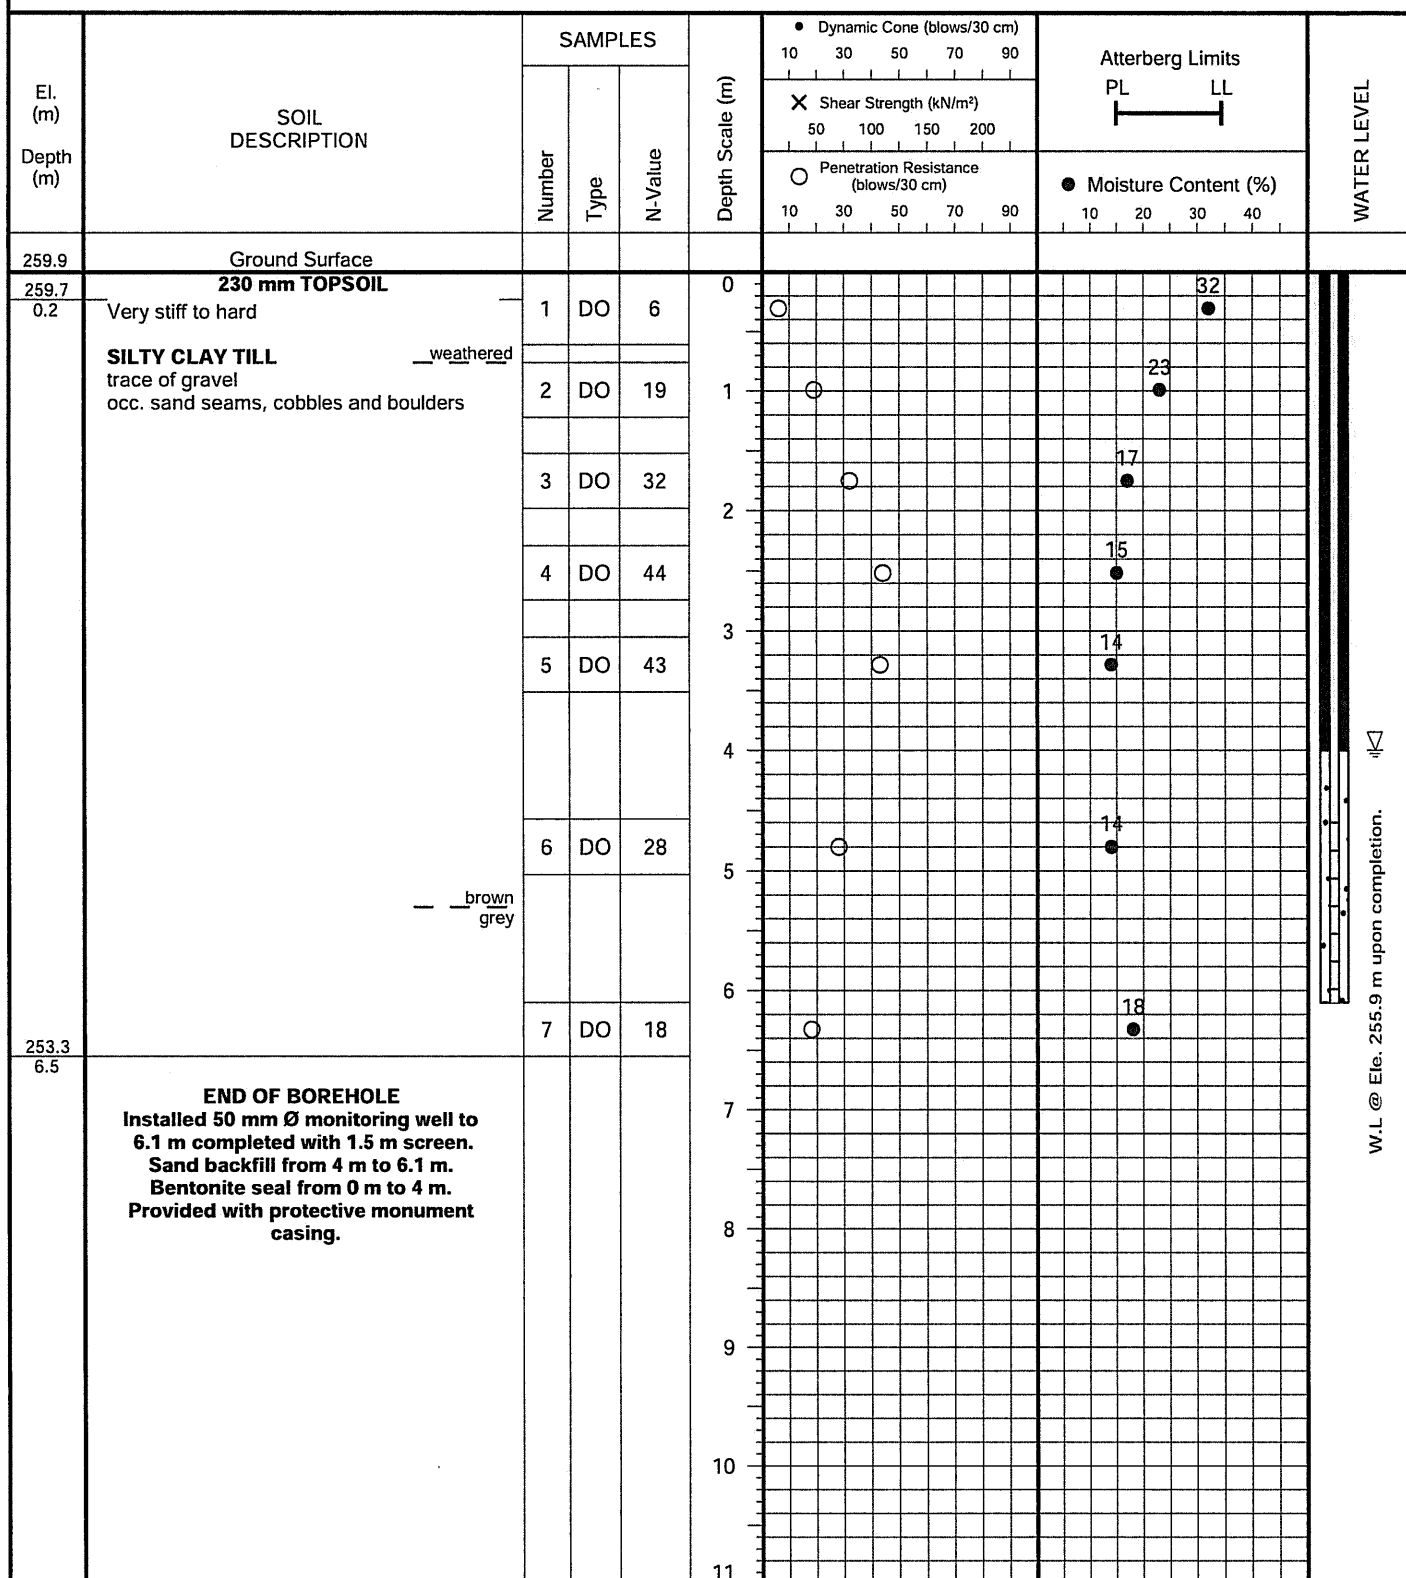PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 25, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 7


FIGURE NO.: 7

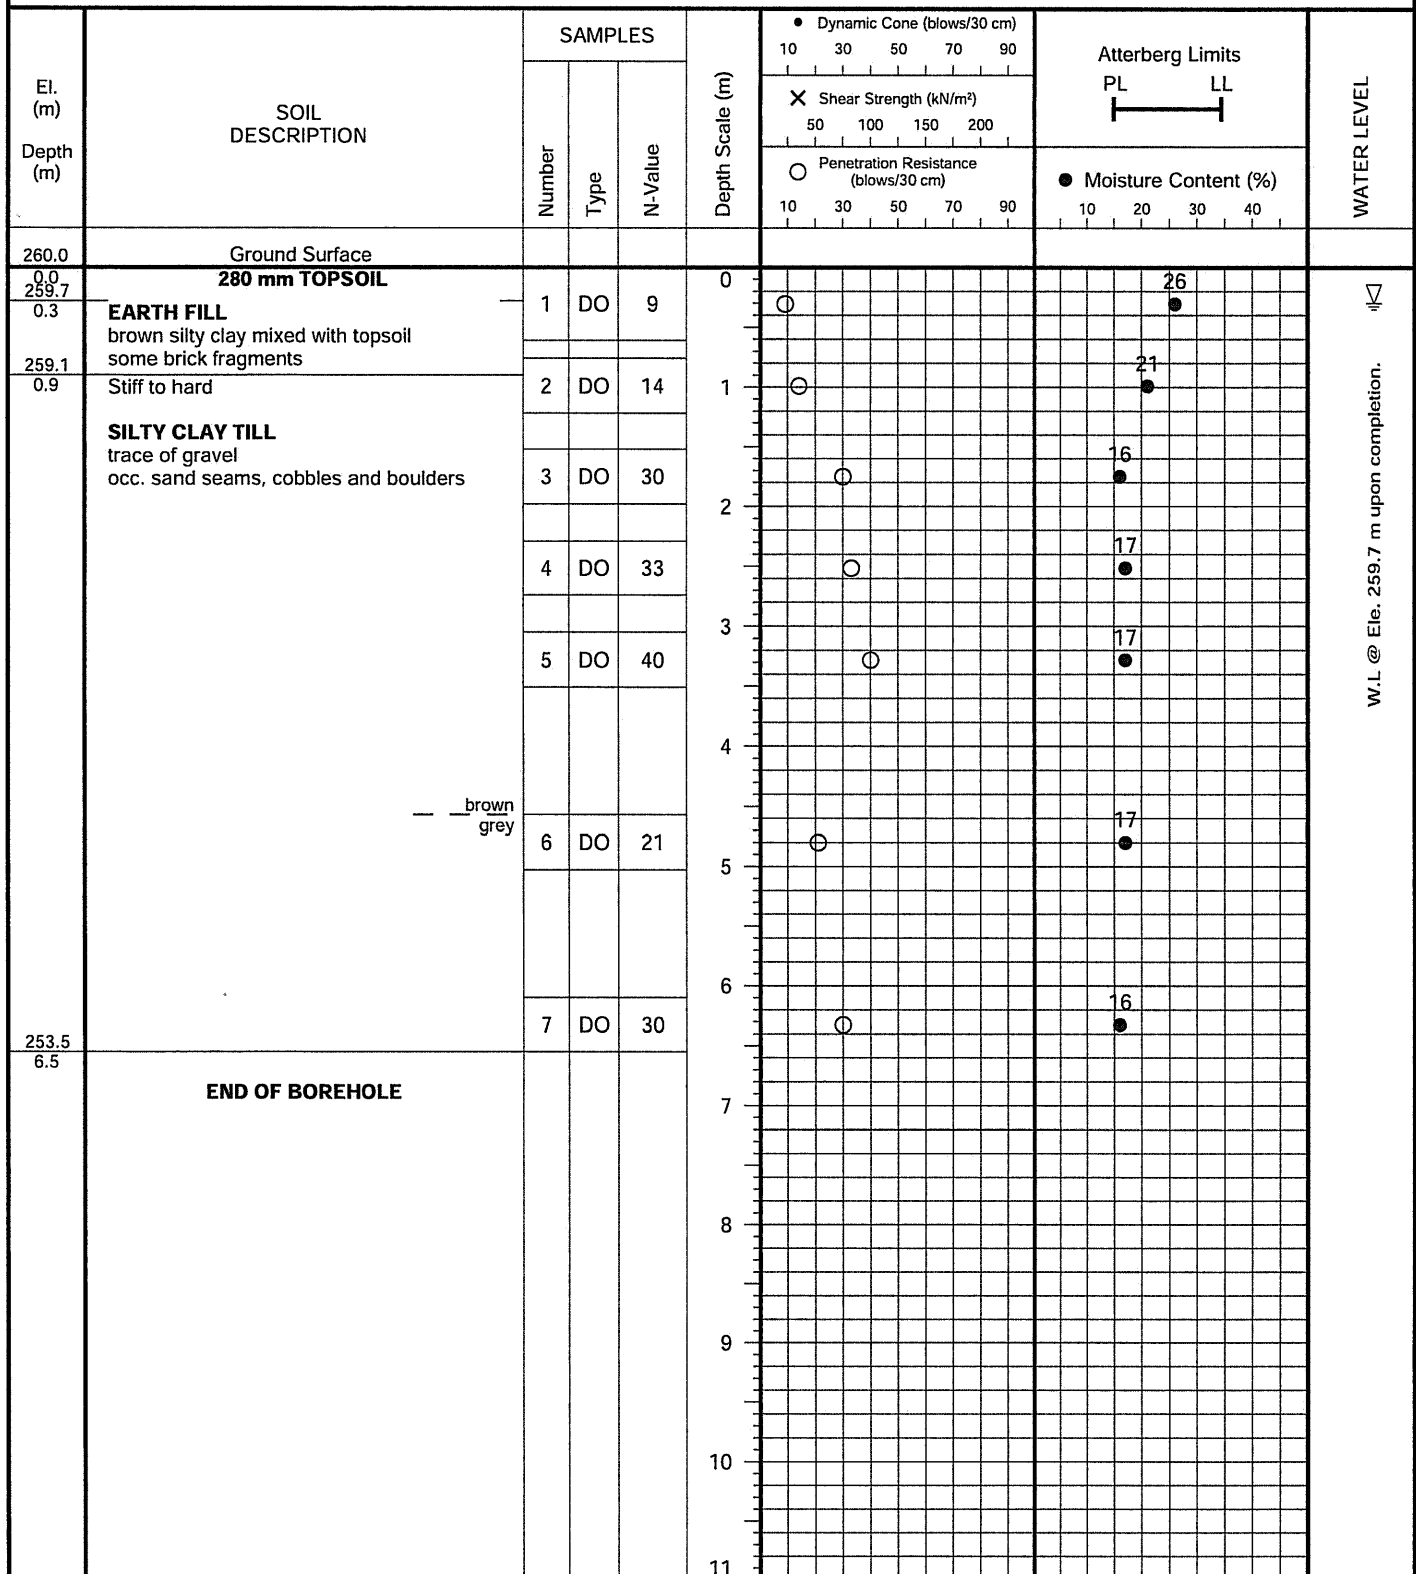PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 23, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 8


FIGURE NO.: 8

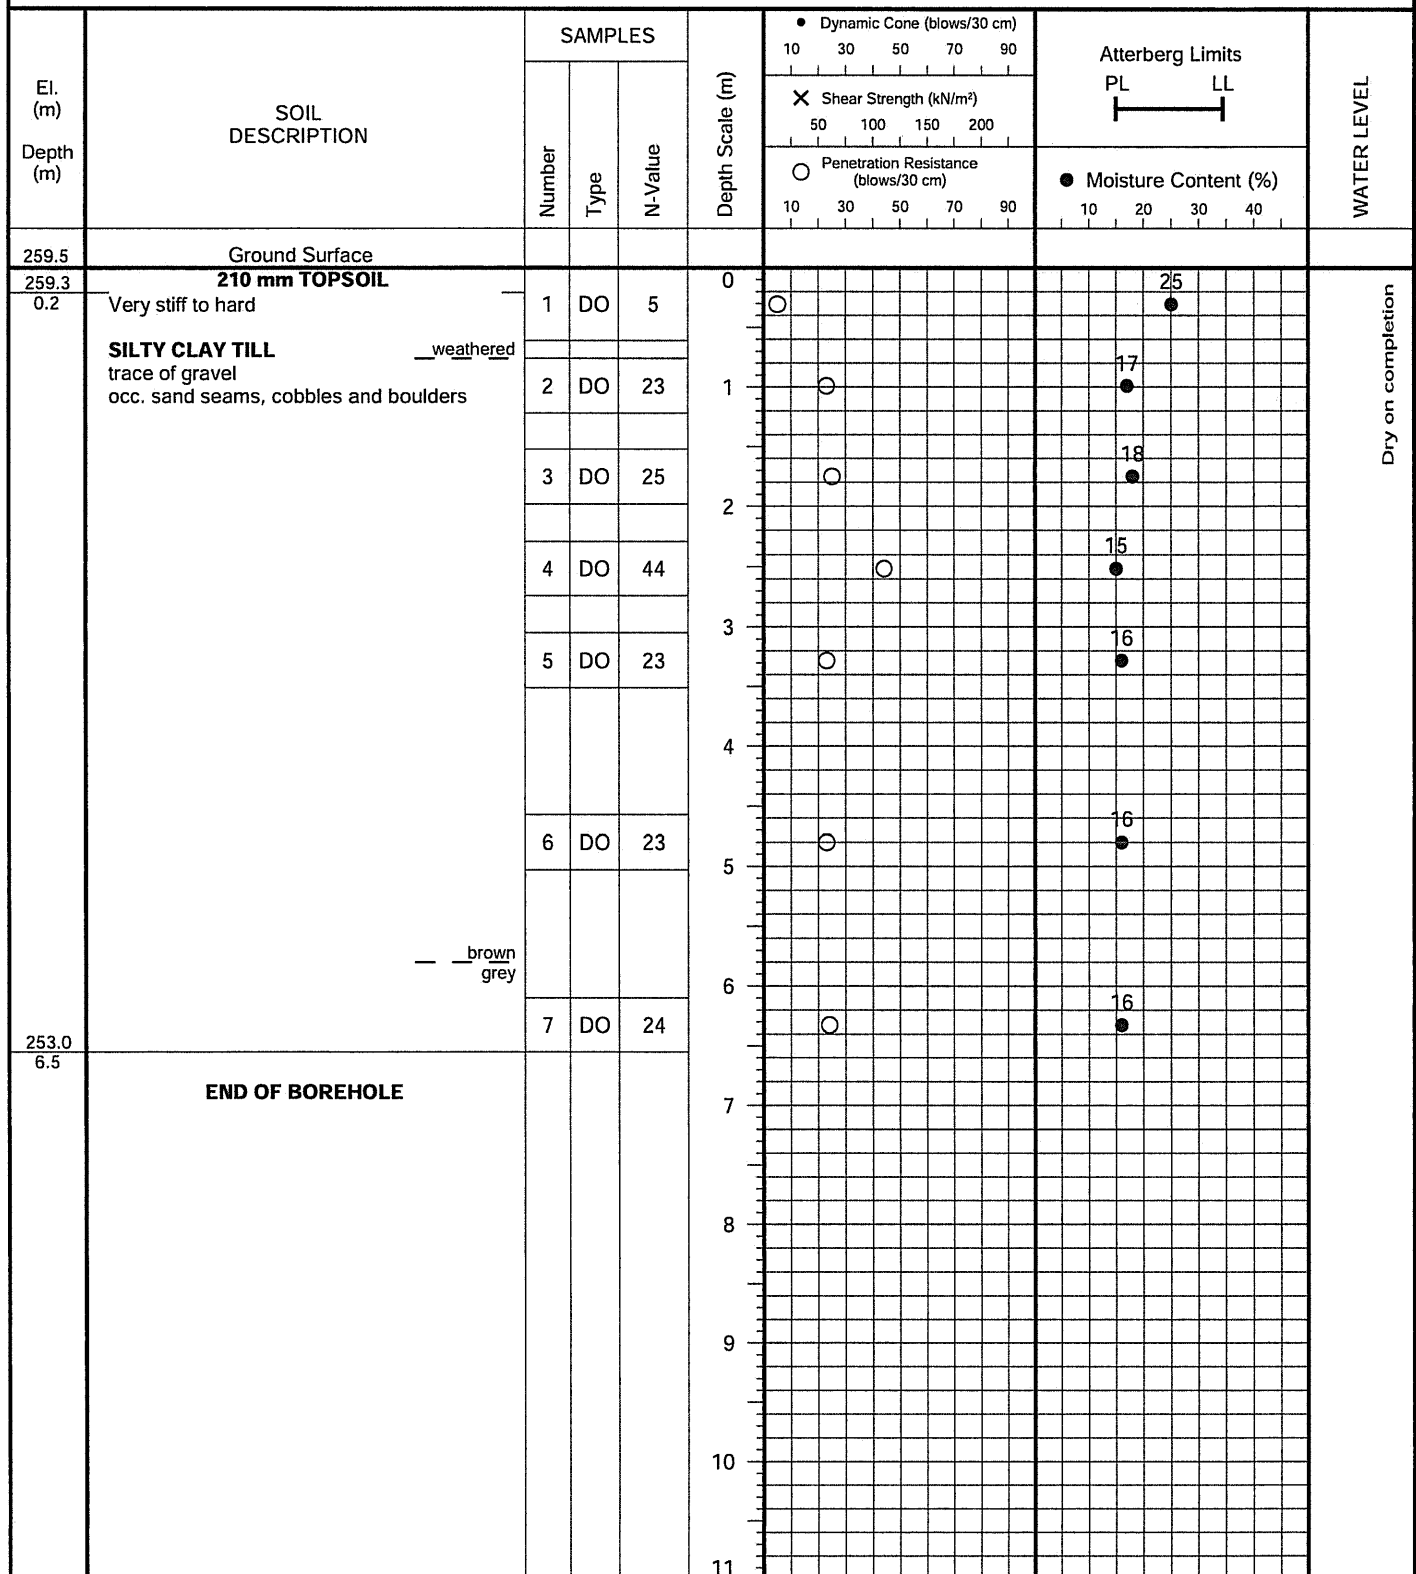PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 23, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 9


FIGURE NO.: 9

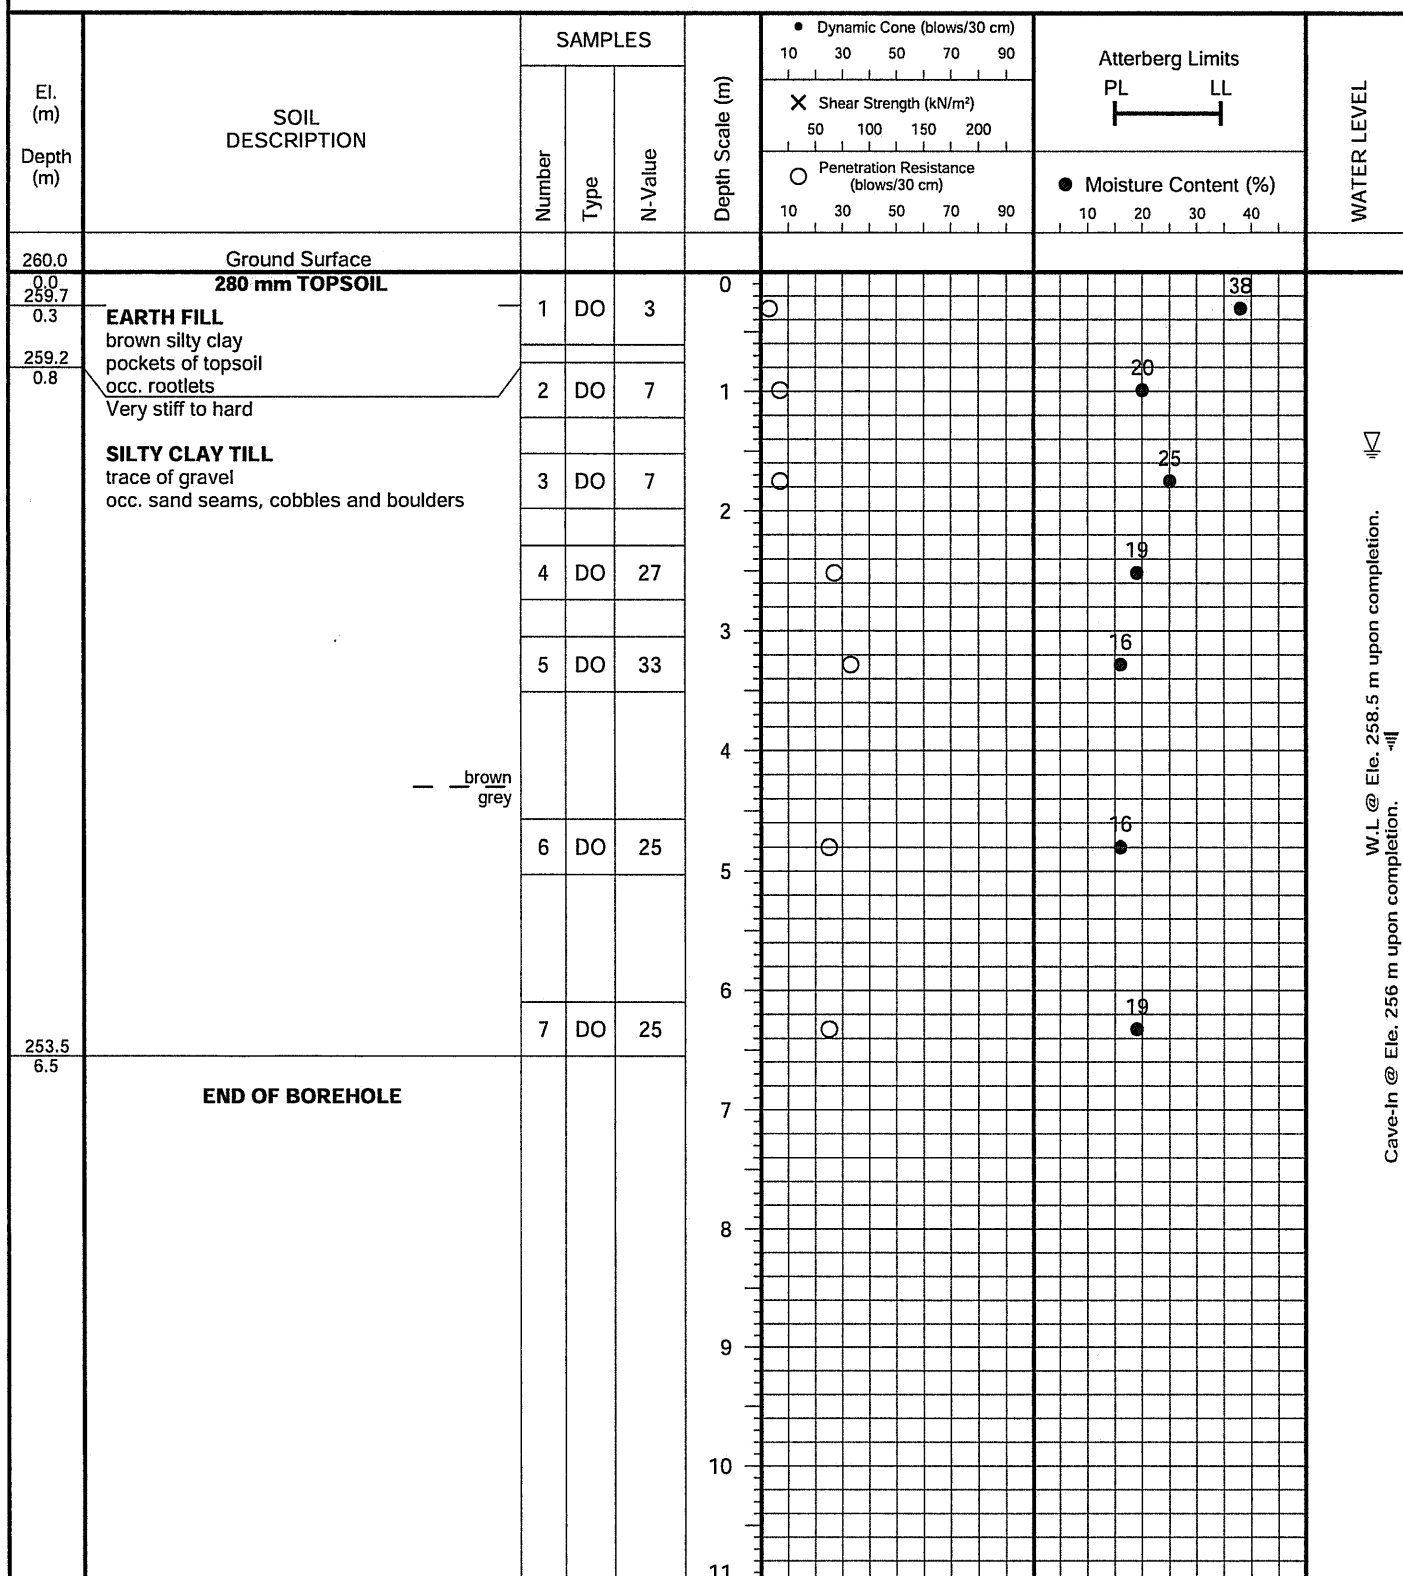PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 23, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 10


FIGURE NO.: 10

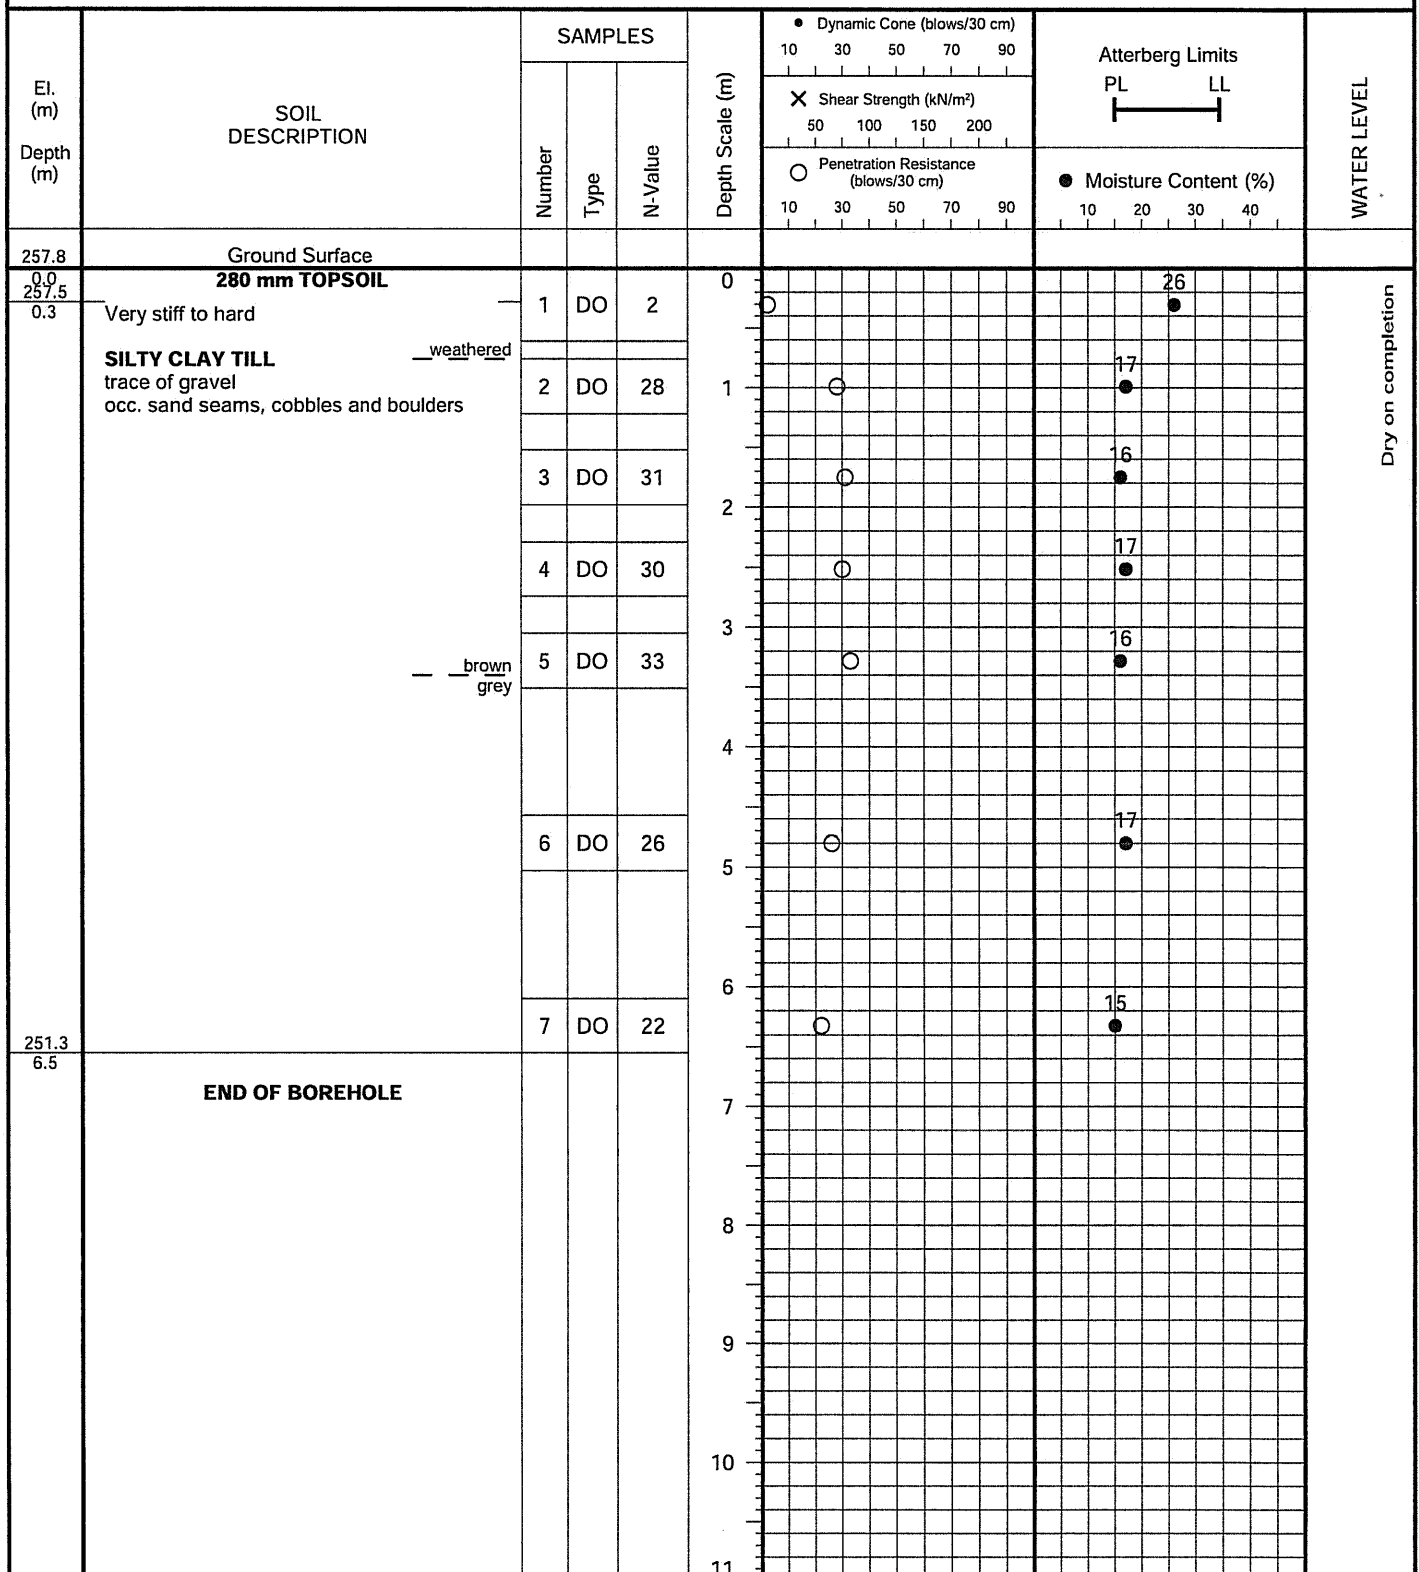PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 23, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 11


FIGURE NO.: 11

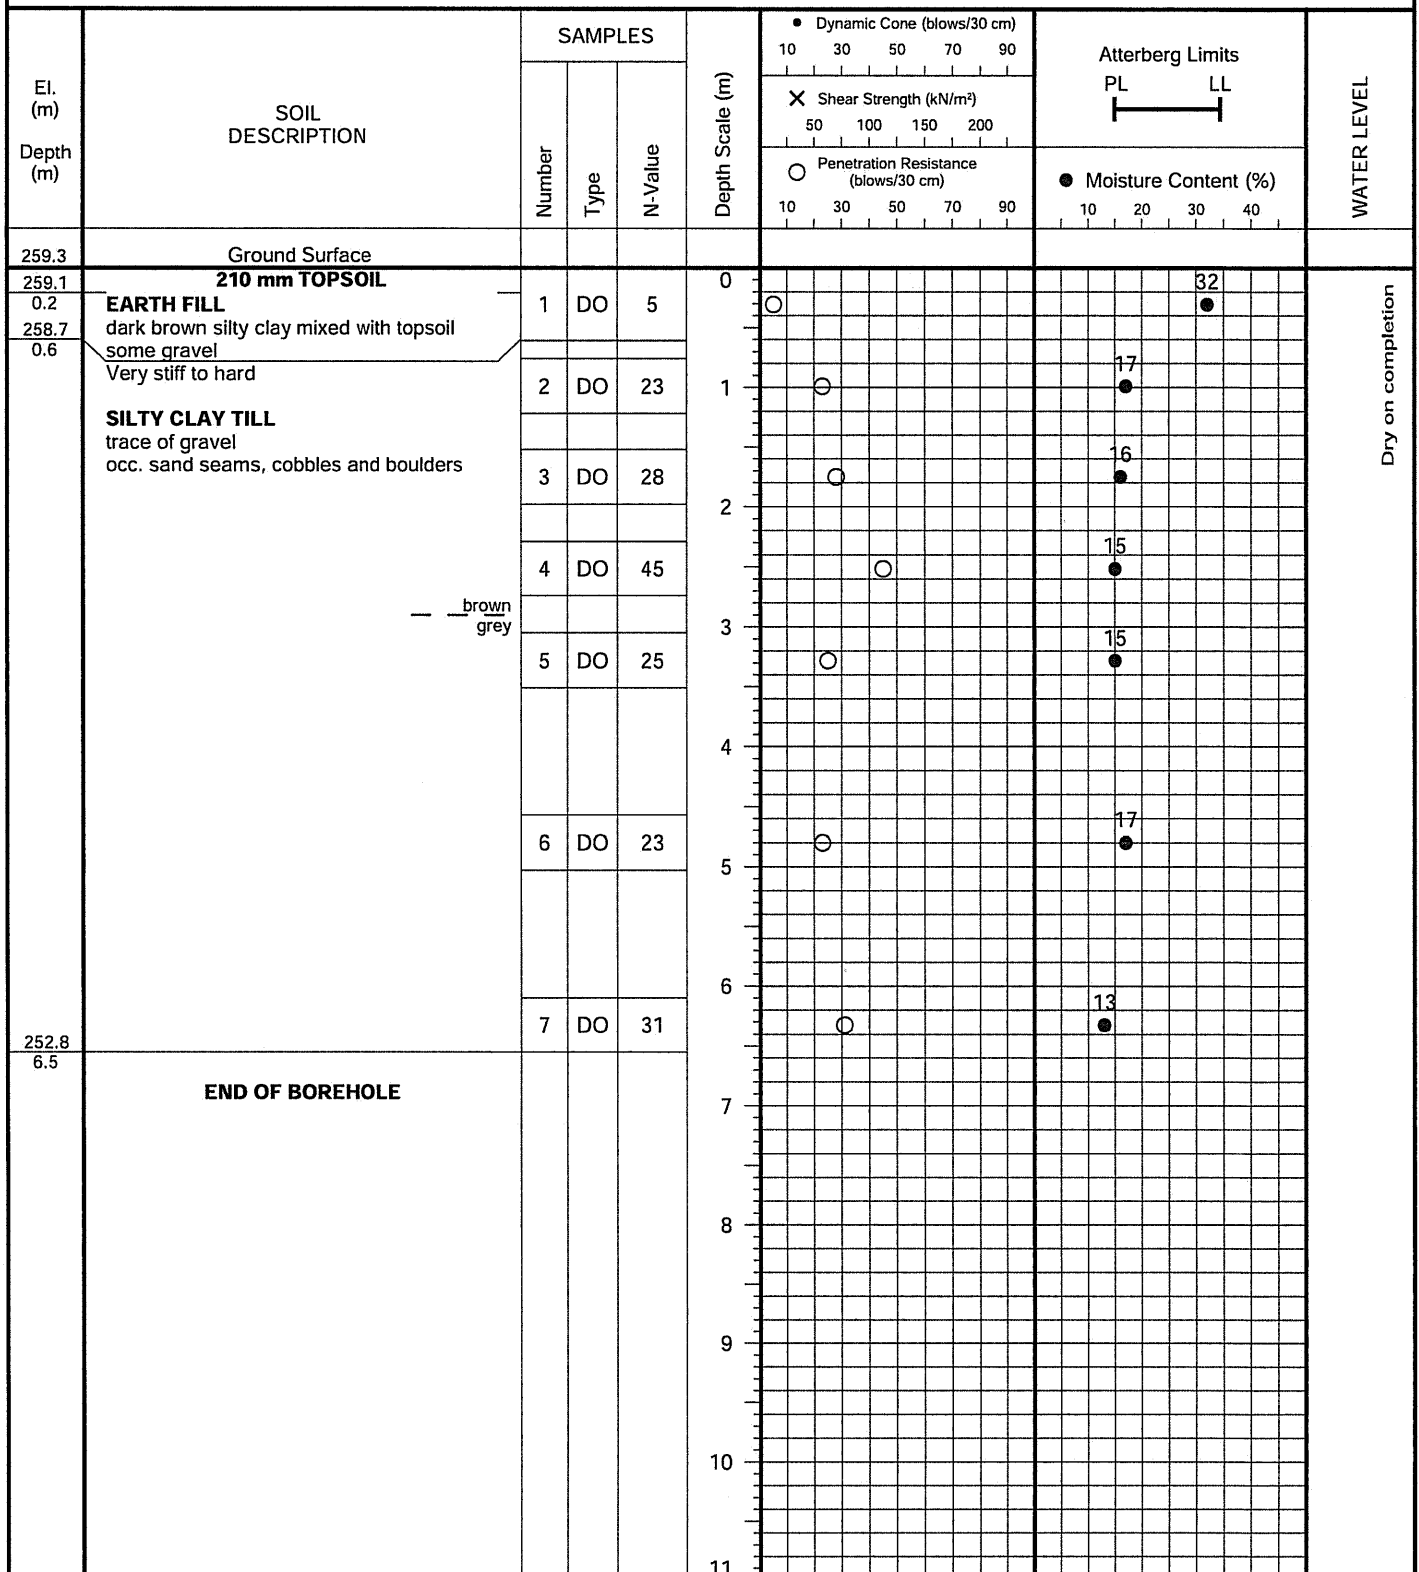PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 23, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 12


FIGURE NO.: 12

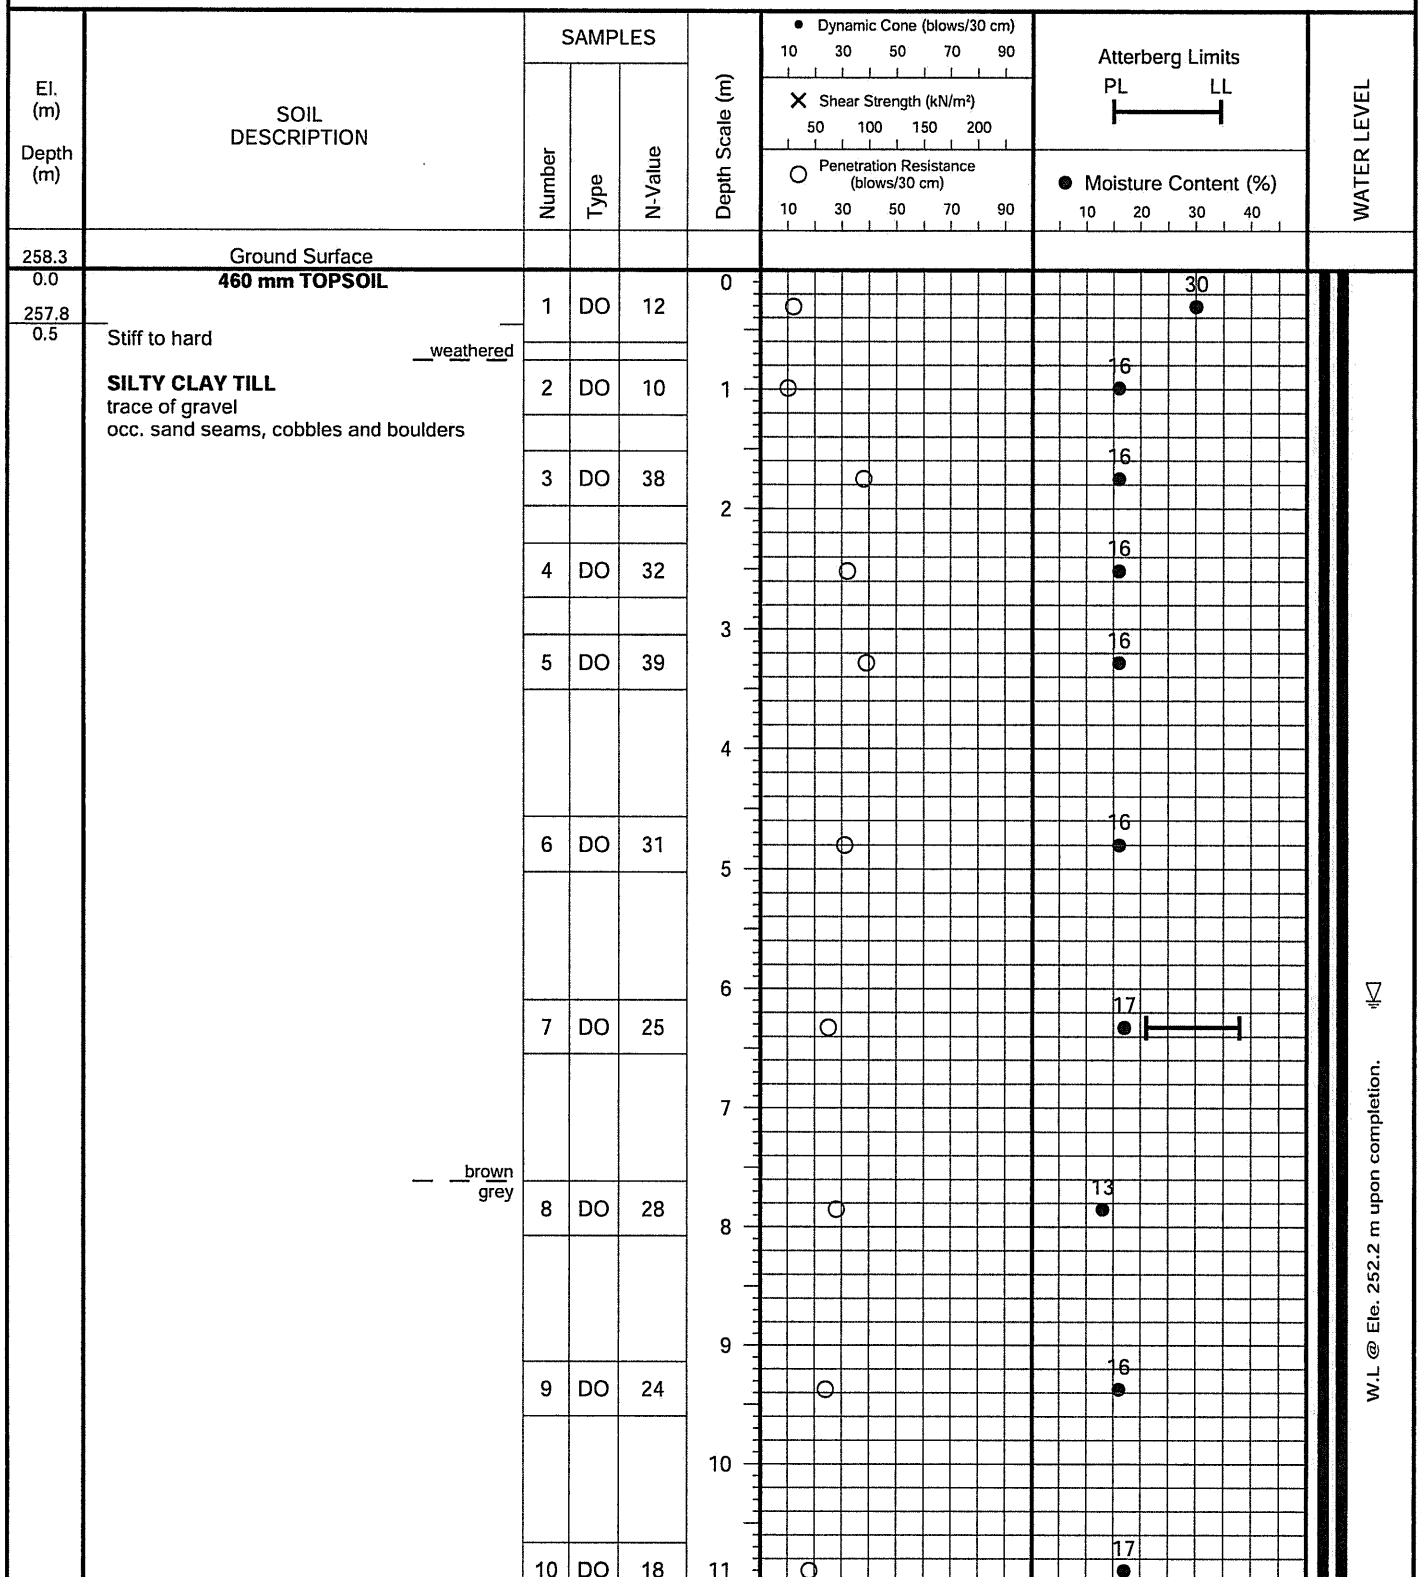PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 24, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 12


FIGURE NO.: 12

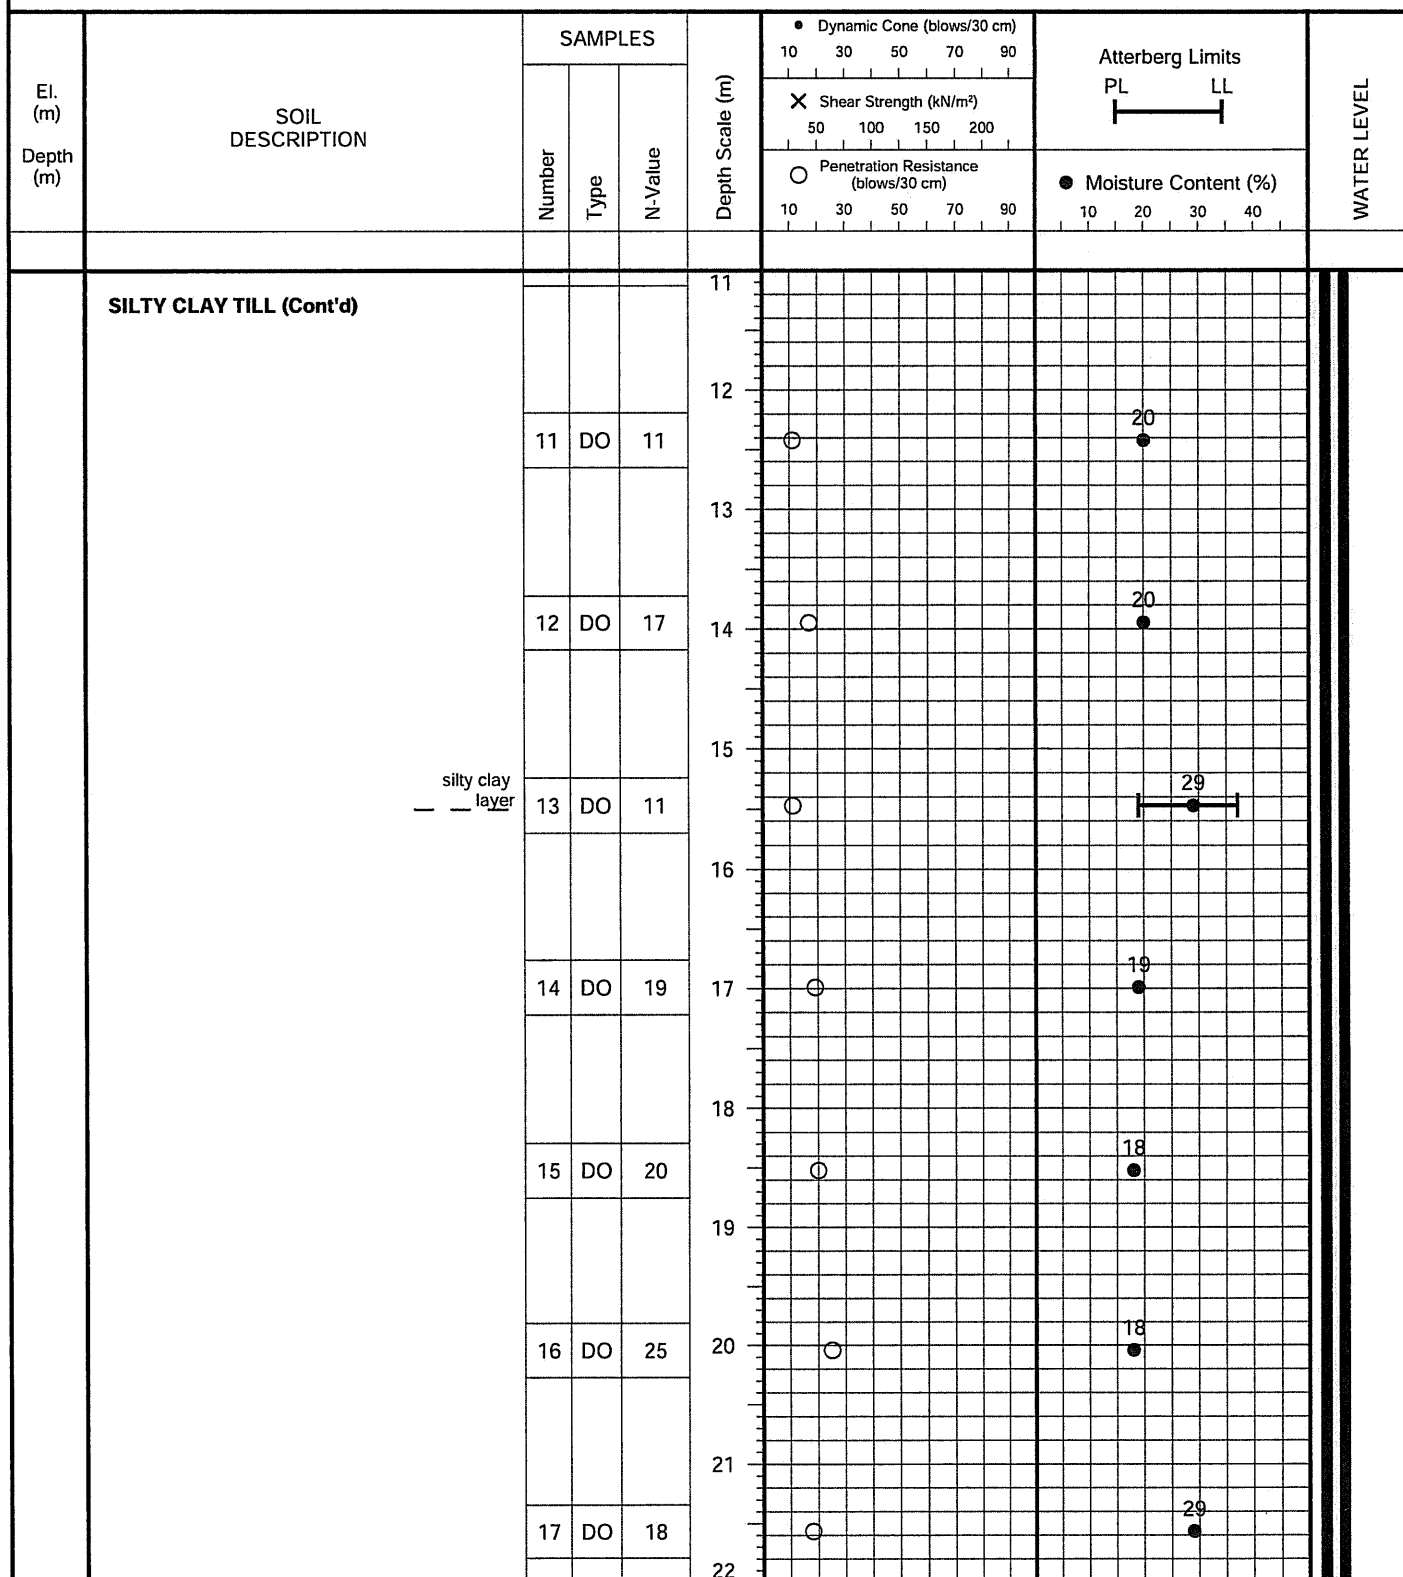PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 24, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 12


FIGURE NO.: 12

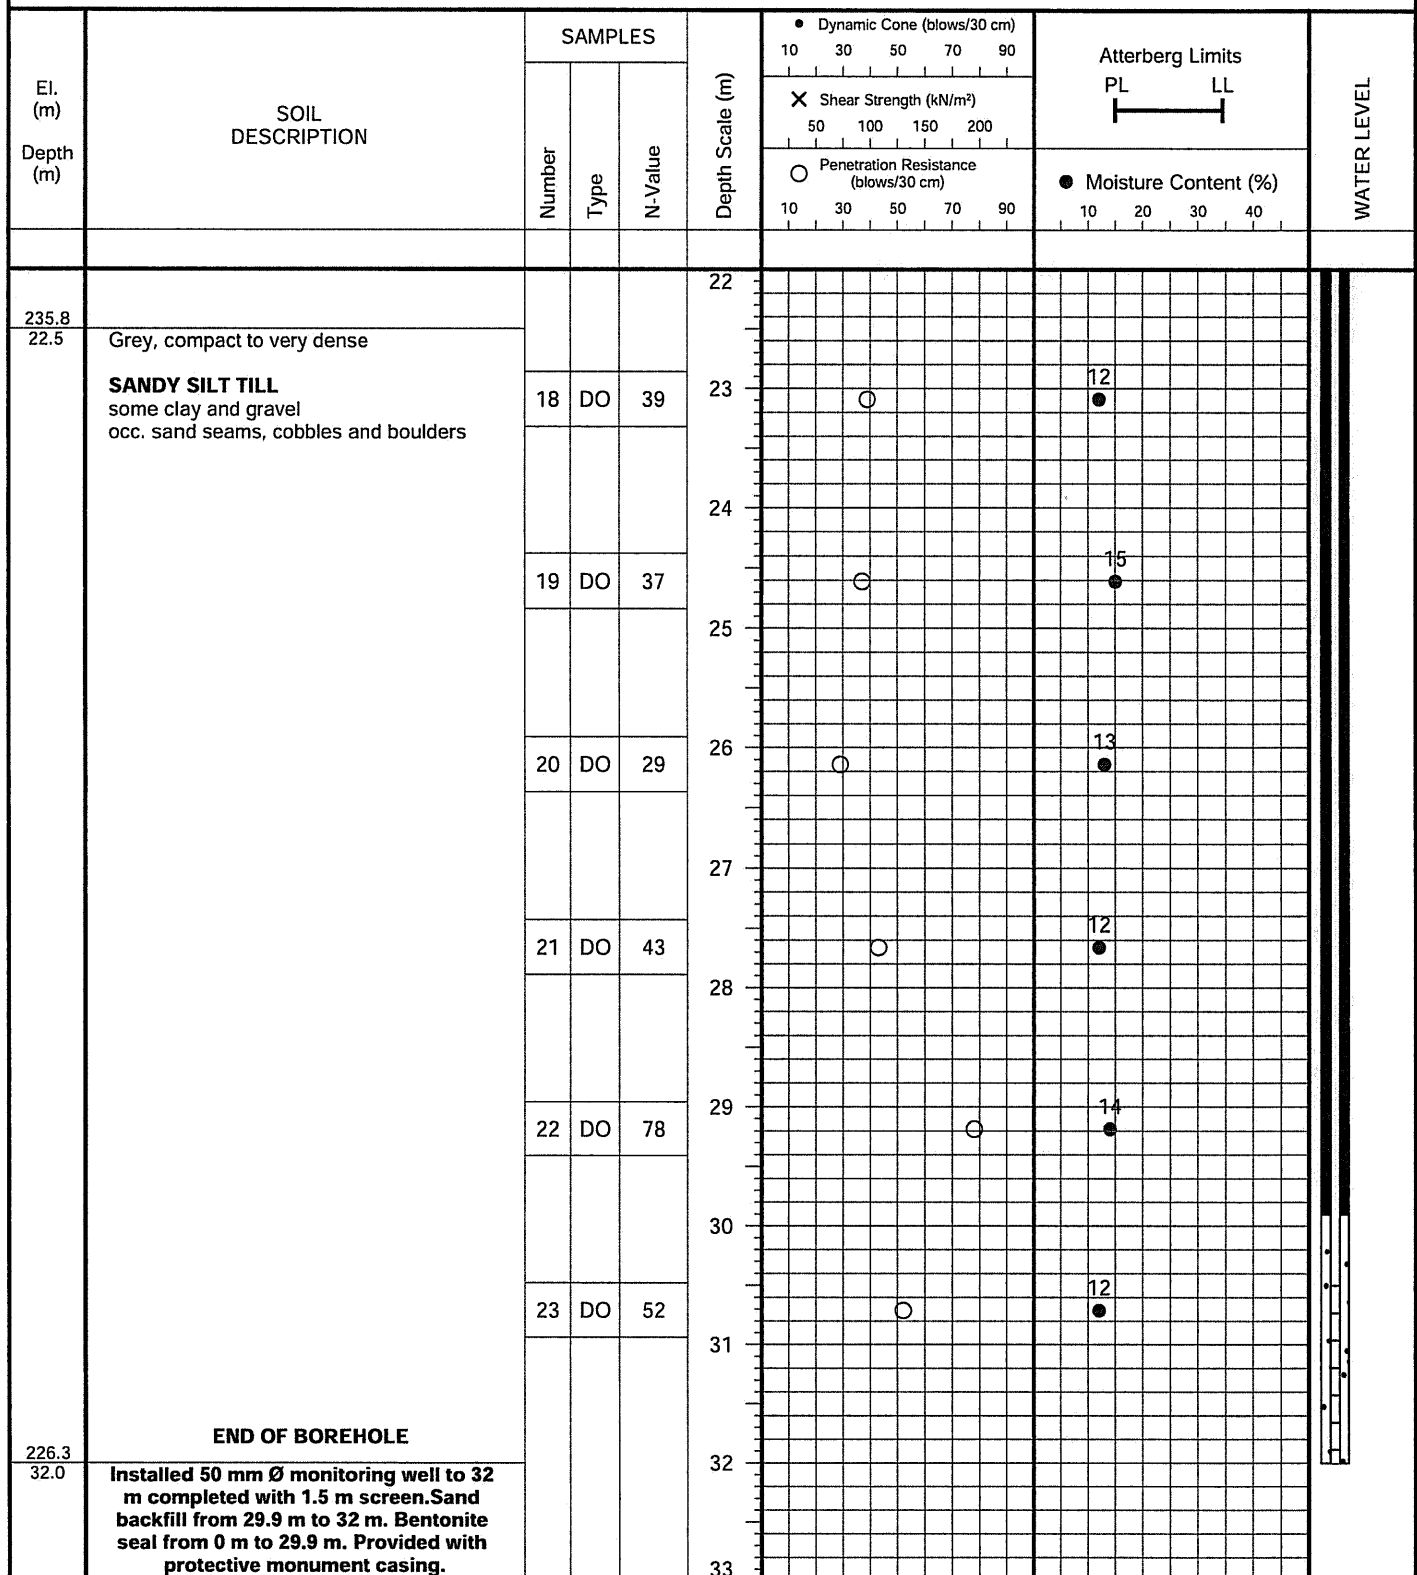PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 24, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 12N

FIGURE NO.: 12

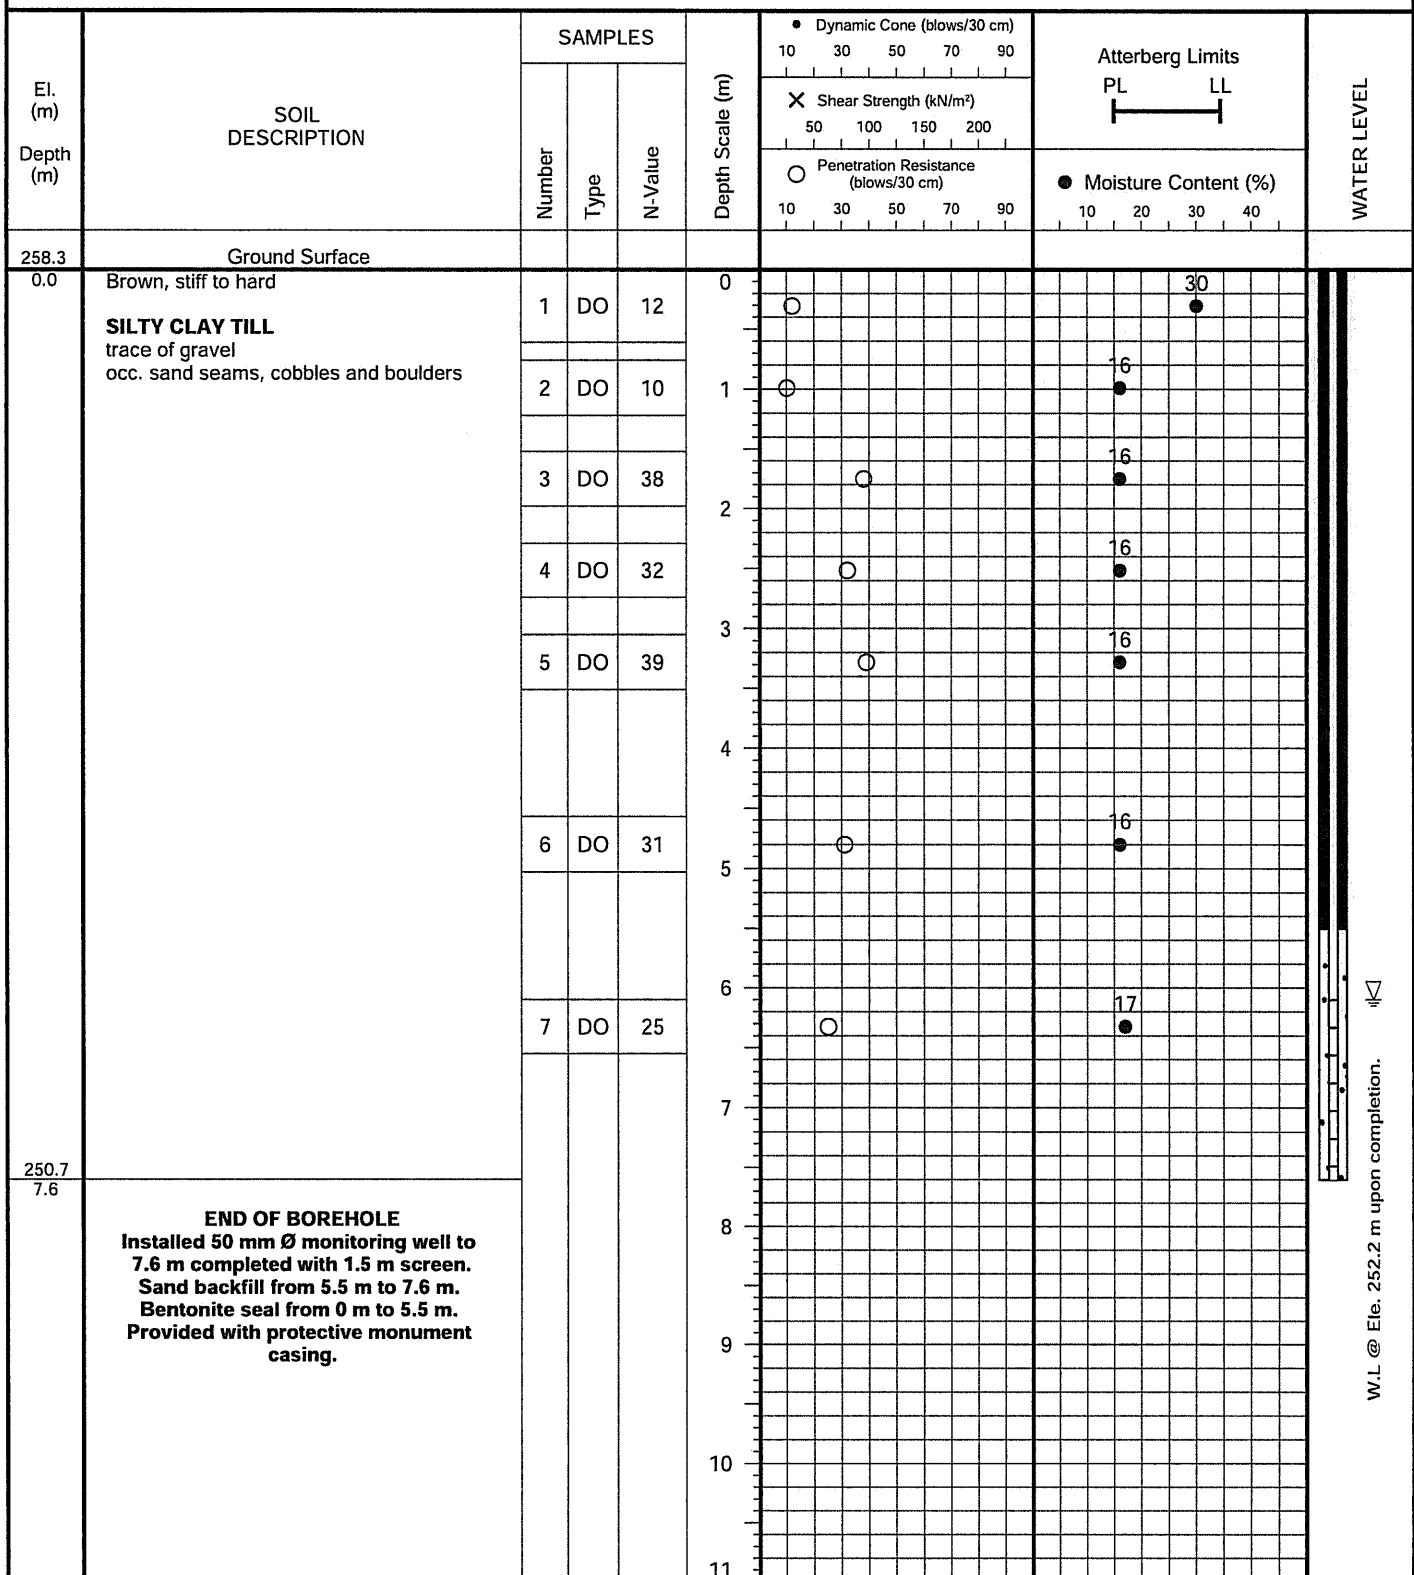PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 24, 2018**Soil Engineers Ltd.**




GRAIN SIZE DISTRIBUTION

Reference No: 1801-S032

U.S. BUREAU OF SOILS CLASSIFICATION

GRAVEL		SAND			SILT	CLAY
COARSE	FINE	COARSE	MEDIUM	V. FINE		
UNIFIED SOIL CLASSIFICATION						
GRAVEL		SAND			SILT & CLAY	
COARSE	FINE	COARSE	MEDIUM	FINE		

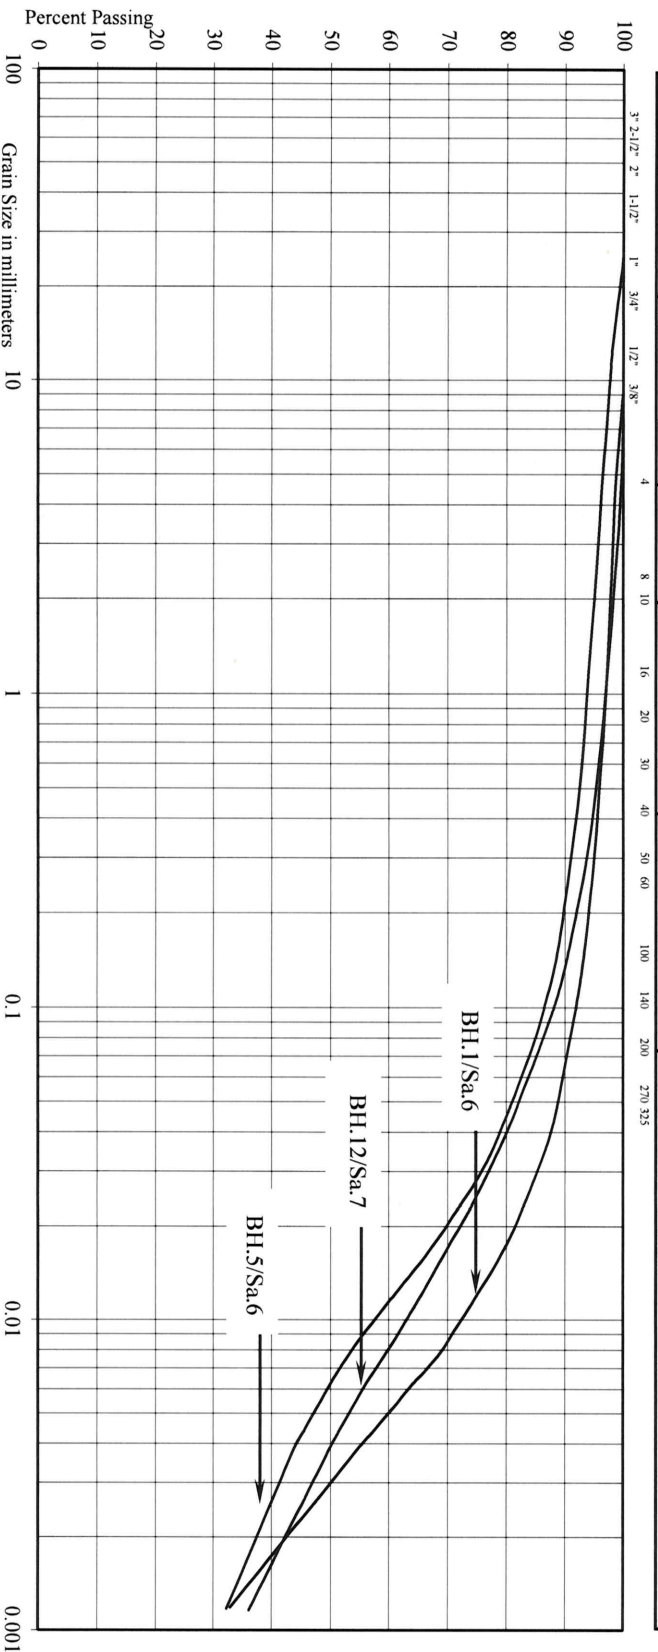

Project: Proposed Residential Development

Location: Chickadee Lane and Glasgow Road, Town of Caledon

Borehole No: 1 5 12

Sample No: 6 6 7

Depth (m):	4.7	4.7	6.3
------------	-----	-----	-----

Elevation (m):	251.8	254.8	252.0
----------------	-------	-------	-------

BH/Sa.	1/6	5/6	12/7
Liquid Limit (%) =	42	36	38
Plastic Limit (%) =	21	20	21
Plasticity Index (%) =	21	16	17
Moisture Content (%) =	18	18	17

$$(\text{cm./sec.}) = 10^{-7} \quad 10^{-7} \quad 10^{-7}$$


Classification of Sample I & Group Symbol: SILTY CLAY TILL, a trace to some sand, a trace of gravel

SILTY CLAY TILL, a trace to some sand, a trace of gravel

Figure: 13



Figure: 14

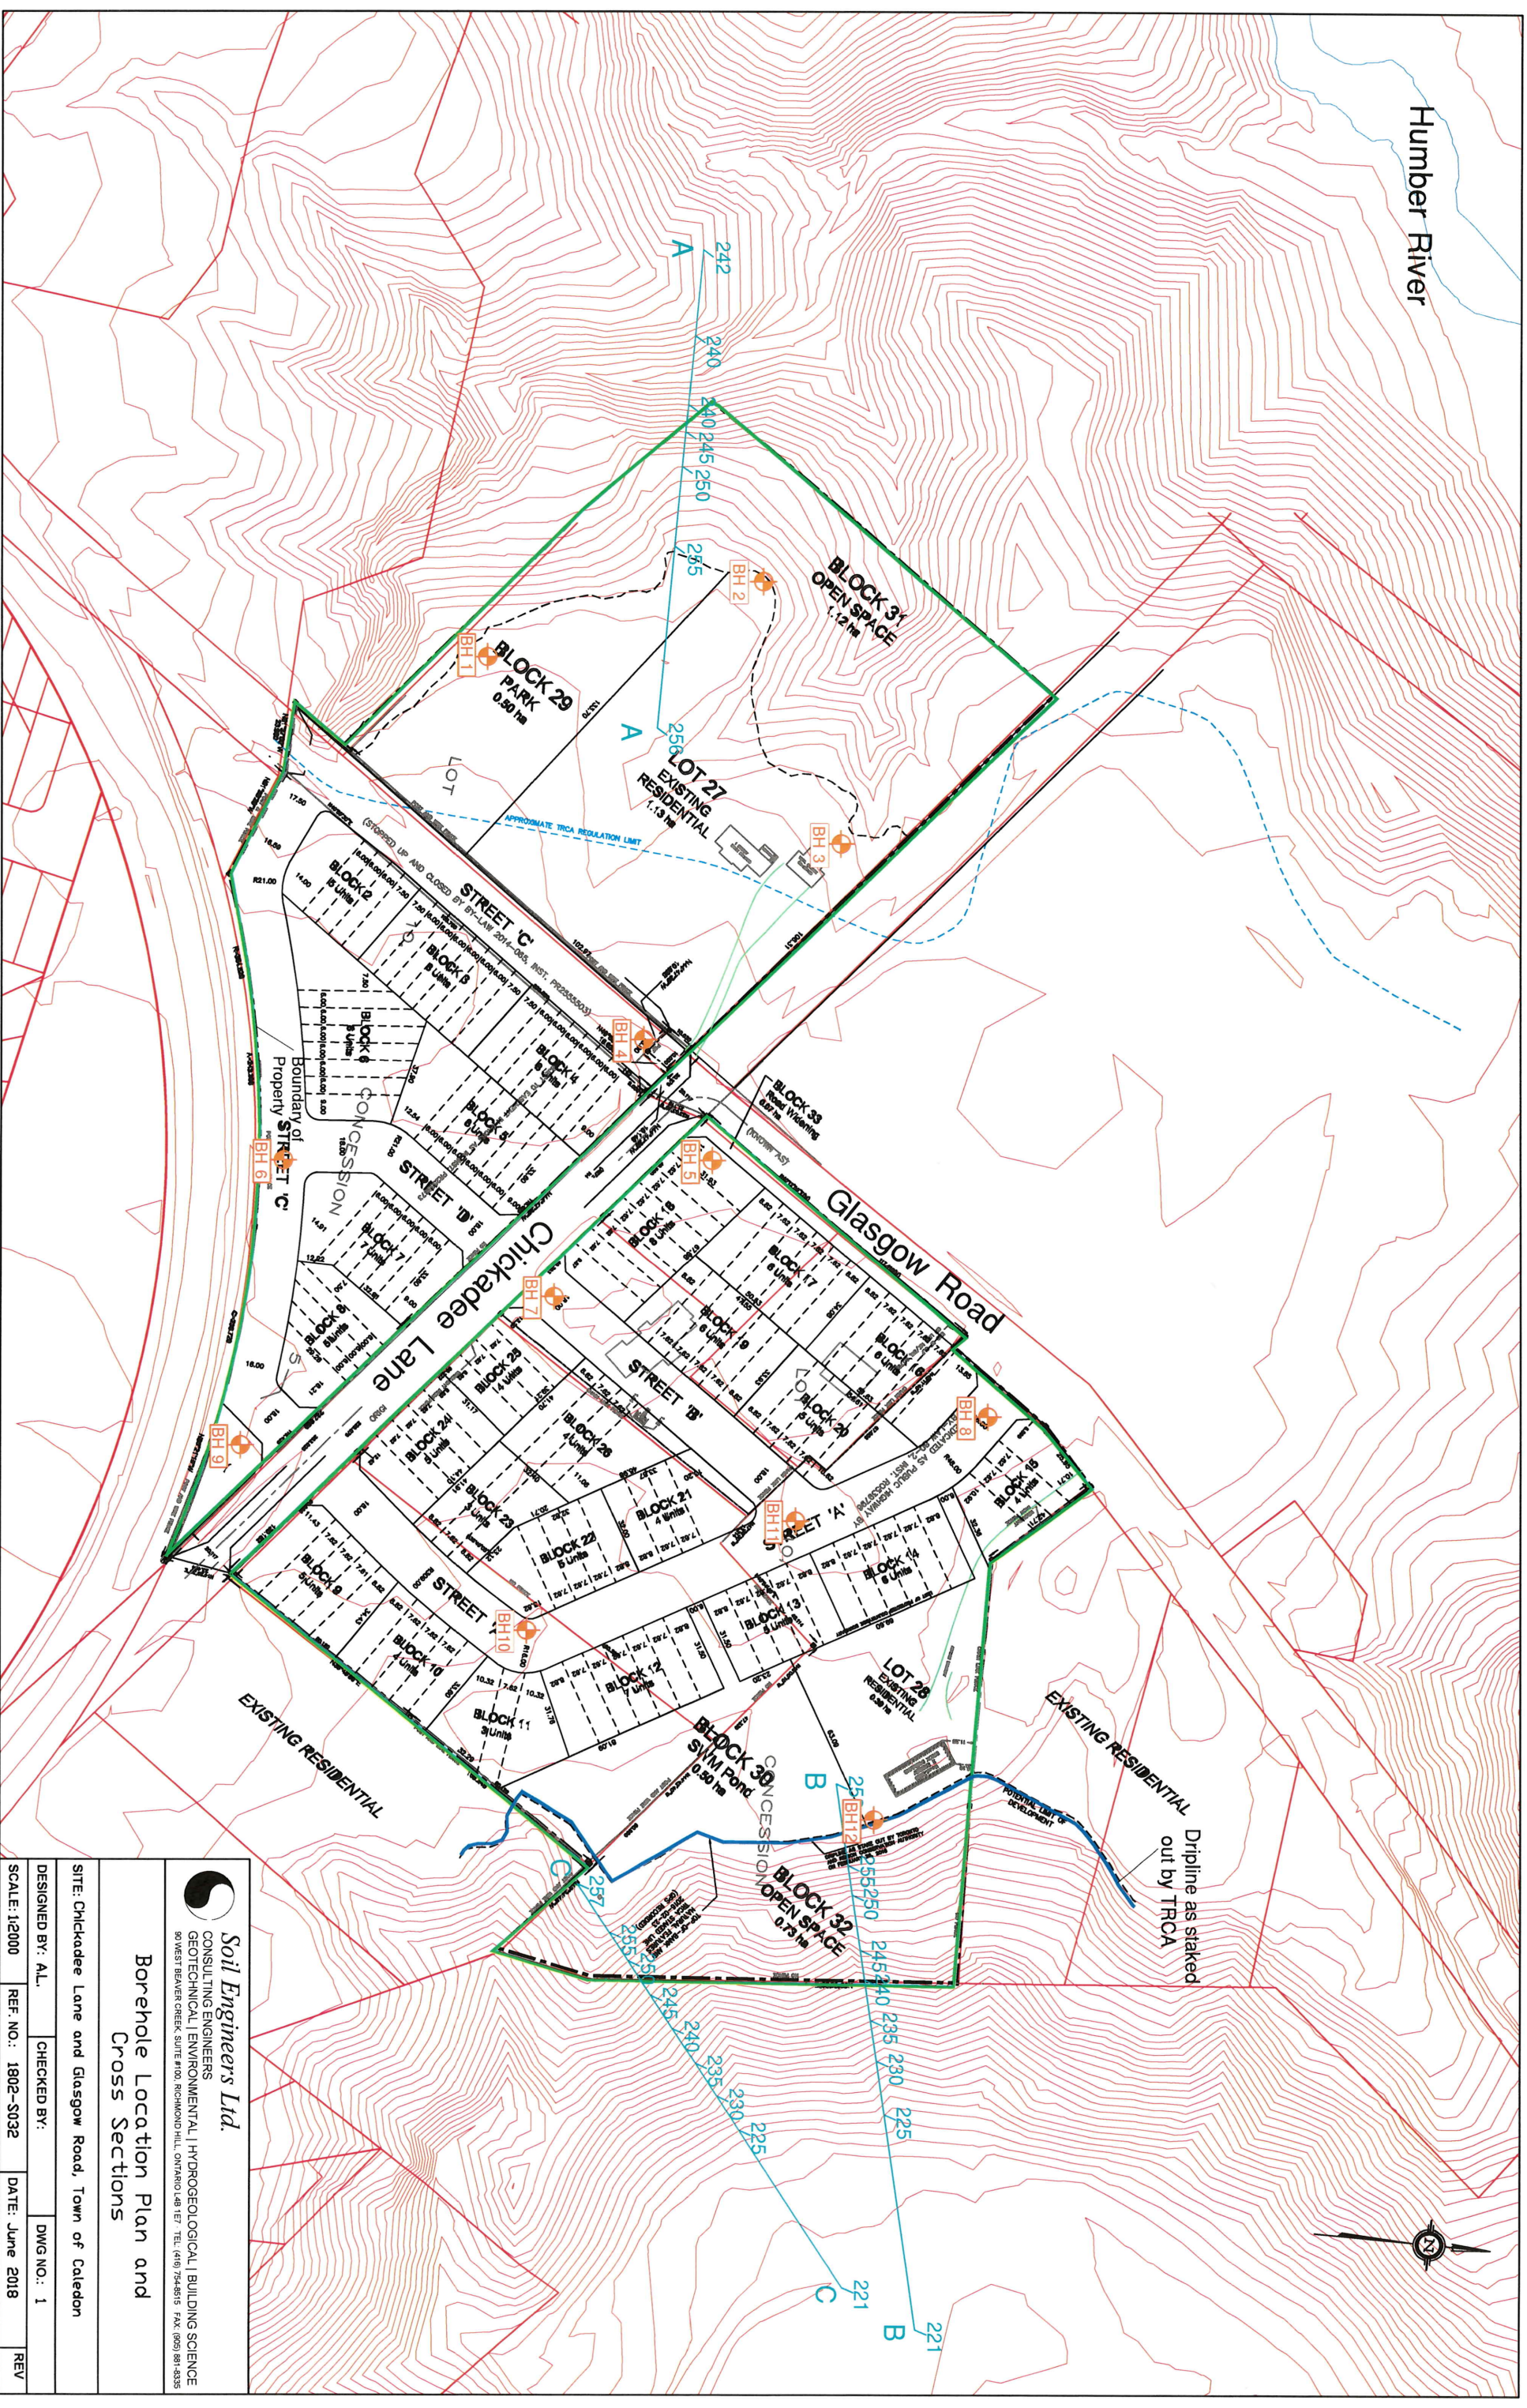



**SUBSURFACE PROFILE
DRAWING NO. 2
SCALE: AS SHOWN**

1801-S032

June 2018

Proposed Residential Development

Chickadee Lane and Glasgow Road, Town of Caledon





Soil Engineers Ltd.
CONSULTING ENGINEERS

GEOTECHNICAL | ENVIRONMENTAL | HYDROGEOLOGICAL | BUILDING SCIENCE

SUBSURFACE PROFILE
DRAWING NO. 3
SCALE: AS SHOWN

JOB NO.:

1801-S032

REPORT DATE:

June 2018

PROJECT DESCRIPTION:

Proposed Residential Development

PROJECT LOCATION:

Chickadee Lane and Glasgow Road, Town of Caledon

LEGEND



TOPSOIL




FILL





SANDY SILT TILL




SILTY CLAY TILL


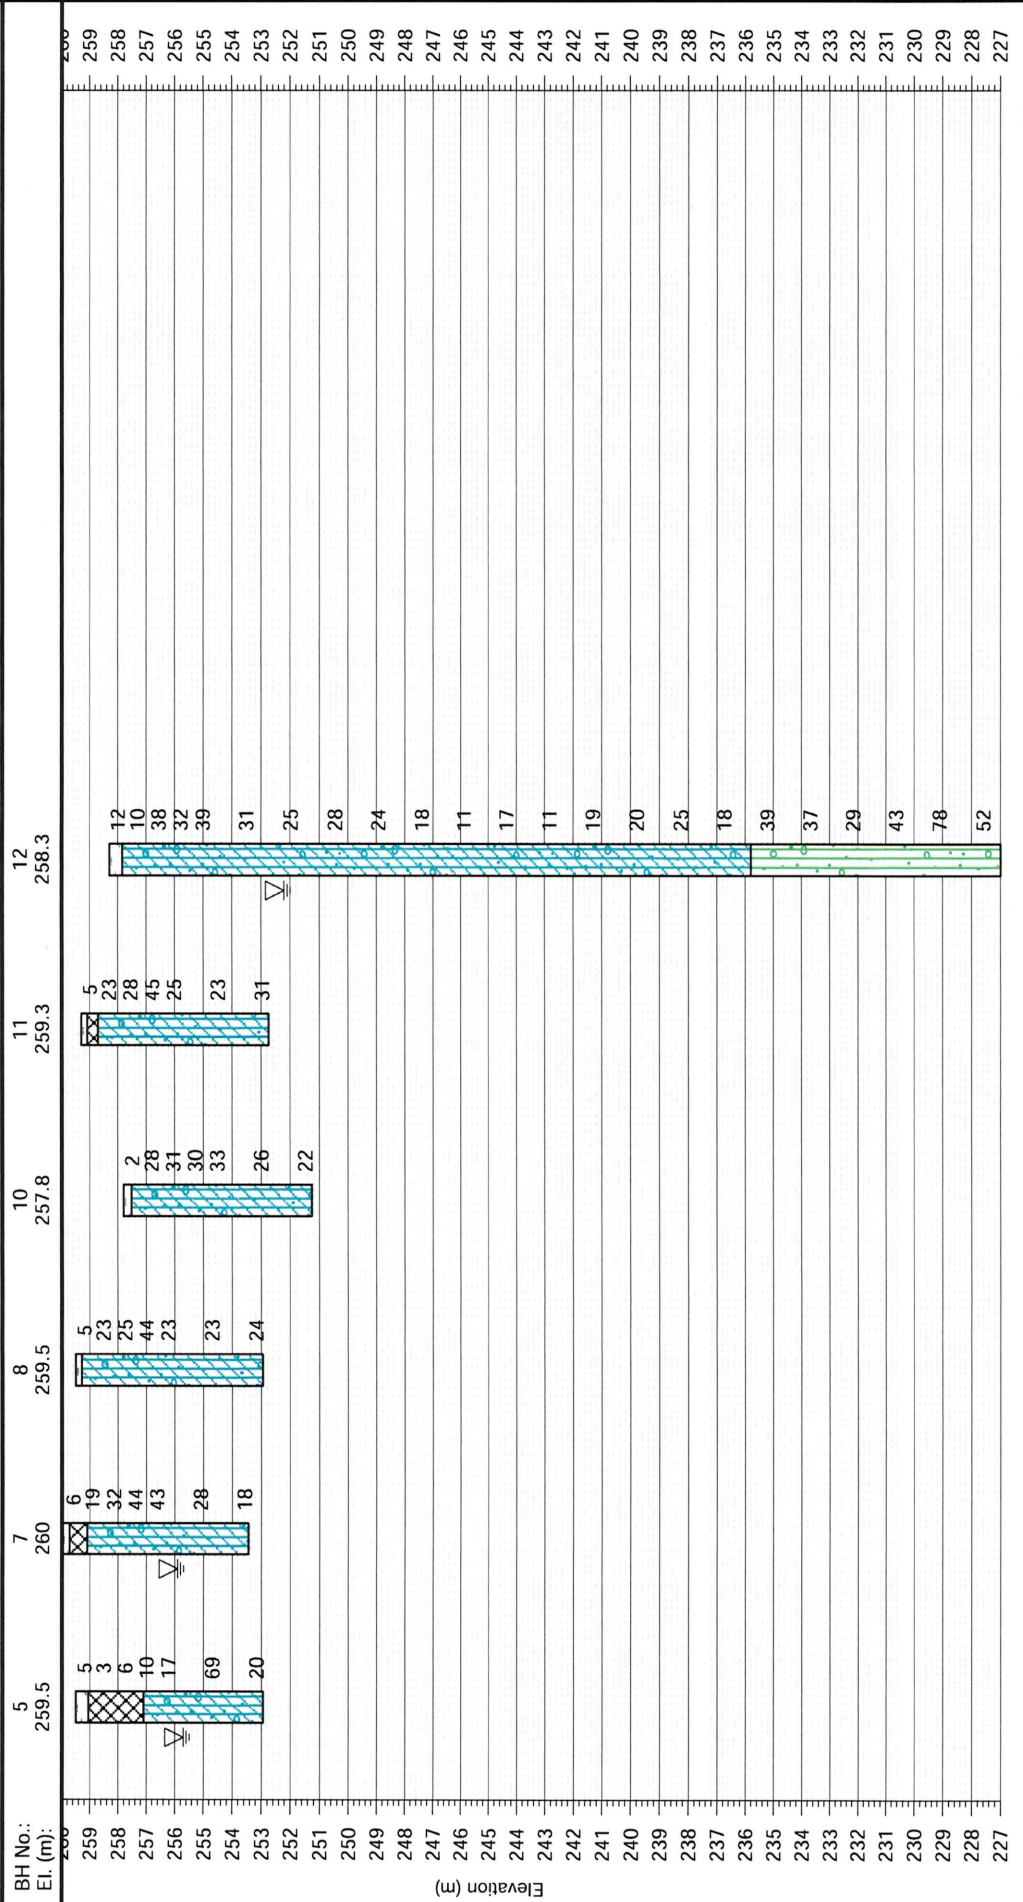


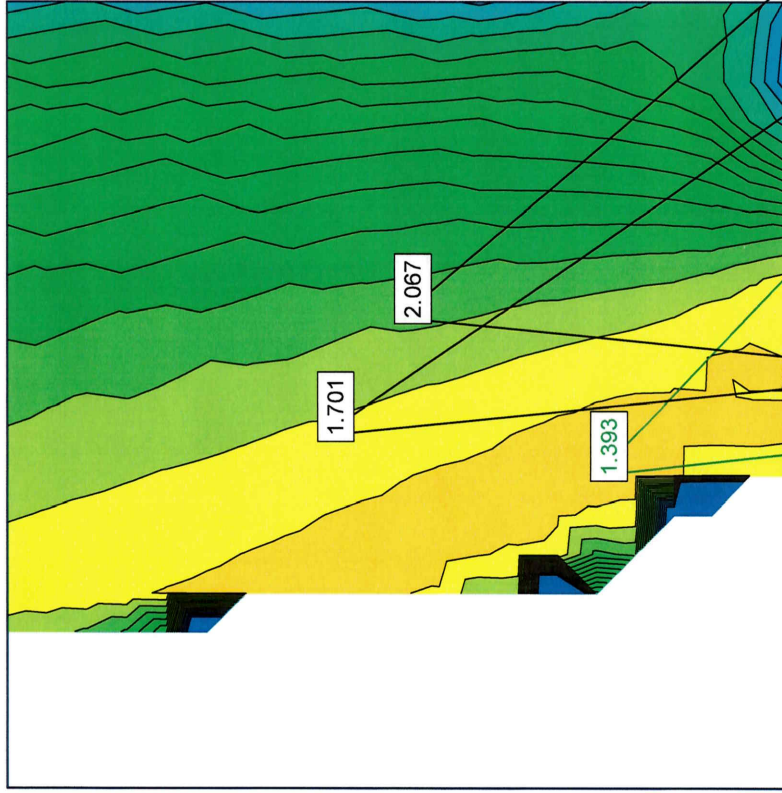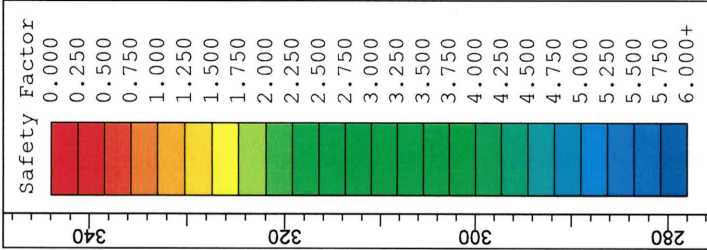


Material Name	Color	Unit Weight (kN/m ³)	Cohesion (kPa)	Phi (deg)
Silty Clay Till, very stiff		22	5	28
Silty Clay Till, stiff		21.5	5	25
Sandy Silt Till, dense		22	5	30

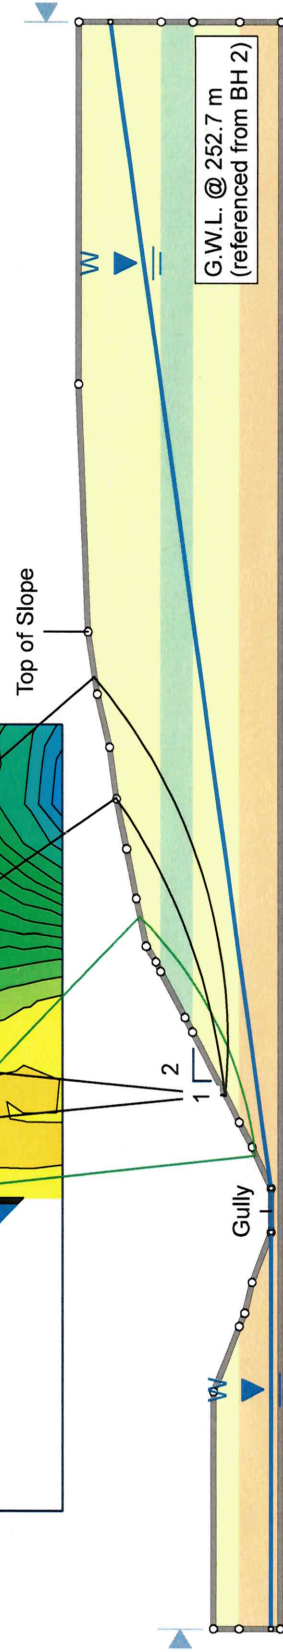

Soil Engineers Ltd. CONSULTING ENGINEERS GEOTECHNICAL / ENVIRONMENTAL HYDROGEOLOGICAL BUILDING SCIENCE 90 WEST BEAVER CREEK ROAD, SUITE #100, RICHMOND HILL, ONTARIO L4B 1E7 TEL (416) 754-8515 FAX (905) 851-9335		Project Title Slope Stability Analysis - Cross Section A-A		Load Case Existing Condition
Location Chickadee Lane and Glasgow Road, Town of Caledon				
Drawn By A.L.	Checked By _____	Scale 1:750	Revision _____	
Date May 2018	Reference No. 1801-S032	Drawing No. 4		

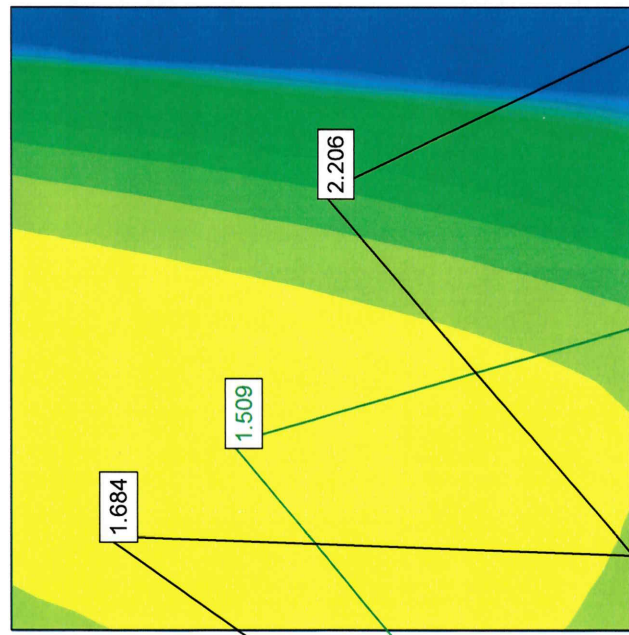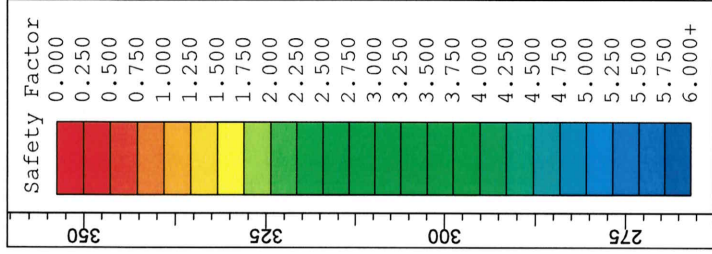


Material Name	Color	Unit Weight (kN/m ³)	Cohesion (kPa)	Phi (deg)
Silty Clay Till, very stiff		22	5	28
Silty Clay Till, stiff		21.5	5	25
Sandy Silt Till, dense		22	5	30

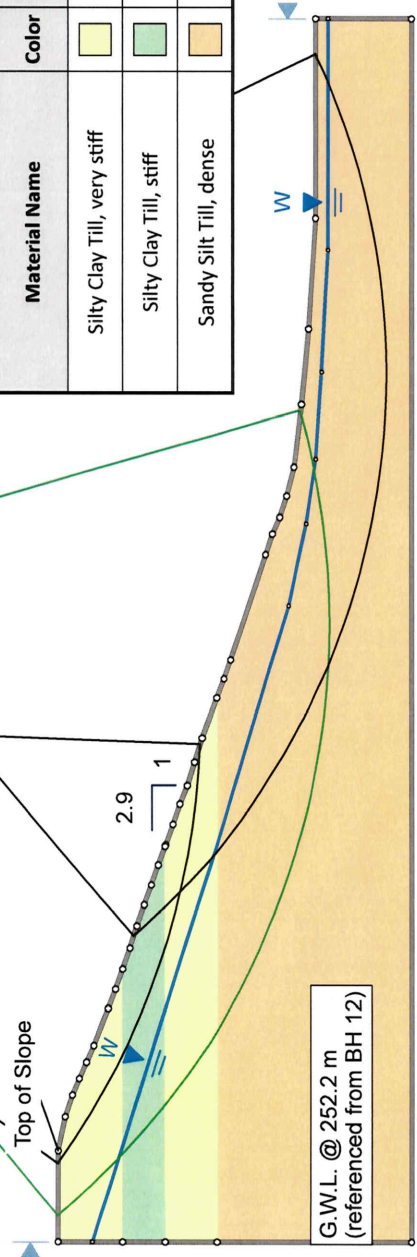

Soil Engineers Ltd. CONSULTING ENGINEERS GEOTECHNICAL ENVIRONMENTAL HYDROGEOLOGICAL BUILDING SCIENCE 90 WEST BEAVER CREEK ROAD, SUITE #100, RICHMOND HILL, ONTARIO L4B 1E7 TEL: (416) 754-8515 FAX: (905) 881-5335		Project Title Slope Stability Analysis - Cross Section C-C	Load Case Existing Condition
Location Chickadee Lane and Glasgow Road, Town of Caledon			
Drawn By A.L.	Checked By A.L.	Scale 1:1000	Revision Revision
Date June 2018	Reference No. 1801-S032	Drawing No. 6	

Humber River

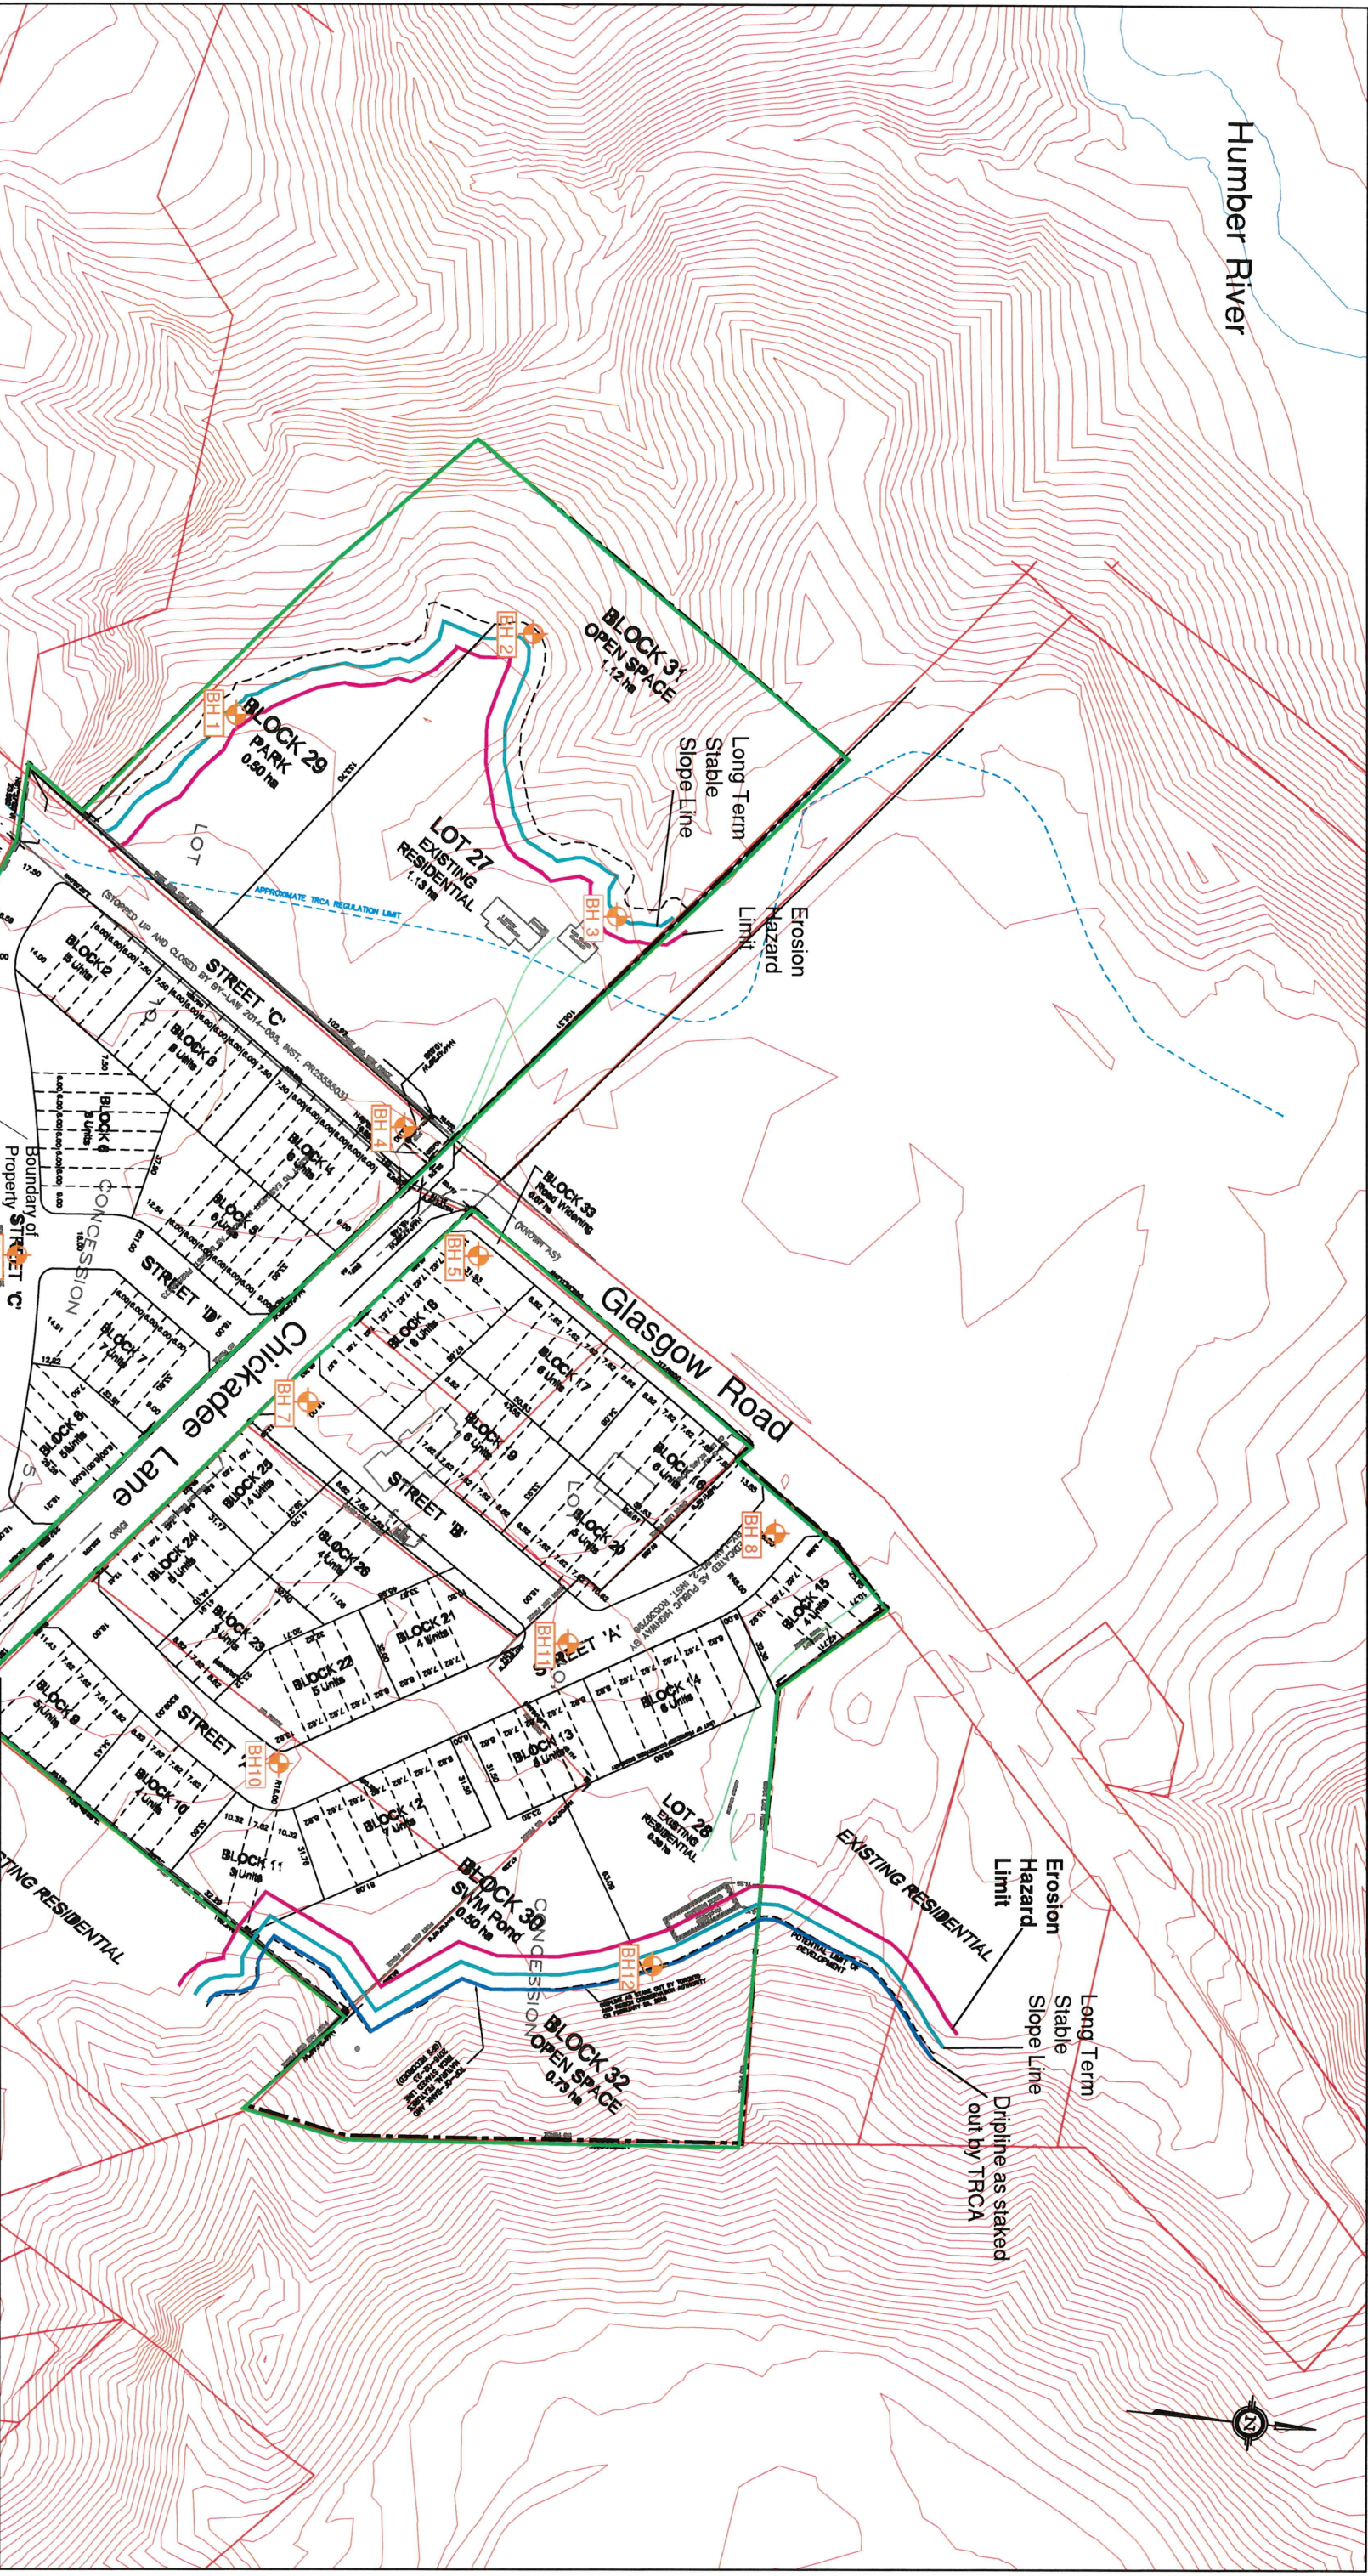

LEGEND

- Erosion Hazard Limit
- Long Term Stable Slope Line
- Dripline Staked by TRCA
- Property Boundary



Soil Engineers Ltd.
CONSULTING ENGINEERS
GEOTECHNICAL | ENVIRONMENTAL | HYDROGEOLOGICAL | BUILDING SCIENCE
90 WEST BEAVER CREEK SUITE #100, RICHMOND HILL, ONTARIO L4B 1E7 | TEL: (416) 754-8515 | FAX: (905) 881-4335

Long Term Stable Slope Line and Erosion Hazard Limit

SITE: Chickadee Lane and Glasgow Road, Town of Caledon

DESIGNED BY: A.L.	CHECKED BY:	DWG NO.: 7	REV
SCALE: 1:2000	REF. NO.: 1802-S032	DATE: June 2018	



Soil Engineers Ltd.

CONSULTING ENGINEERS

GEOTECHNICAL • ENVIRONMENTAL • HYDROGEOLOGICAL • BUILDING SCIENCE

90 WEST BEAVER CREEK ROAD, SUITE #100, RICHMOND HILL, ONTARIO L4B 1E7 • TEL (416) 754-8515 • FAX (905) 881-8335

BARRIE
TEL: (705) 721-7863
FAX: (705) 721-7864

MISSISSAUGA
TEL: (905) 542-7605
FAX: (905) 542-2769

OSHAWA
TEL: (905) 440-2040
FAX: (905) 725-1315

NEWMARKET
TEL: (905) 853-0647
FAX: (905) 881-8335

GRAVENHURST
TEL: (705) 684-4242
FAX: (705) 684-8522

PETERBOROUGH
TEL: (905) 440-2040
FAX: (905) 725-1315

HAMILTON
TEL: (905) 777-7956
FAX: (905) 542-2769

August 31, 2020

Reference No. 1801-S032

Page 1 of 4

Zancor Homes (Bolton) Ltd.
221 North Rivermede Road
Concord, Ontario
L4K 3N7

Attention: Mr. Frank Filippo

**Re: A Supplementary Slope Stability Assessment for
Proposed Residential Development
Chickadee Lane and Glasgow Road
Town of Caledon**

Dear Sir:

As requested, Soil Engineers Ltd. has carried out a supplementary slope stability assessment in Blocks 27, 29, 30 and 31 of the captioned site to further delineate the Long-Term Stable Slope Line (LTSSL). We herein provide a summary of our findings and analytical results of the concerned slope.

Background

The subject site is located at the intersection of Chickadee Lane and Glasgow Road, in the Town of Caledon. The concerned slope is located at the west limit of the subject site in Blocks 27, 29, 30 and 31. The height of the slope varies from 10 to 30 m, having a gradient of 1.6 to 5+ horizontal (H): 1 vertical (V). Humber River is more than 15 m away from the bottom of slope.

Subsurface Investigation

A geotechnical investigation report, Reference No. 1801-S032, dated July 2018 was completed for the subject site. Three (3) sampled boreholes (Boreholes 1 to 3, inclusive) were located in the vicinity of the concerned slope. The boreholes indicated that topsoil, 160 mm to 260 mm in thickness, was encountered at the surface of the area. Beneath the topsoil veneer, the subsoil generally consisted of firm to hard silty clay till deposit extending to a depth of 16.4 m from the prevailing ground surface, overlying compact to dense sandy silt till deposit to the maximum investigated depth of the borehole at 19.8 m from the ground surface.



Groundwater level was recorded at El. 252.7 m in Borehole 2 upon completion of the drilling program. Boreholes 1 and 3 remained dry on completion. The recorded groundwater represents a perched water condition within the till mantle and will fluctuate with seasons.

Visual Inspection

Visual inspection was performed on March 20, 2018 during the original study. The inspection revealed that the sloping ground is generally covered with mature trees or vegetation, with isolated bare spots covered with fallen leaves and wood branches. Most of the trees appeared in the upright position. There were no signs of water seepage or surface erosion along the slope surface, except multiple gullies and surface erosion were present to the north and west of the property. Toe erosion scars were also evident along Humber River.

Modeling

In addition to the Cross-Section A-A that was analyzed during the original study with the geotechnical investigation, two (2) additional sections (Cross Sections D-D and E-E) are performed to further delineate the LTSSL. The surface profiles of the slope sections are interpreted from the elevation contours shown on the topographic plan obtained from First Base Solutions. The subsurface soil information was derived from the borehole findings. The locations of the cross-sections are shown on Drawing No. 1. The details of the slope at the Cross-Sections A-A, D-D and E-E are presented on Drawing Nos. 2, 3 and 4, respectively.

The analyses were carried out with computer-aided program, SLIDE created by Rocscience Inc., using force-moment-equilibrium criteria with the soil strength parameters shown in the following table:

Soil Type	Unit Weight (kN/m ³)	Effective Cohesion (kPa)	Effective Internal Friction Angle (degrees)
Very stiff to hard Silty Clay Till	22.0	5	28
Stiff Silty Clay Till	21.5	5	25
Sandy Silt Till	22.0	5	30

Where applicable, the highest water level detected in the boreholes and the creek level were incorporated into the analysis as a phreatic surface.

Results

The results of the analyses are summarized in the following table and are presented on Drawing Nos. 2, 3 and 4.



Cross Section	Height (m)	Existing Slope Gradient	Factor of Safety (FOS)	Remodeled Slope Gradient	Resulting FOS
A-A	19.0	1.9 to 5.4H:1V	1.39	2.5H:1V	1.61
D-D	8.5	1.6H:1	1.31	2H:1V	1.51
E-E	7.0	3.1 to 4.7H:1V	2.40	-	-

The resulting FOS at the Cross-Section E-E meet the Ontario Ministry of Natural Resources and Forestry (OMNRF) guideline requirement for 'Active' land use (FOS of 1.5), while the FOS for Cross-Sections A-A and D-D is below the OMNRF guideline requirement. A stable slope allowance will be required for Cross-Sections A-A and D-D.

Even though there were active erosion observed at the bank of the Humber River, however, given that the river is more than 15 m away from the bottom of slope, a Toe Erosion Allowance (T.E.A.) is not required.

After incorporating the stable slope gradient of 2.5 to 2.0H:1V at Cross- Sections A-A and D-D, the resulting FOS for the remodeled slope meets the OMNRF guideline of FOS 1.5. The results are presented on Drawing No. 5 and 6.

Based on the analytical results, the LTSSL, incorporating the stable slope gradient, is established and is illustrated in Drawing No. 1.

A development setback buffer for man-made and environmental degradation based on the TRCA policy will be required. This is subject to the discretion of TRCA.

Where grading of the site requires the area to be raised, the proposed slope should maintain a gradient of 1V:3H or flatter for stability. Any slope steeper than 1V:3H will require further stability analysis and it may need to be constructed as a reinforced earth slope.

In order to prevent disturbance of the existing stable slope and to enhance the stability of the bank for the proposed project, the following geotechnical constraints should be stipulated:

1. The prevailing vegetative cover must be maintained, since its extraction would deprive the bank of the rooting system that is reinforcement against soil erosion by weathering. If for any reason the vegetation cover is stripped, it must be reinstated to its original, or better than its original, protective condition.
2. The leafy topsoil cover on the bank face should not be disturbed, since this provides an insulation and screen against frost wedging and rainwash erosion.



3. Grading of the land adjacent to the bank must be such that concentrated runoff is not allowed to drain onto the bank face. Landscaping features which may cause runoff to pond at the top of the bank, as well as saturation of the crown of the bank must not be permitted.
4. Where the construction is carried out near the top of the bank, dumping of loose fill over the bank from topsoil stripping or vegetation removal activities must be prohibited. Topsoil stripping and vegetation removal along the bank are also prohibited.

In case of any removal of vegetation during the course of construction, restoration with selective native plantings, including deep rooting systems which would penetrate the original topsoil, shall be carried out after the development to ensure slope stability. Provided that all the above recommendations are followed, the proposed development at the tableland should not have any adverse effect on the stability of the slope.

The above recommendations should be reviewed and are subject to the approval of TRCA.

We trust the above satisfies your present requirements. Should you have any further queries, please feel free to contact this office.

Yours truly,

SOIL ENGINEERS LTD.

Kin Fung Li, P.Eng.
KFL/BL



Bernard Lee, P.Eng.



ENCLOSURES


Borehole Logs	Figures 1 to 3
Cross Section Location Plan.....	Drawing No. 1
Slope Stability Analyses (Existing Condition).....	Drawing Nos. 2 to 4
Slope Stability Analysis (Geotechnically Stable Condition)	Drawing Nos. 5 and 6

This letter/report/certification was prepared by Soil Engineers Ltd. for the account of the captioned clients and may be relied upon by regulatory agencies. The material in it reflects the writer's best judgment in light of the information available to it at the time of preparation. Any use which a third party makes of this letter/report/certification, or any reliance on or decisions to be made based upon it, are the responsibility of such third parties. Soil Engineers Ltd. accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions based on this letter/report/certification.

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 1


FIGURE NO.: 1

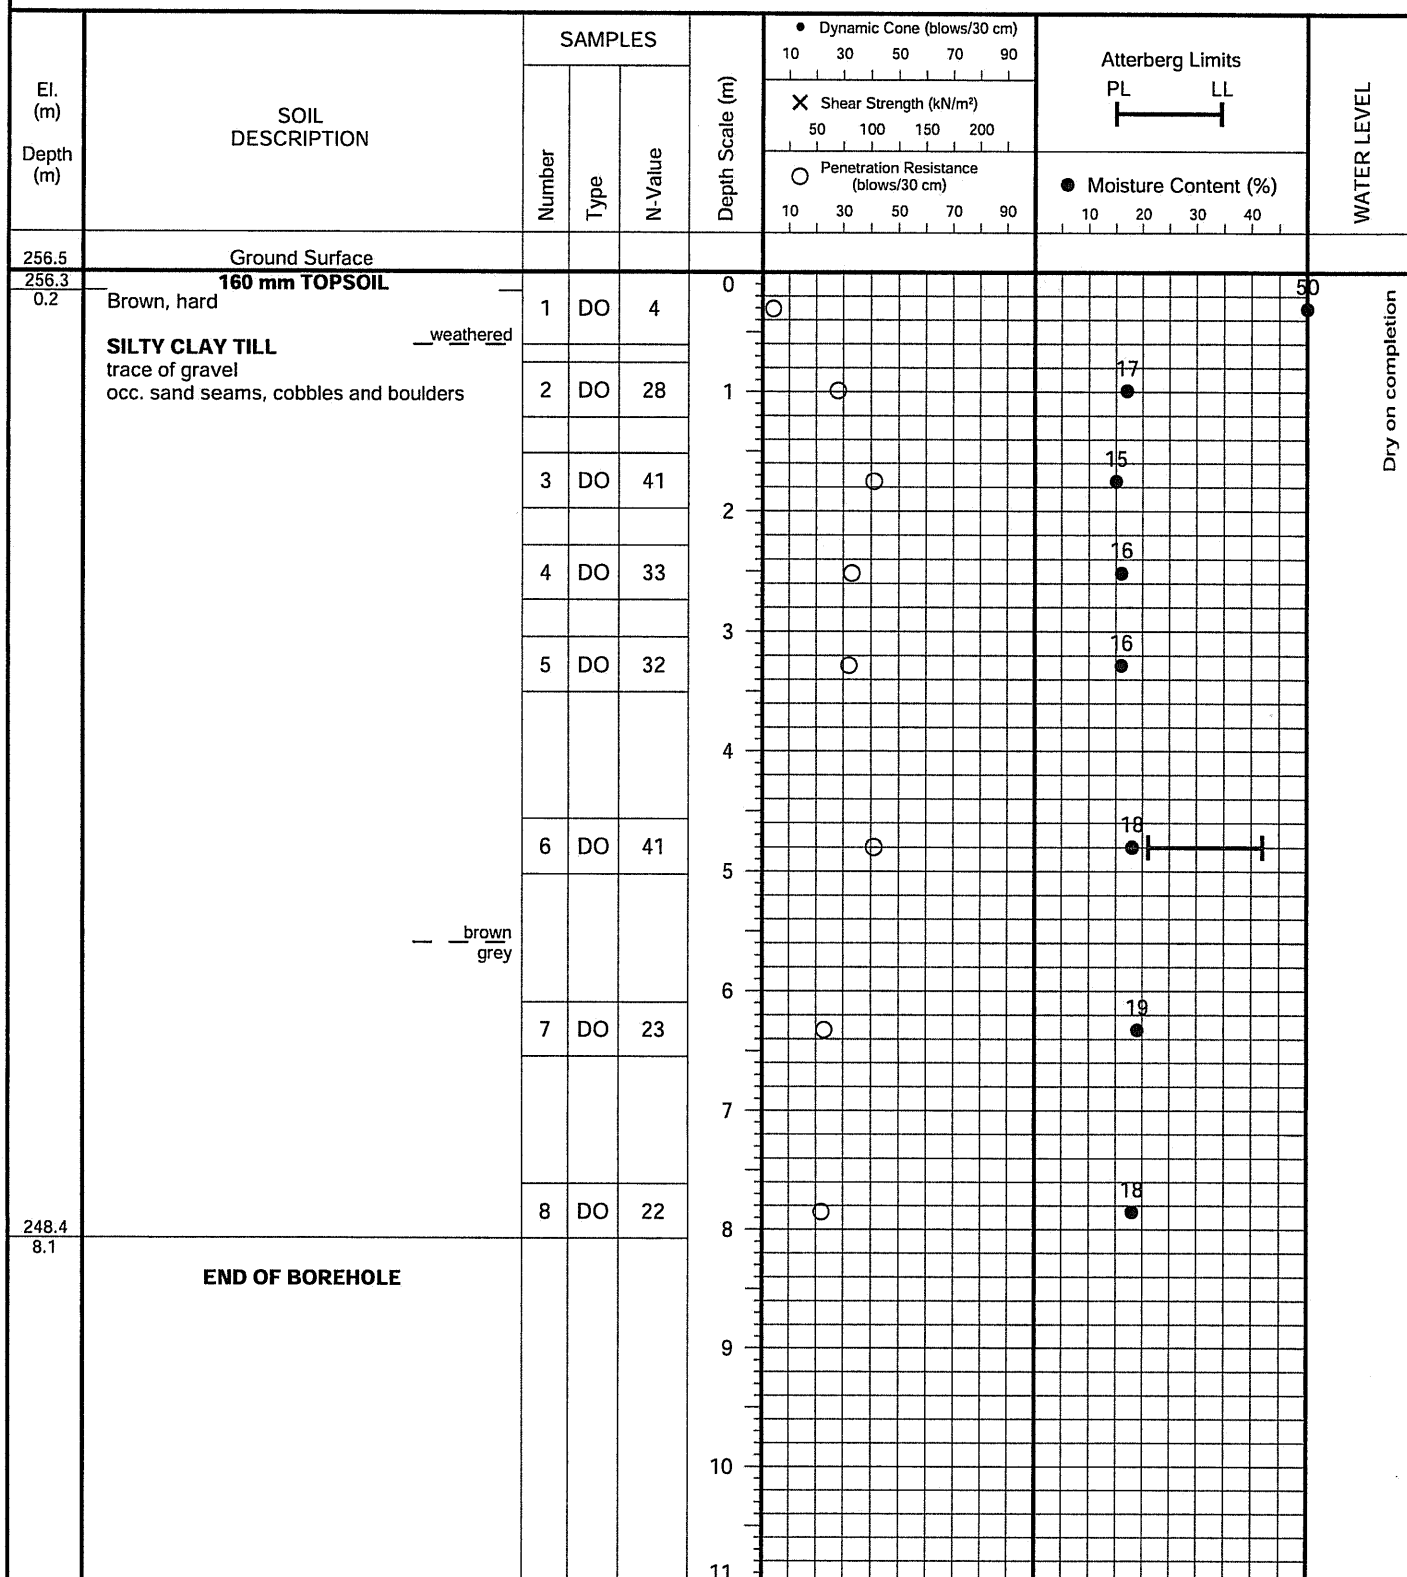PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 2


FIGURE NO.: 2

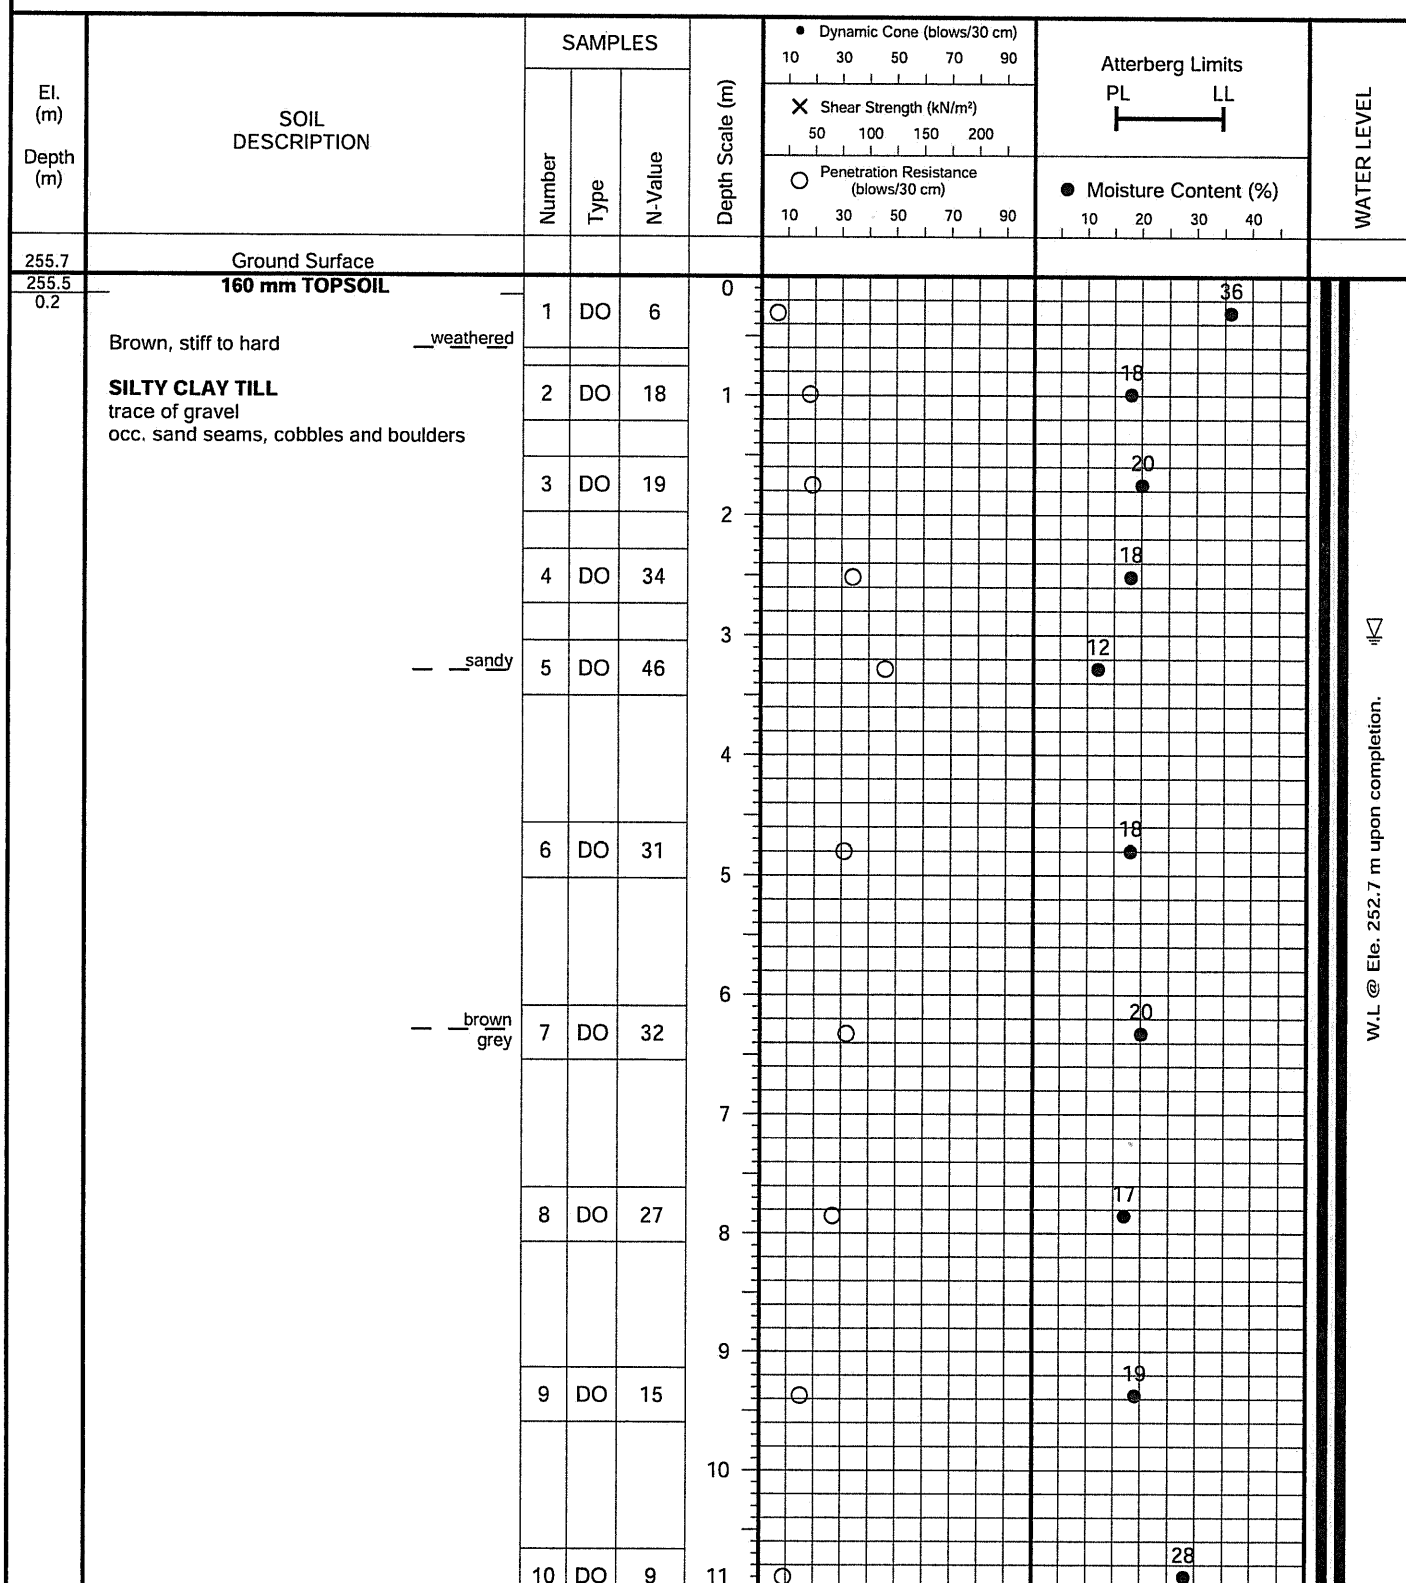PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 2


FIGURE NO.: 2

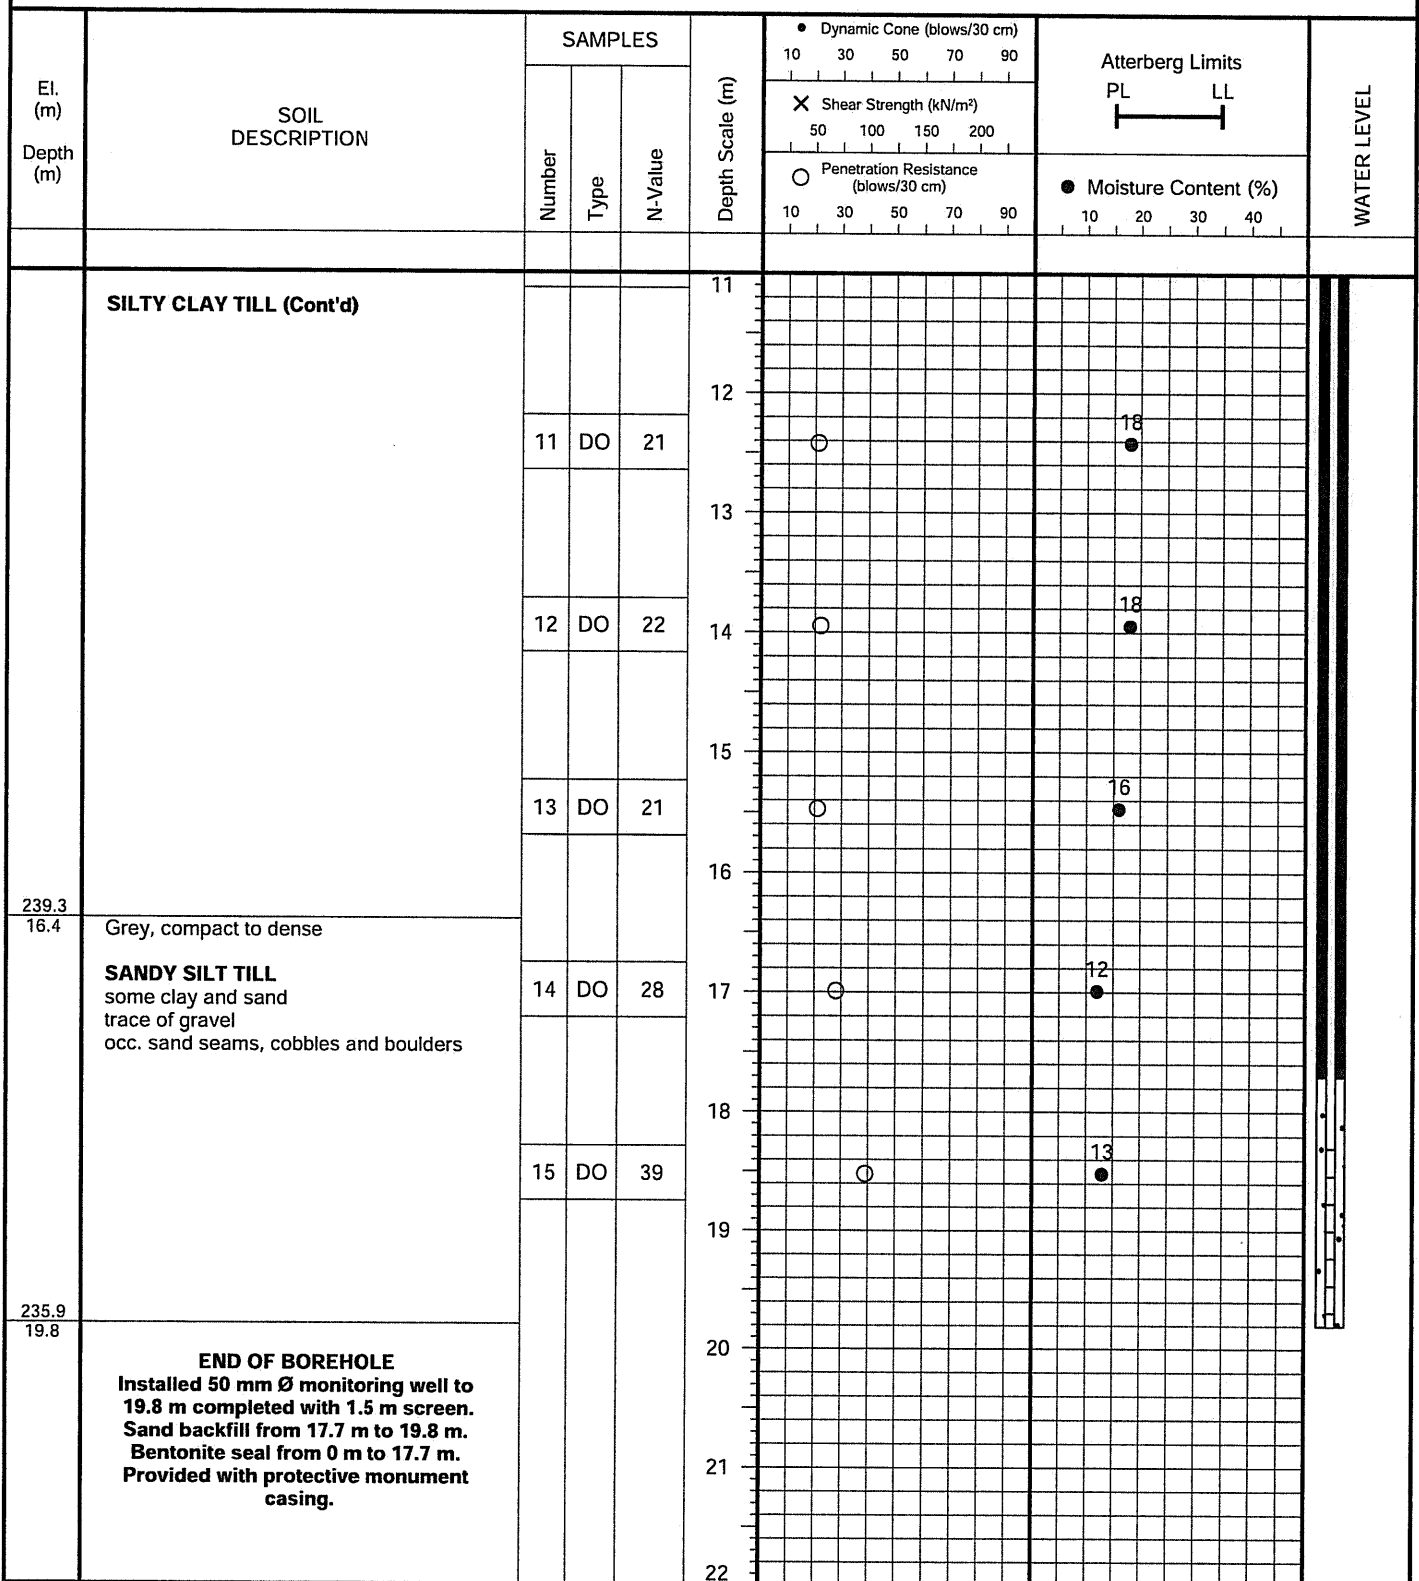
PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**


JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 3

FIGURE NO.: 3

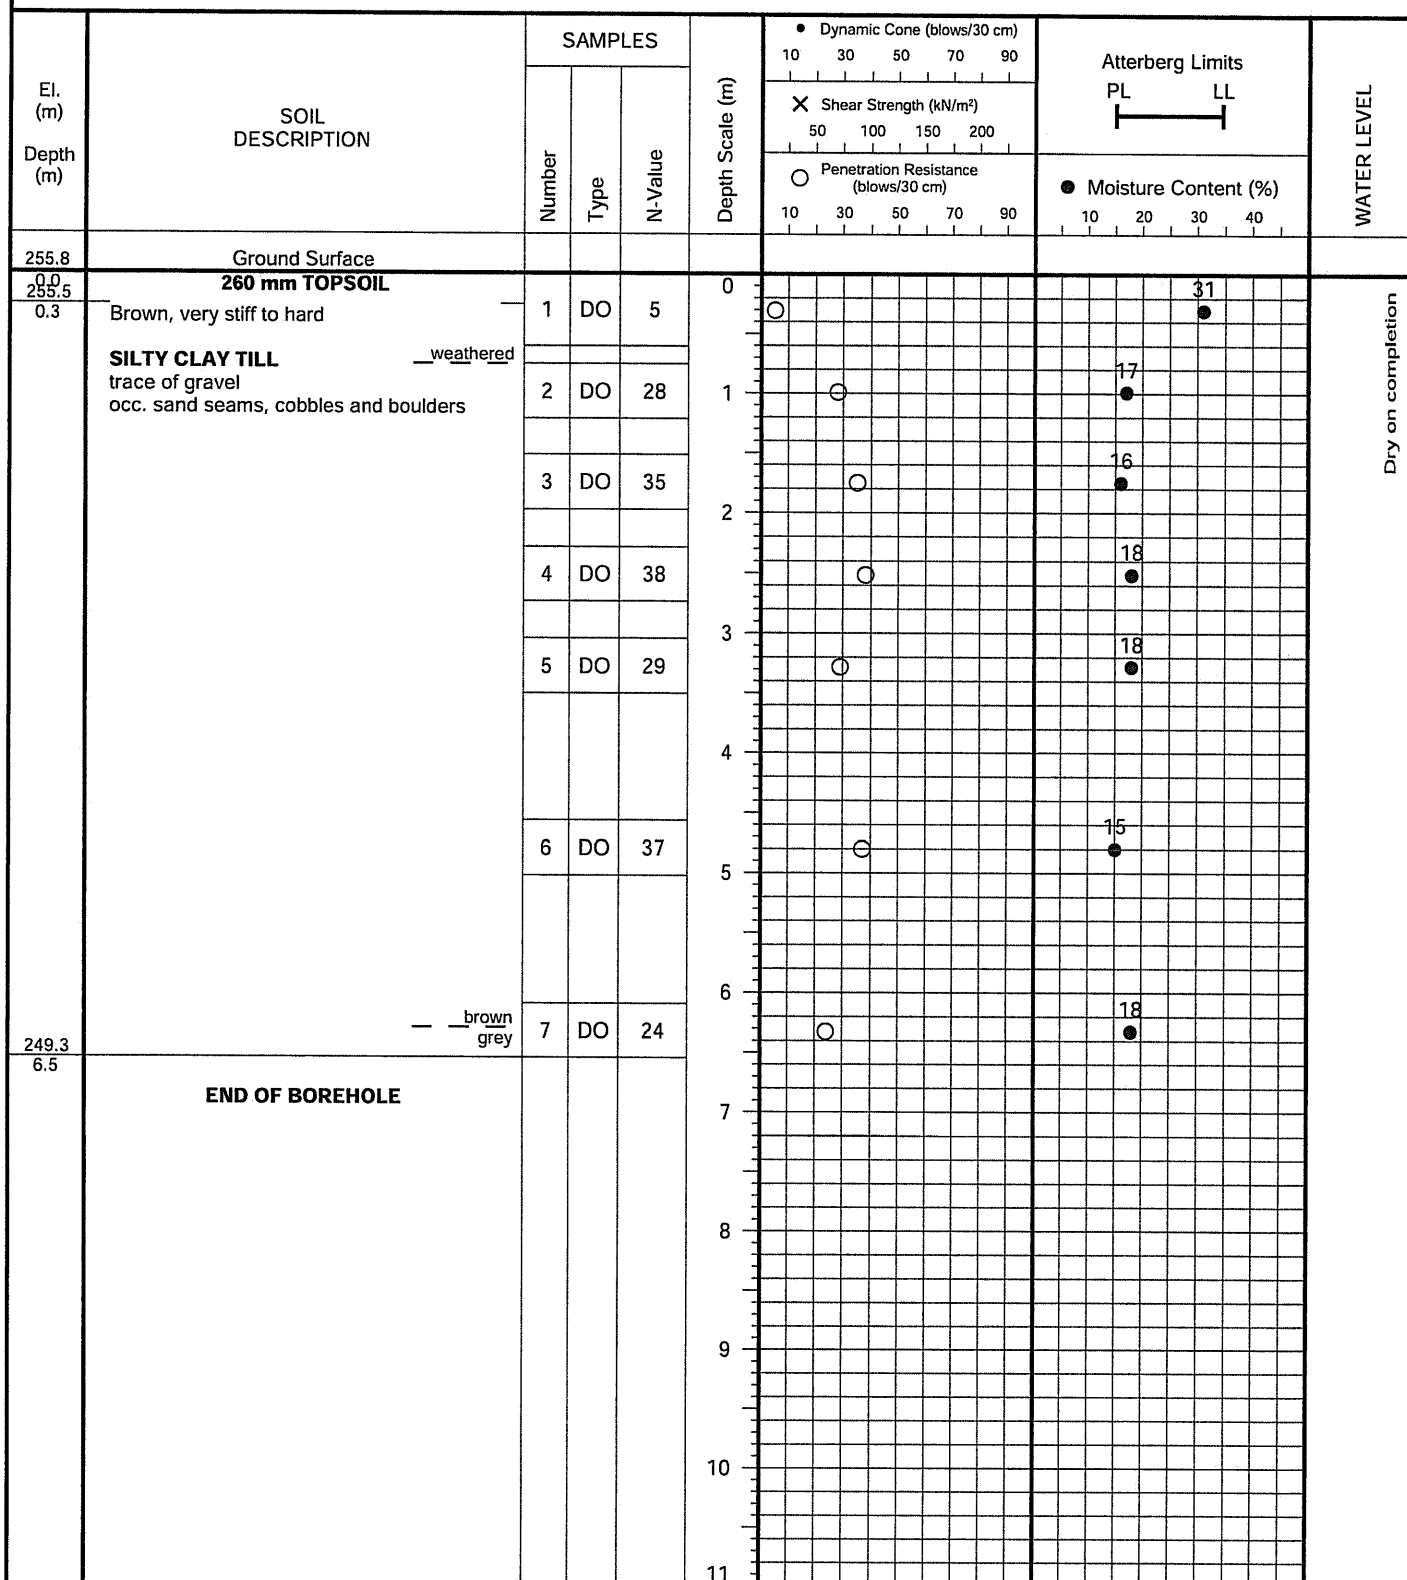PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**

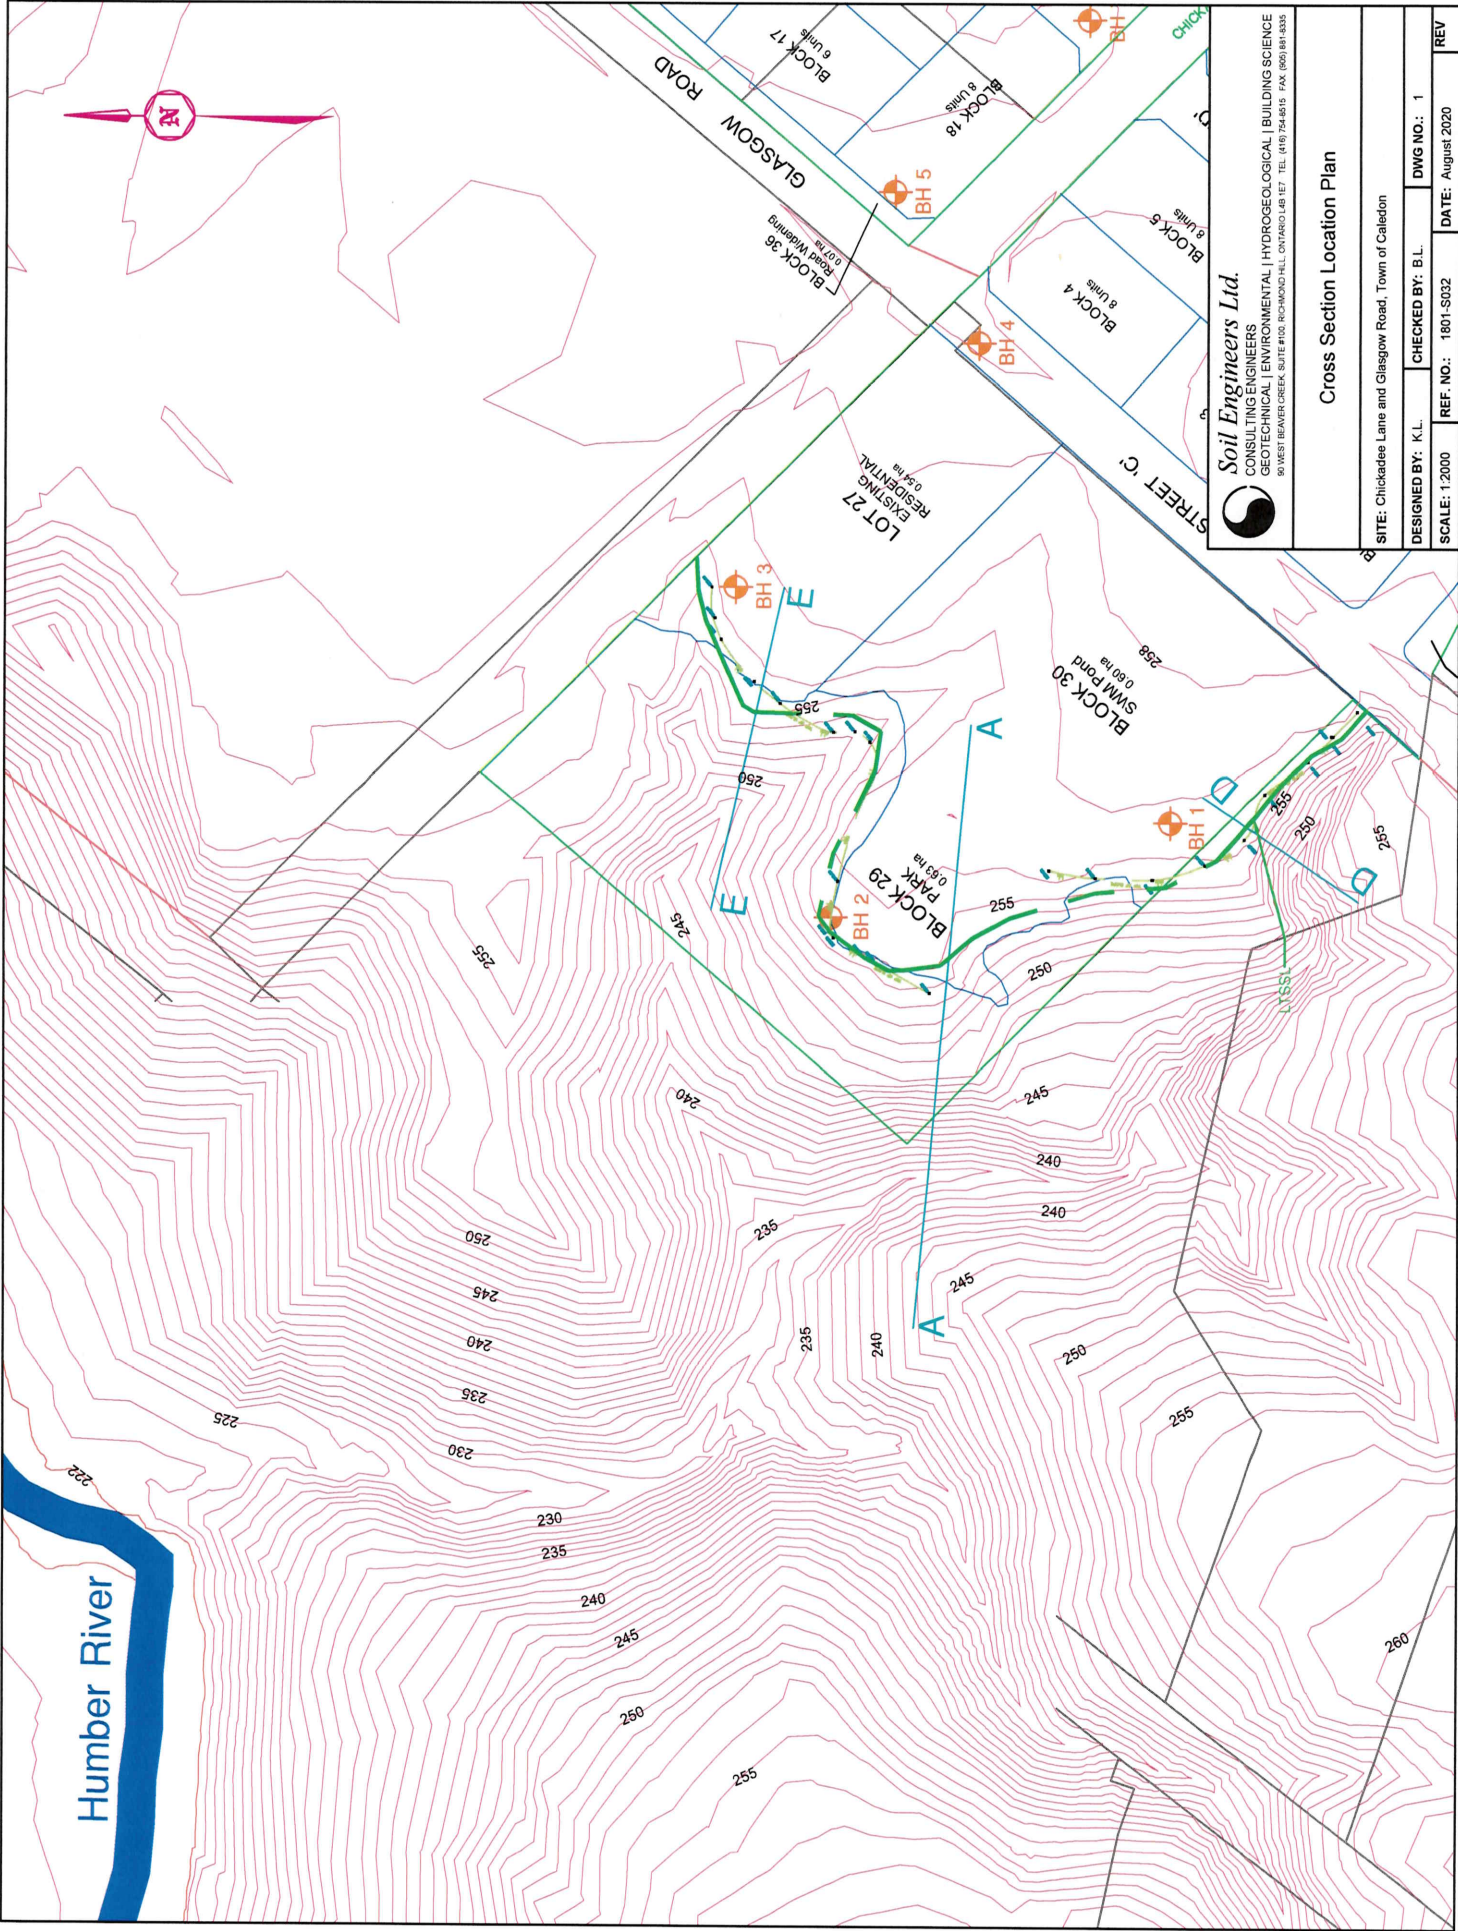





Soil Engineers Ltd.
CONSULTING ENGINEERS
GEOTECHNICAL | ENVIRONMENTAL | HYDROGEOLOGICAL | BUILDING SCIENCE
91 WEST BEAVER CREEK, SUITE 200, EDMONTON, ALBERTA T6E 6K7
TEL: (403) 744-8400 FAX: (403) 744-8401

Cross Section Location Plan

SITE: Chickadee Lane and Glasgow Road, Town of Caledon


DESIGNED BY: K.L.	CHECKED BY: B.L.	DWG NO.: 1
SCALE: 1:2000	REF. NO.: 1801-S032	DATE: August 2020
		REV


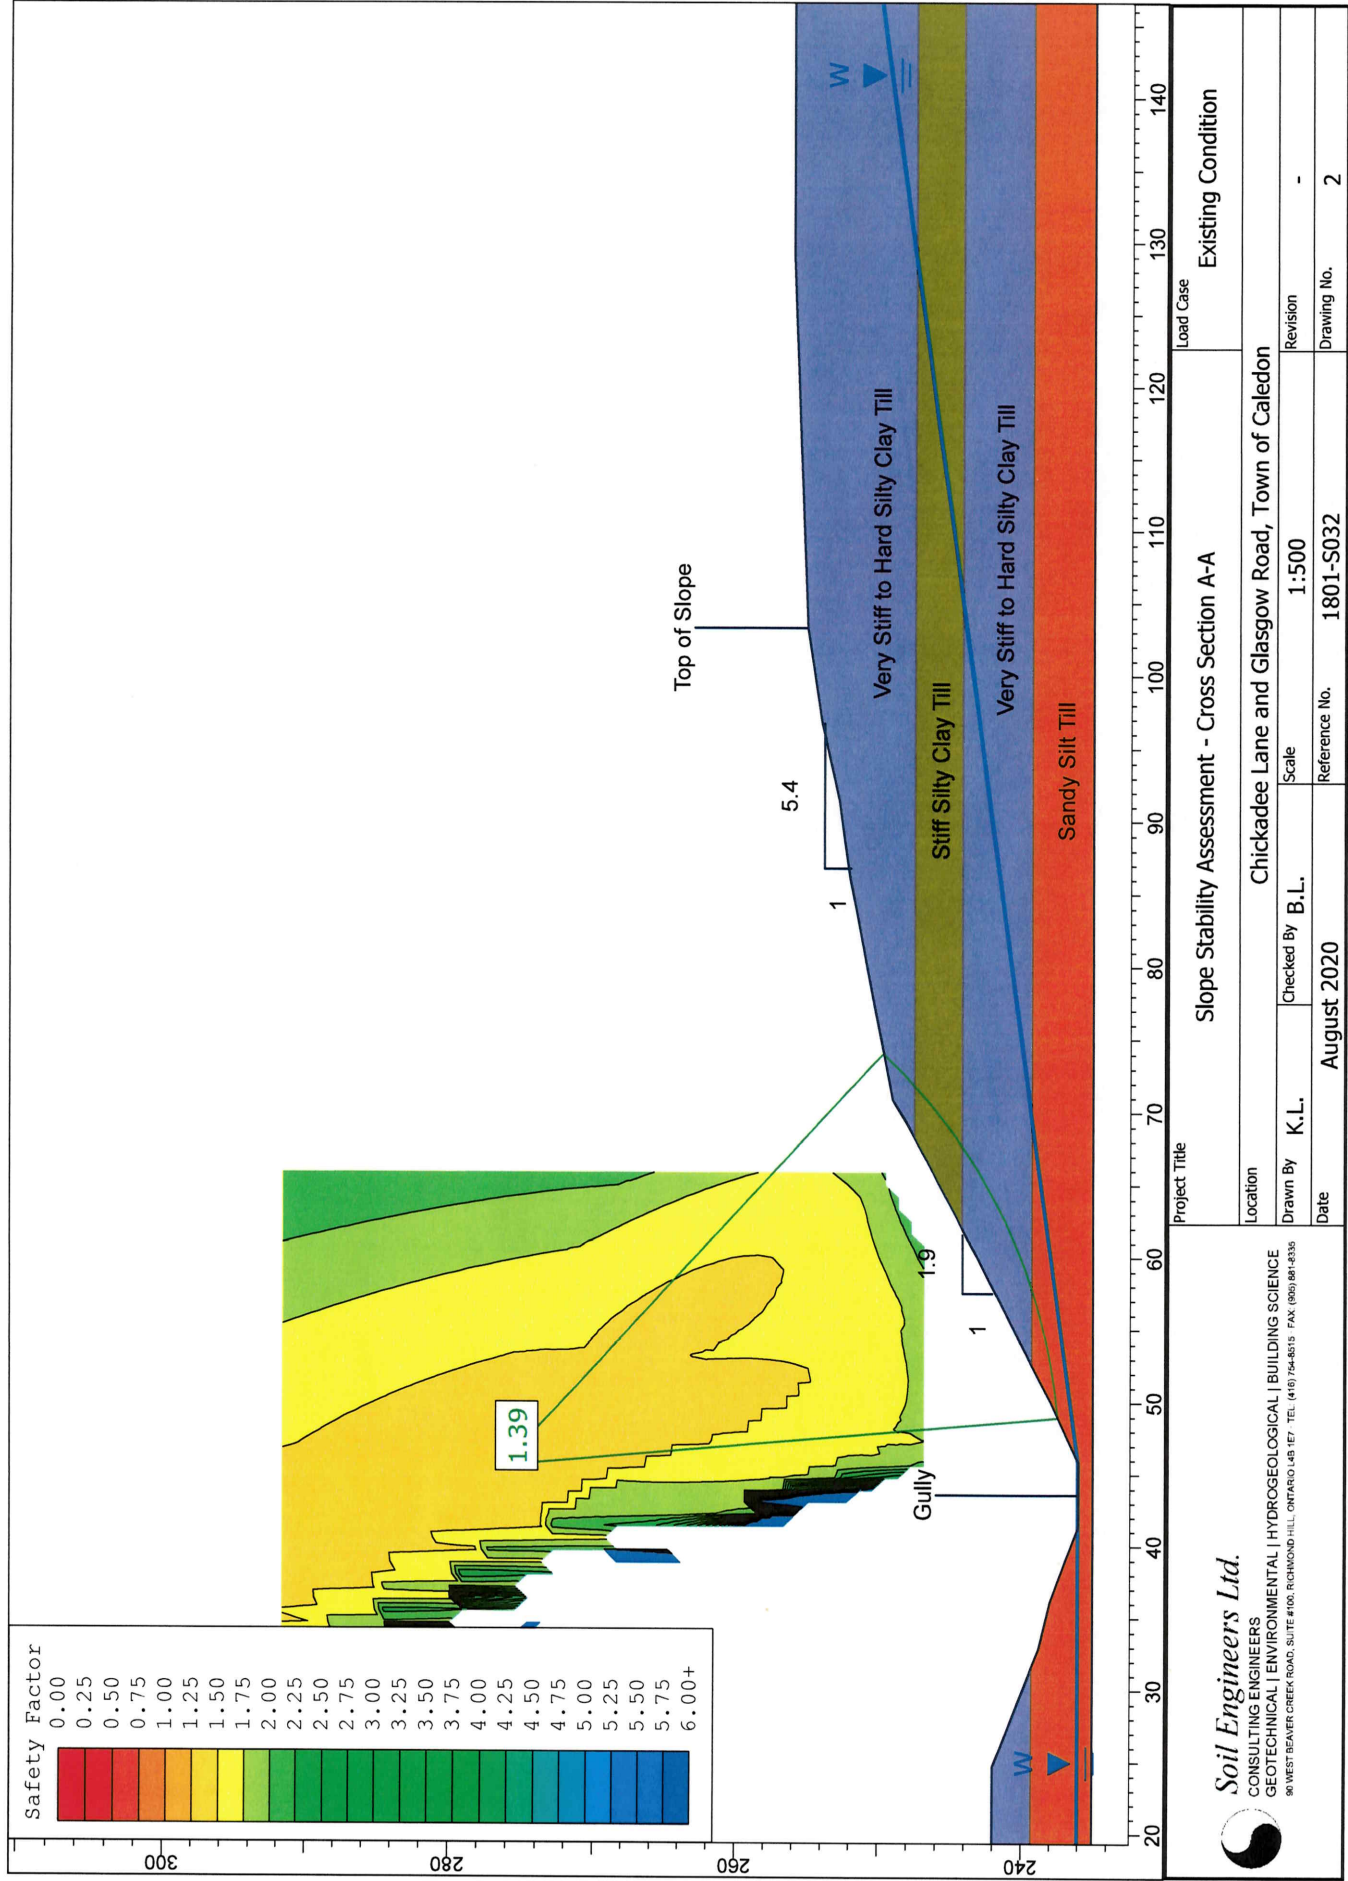


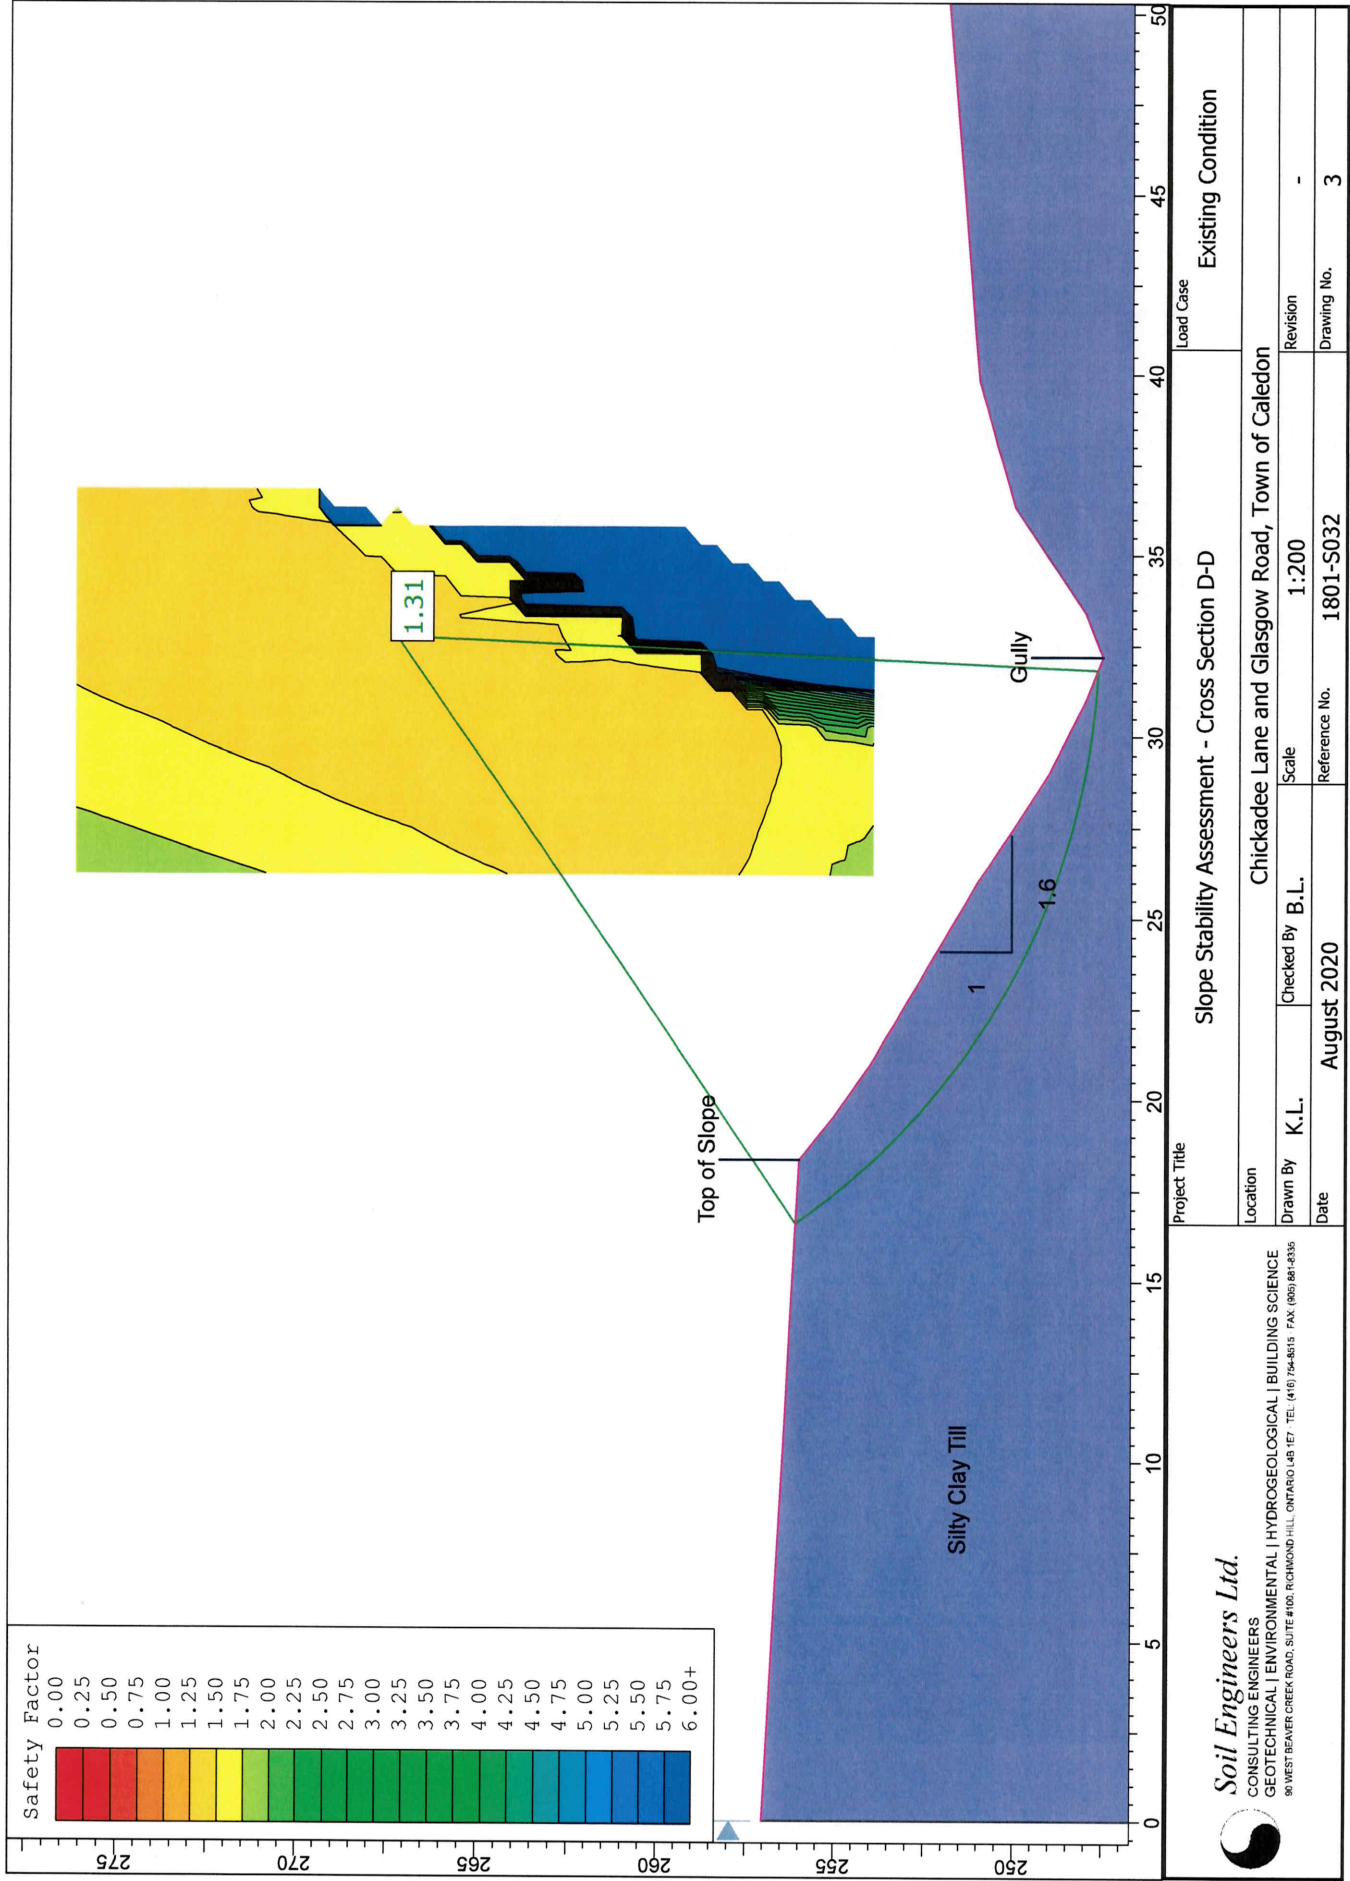



Soil Engineers Ltd.

CONSULTING ENGINEERS
GEOTECHNICAL | ENVIRONMENTAL | HYDROGEOLOGICAL | BUILDING SCIENCE
90 WEST BEAVER CREEK ROAD, SUITE #100, RICHMOND HILL, ONTARIO L4B 1E7 TEL: (416) 754-8515 FAX: (905) 881-4335

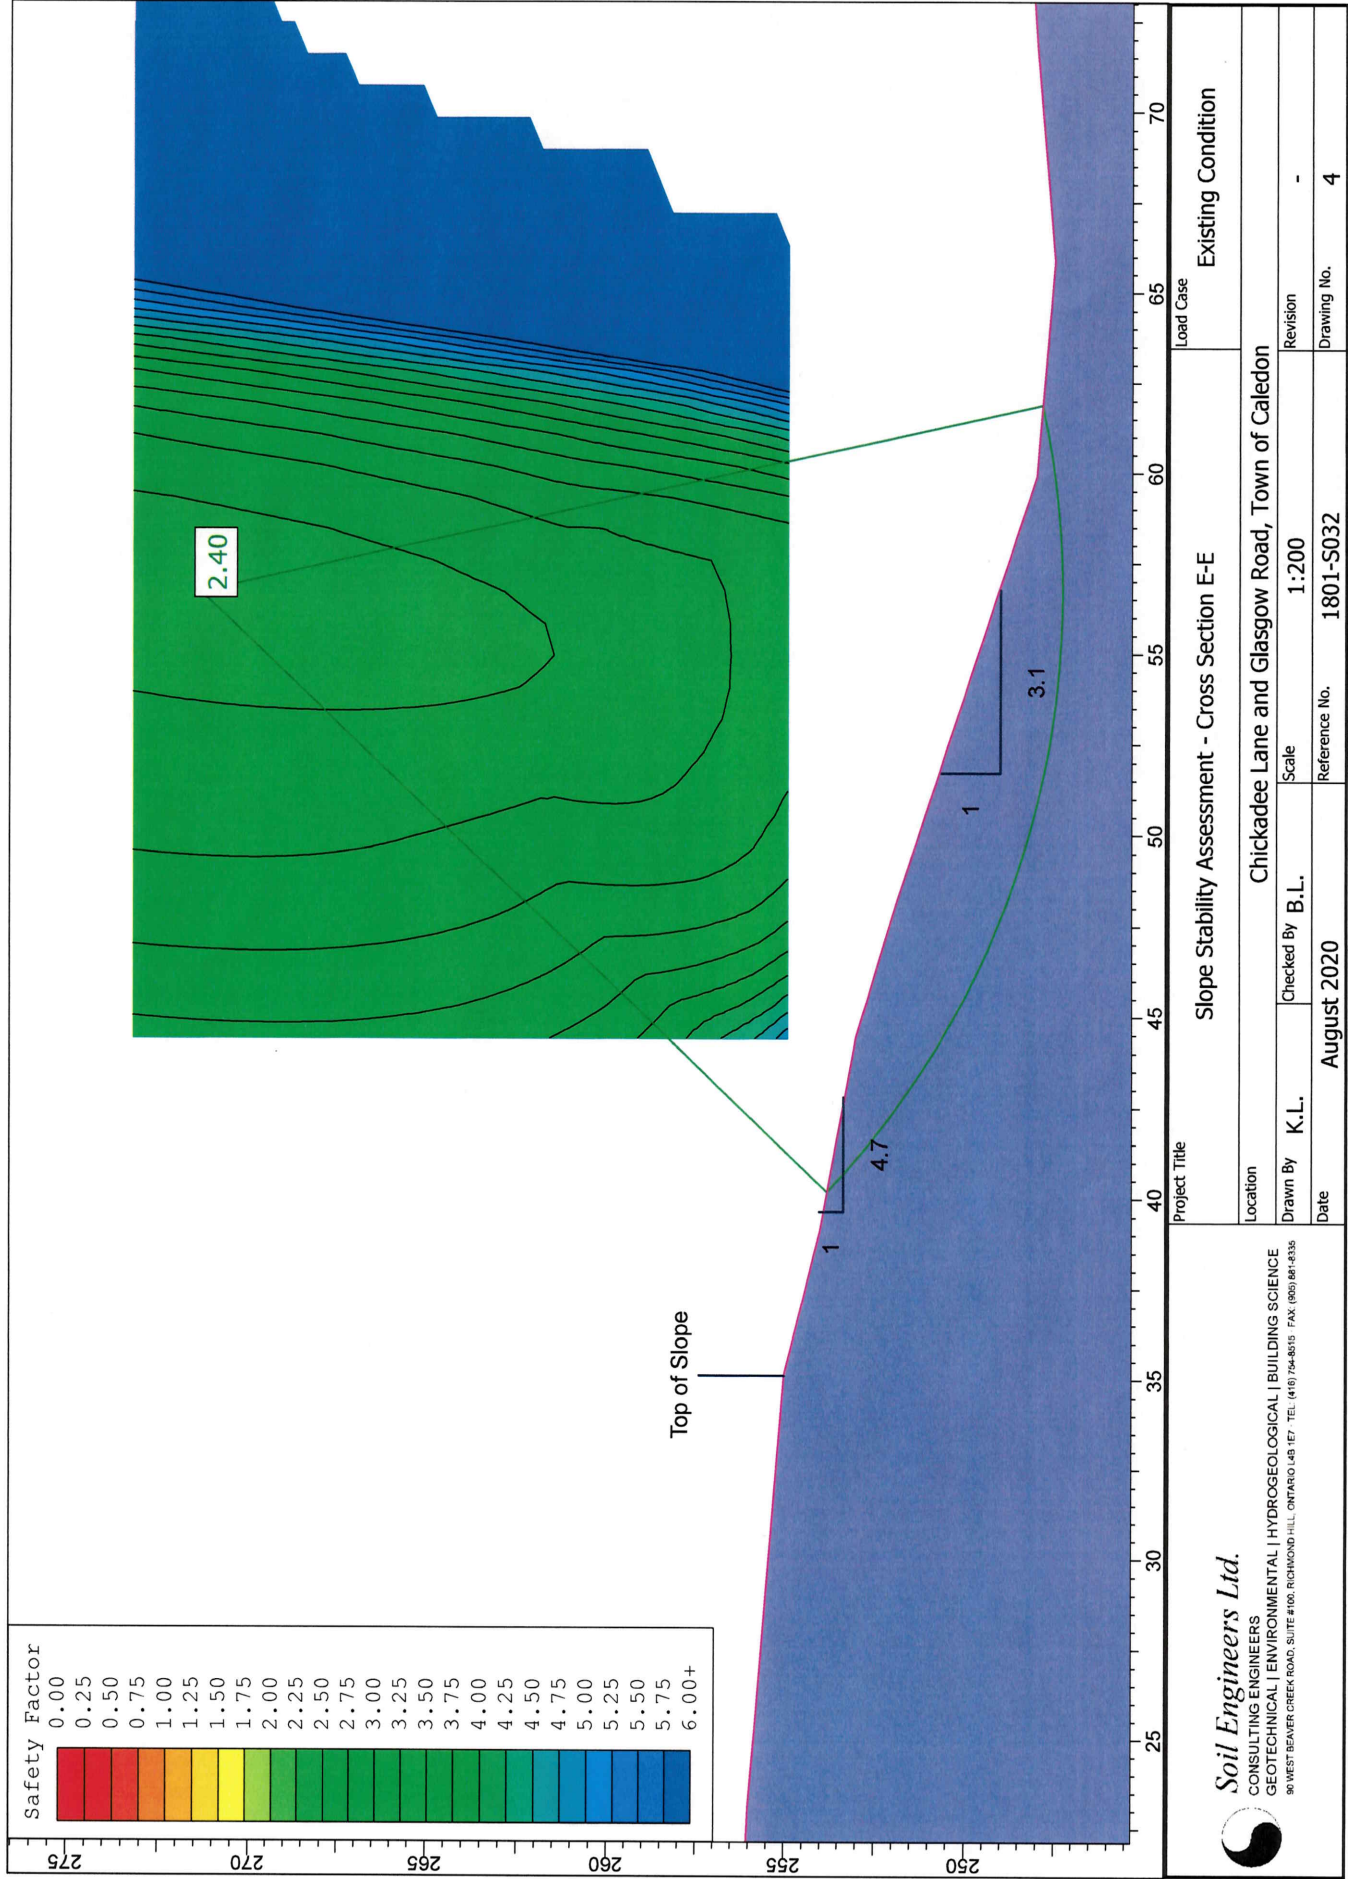

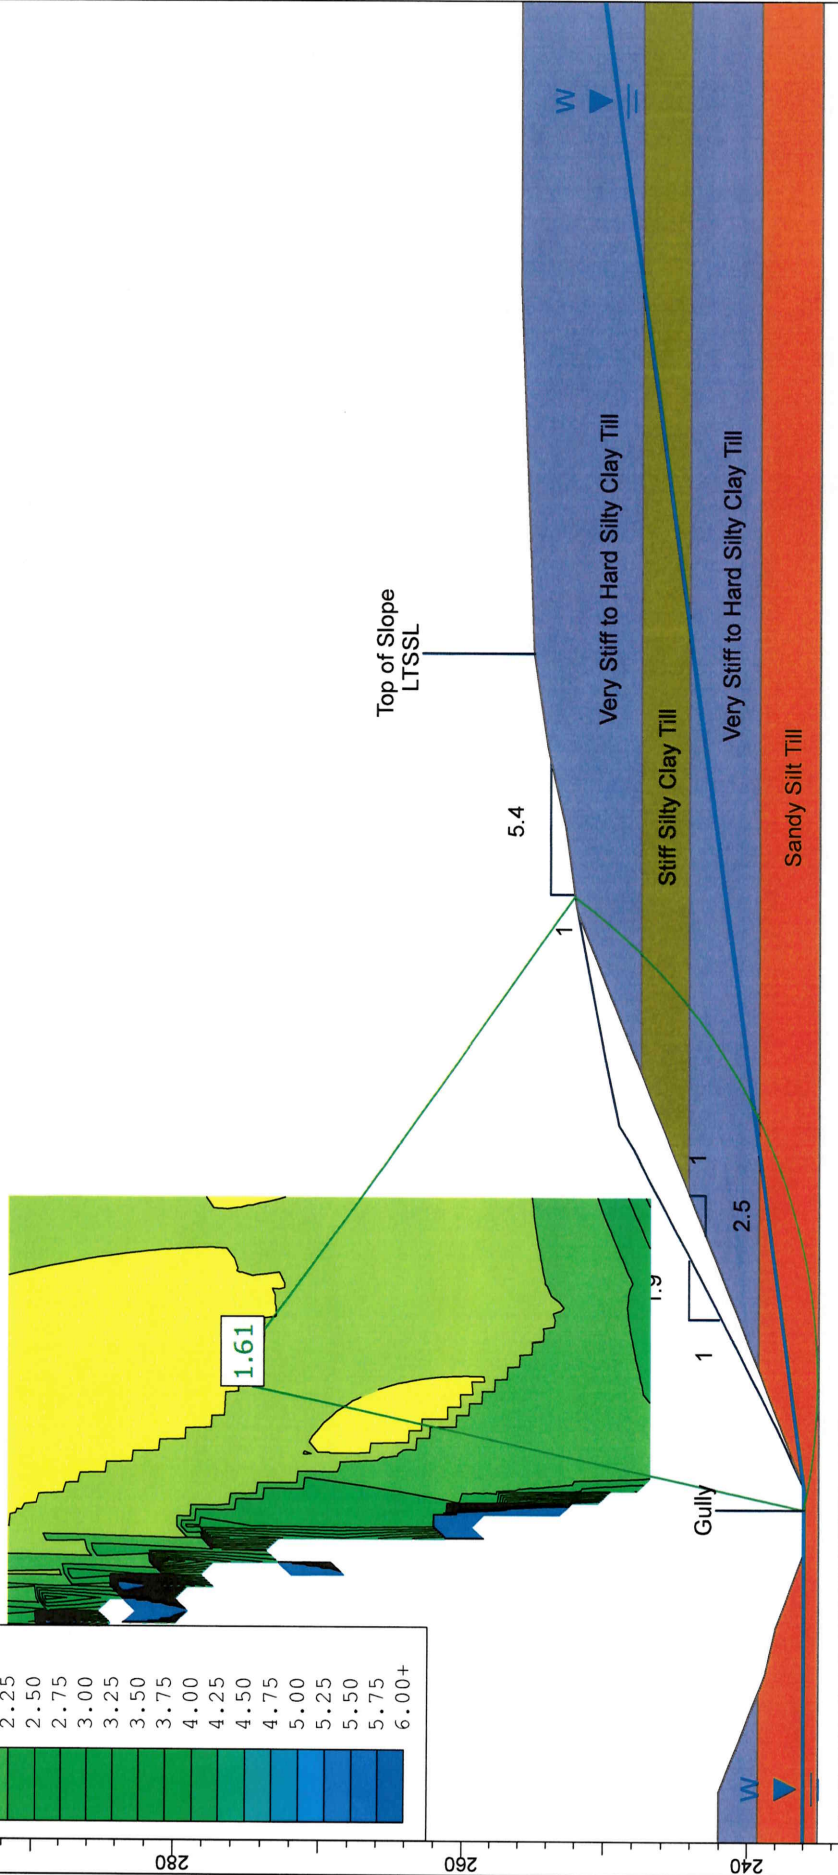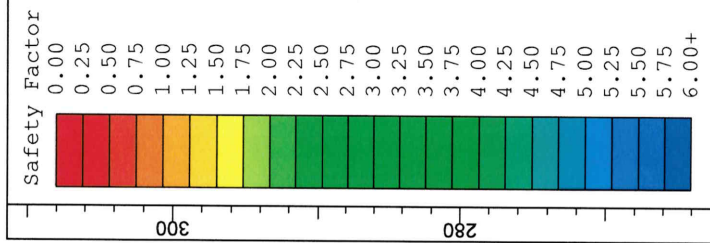

Soil Engineers Ltd. CONSULTING ENGINEERS GEOTECHNICAL ENVIRONMENTAL HYDROGEOLOGICAL BUILDING SCIENCE 90 WEST BEAVER CREEK ROAD, SUITE #100, RICHMOND HILL, ONTARIO L4B 1E7 TEL: (416) 754-8515 FAX: (800) 887-4335			Slope Stability Assessment - Cross Section A-A			Load Case	Geotechnically Stable Condition
Project Title			Location			Chickadee Lane and Glasgow Road, Town of Caledon	
Drawn By K.L.	Checked By B.L.	Scale 1:500	Revision			-	
Date August 2020	Reference No. 1801-S032	Drawing No. 5					

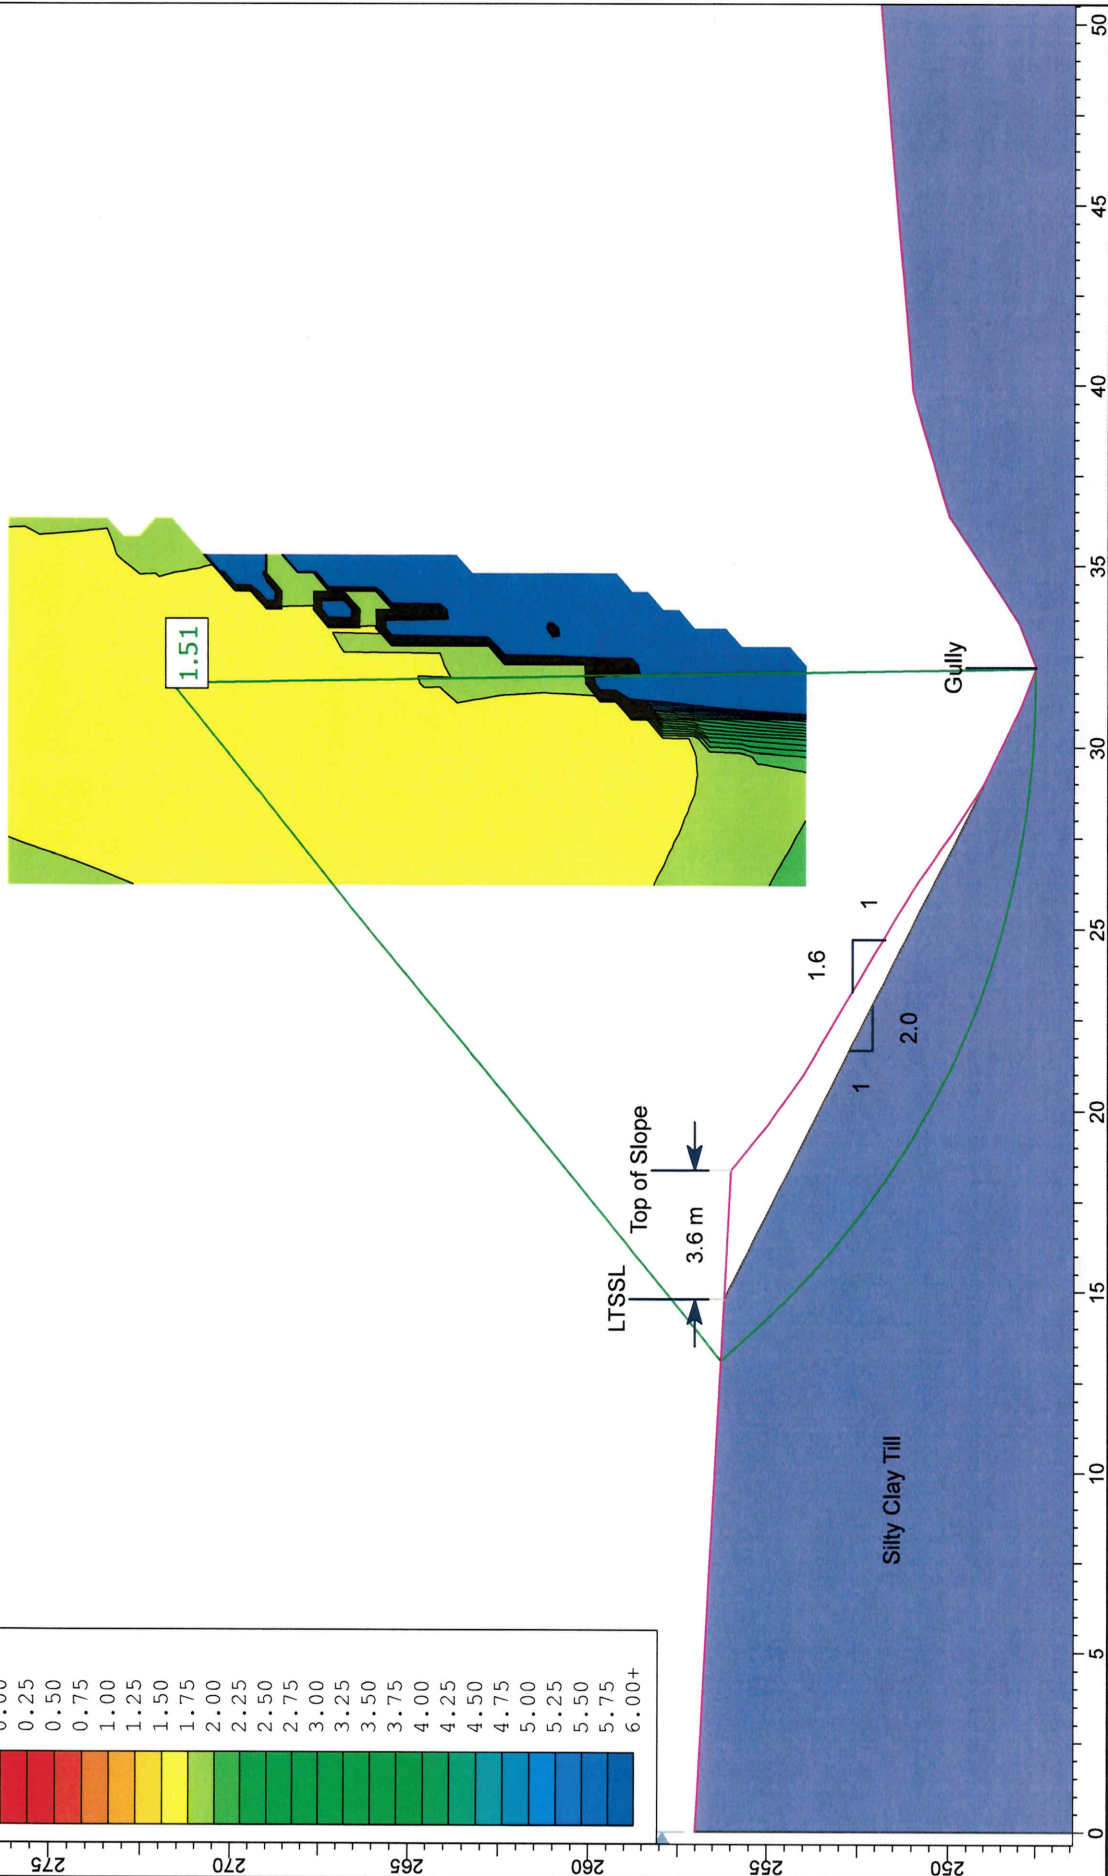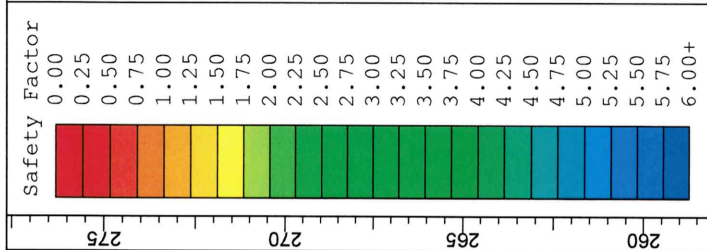

Project Title			Load Case	
Slope Stability Assessment - Cross Section D-D			Geotechnically Stable Condition	
Location			Chickadee Lane and Glasgow Road, Town of Caledon	
Drawn By	K.L.	Checked By	B.L.	Scale
Date	August 2020	Reference No.	1801-S032	Revision
			Drawing No.	6

APPENDIX “C”

**Hydrogeological Investigation - Chickadee Lane Rounding Out Area “B”, Bolton Ontario, Palmer
Environmental Consulting Group Inc., dated October 12th 2018, Project No. 170163**



PALMER
ENVIRONMENTAL
CONSULTING
GROUP INC.

74 Berkeley St., Toronto, Ontario M5A 2W7 t 647-795-8153

Hydrogeological Investigation – Chickadee Lane Rounding Out Area B

Bolton, Ontario

PECG Project #
170163

Prepared For
Brookvalley Project Management Inc.

October 12, 2018



PALMER
ENVIRONMENTAL
CONSULTING
GROUP INC.

74 Berkeley St., Toronto, Ontario M5A 2W7 t 647-795-8153

October 12, 2018

Frank Filippo
Director, Land and Construction
Brookvalley Project Management Inc.
137 Bowes Road
Concord, ON L4K 1H3

Dear Mr. Filippo:

Re: Hydrogeological Investigation – Chickadee Lane Rounding Out Area B
Project #: 170163

Palmer Environmental Consulting Group Inc. is pleased to submit the attached report describing the results of our Hydrogeological Investigation for the proposed land development with the Chickadee Lane Rounding Out Area B, in Bolton, Ontario.

Please let us know if you have any questions or comments on this submission.

Thank you for the opportunity to work with your team on this project.

Yours truly,

Palmer Environmental Consulting Group Inc.

Jason Cole, M.Sc., P.Geo.
Principal, Senior Hydrogeologist

Table of Contents

Letter

1.	Introduction	1
1.1	Scope of Work	1
2.	Regional Existing Conditions	3
2.1	Physiography and Regional Geology	3
2.2	Hydrostratigraphy	3
2.2.1	Regional Aquifers and Aquitards	3
2.2.2	Water Supply Wells	5
2.3	Drainage	5
3.	Local Existing Conditions	5
3.1	Site Geology	5
3.1.1	Methodology	5
3.1.2	Results	7
3.2	Groundwater Levels	7
3.3	Hydraulic Gradients	9
3.4	Hydraulic Conductivity	11
3.5	Groundwater – Surface Water Interactions	12
3.6	Groundwater Chemistry	12
4.	Water Balance	14
4.1	Methodology	14
4.2	Pre-Development Water Balance Results	18
5.	Development Considerations	22
5.1	LID Considerations	22
5.2	Source Water Protection	22
5.3	Permit To Take Water (PTTW)	23
6.	Summary and Conclusions	24
7.	Signatures	25
8.	References	26

List of Figures

Figure 1. Site Area	2
Figure 2. Surficial Geology	4
Figure 3. Recorded Groundwater Levels in MW-5 and MW-2S	8
Figure 4. Groundwater Flow.....	10
Figure 5. Site Topography.....	16
Figure 6. Pre-Development Land Use	17
Figure 7. Pre-Development Infiltration	20
Figure 8. Pre-Development Runoff	21

List of Tables

Table 1. Monitoring Well Installation Details and Groundwater Levels	6
Table 2. Mini Piezometer Installation Details, Water Levels, and Hydraulic Gradients	6
Table 3. Hydraulic Conductivity Results	11
Table 4. Groundwater Chemistry Results	12
Table 5. Summary of Infiltration Factors (MOEE, 1995)	14
Table 6. Available Water Surplus Values by Pre-Development Land Use	19
Table 7. Summary of Pre-Development Water Balance Analysis	19

List of Appendices

Appendix A.	Concept Site Design (HPG, 2018)
Appendix B.	Borehole Logs (Soil Engineers Ltd., 2018)
Appendix C.	Single Well Response Test Analyses (PECG, 2018)
Appendix D.	Groundwater Chemistry Certificate of Analysis

1. Introduction

Palmer Environmental Consulting Group Inc. (PECG) was retained by Brookvalley Project Management Inc. on behalf of Zancor Homes to complete a Hydrogeological Investigation for the proposed Chickadee Lane residential land development project in Bolton, Ontario (the “project” or the “site”). The property is referred to as the Chickadee Lane Rounding Out Area B (**Figure 1**) and is part of the Bolton Residential Expansion Lands (BRES) Official Plan Amendment (ROPA 30). Prior to submission of a Draft Plan, these lands must be brought into the Bolton urban boundary through completion of a Comprehensive Environmental Impact Study and Management Plan (CEISMP), inclusive of a hydrogeological assessment. This report was prepared to support the CEISMP process.

The site is located on an approximately 10.08 ha parcel of land, with 2.75 ha located within the Provincially designated Greenbelt Lands. The Concept Plan for the proposed Chickadee Lane Rounding Out Area B by Humphries Planning Group Inc. (HPG) is presented in **Appendix A**.


The subject property is located within the Humber River Watershed, under the jurisdiction of the Toronto and Region Conservation Authority (TRCA). The purpose of the hydrogeological investigation is to determine the existing hydrogeological conditions and identify potential impacts of the proposed development to local surface water and groundwater resources. This hydrogeological assessment was undertaken in tandem with the geotechnical investigation completed by Soil Engineers Inc. and includes an assessment of soil and groundwater conditions including groundwater levels, groundwater flow, aquifers and aquitards, local water use, a pre-to-post development water balance, and recommendations for Low Impact Development (LID) mitigation measures.

1.1 Scope of Work


The scope of work for PECG’s Hydrogeological Investigation to support site design and permitting includes the following main tasks:

- Characterize the surface and sub-surface geological and hydrogeological conditions through use of data from six (6) boreholes and four (4) groundwater monitoring wells as installed by Soil Engineers Ltd.;
- Develop and complete hydraulic testing at monitoring wells (response test) to estimate hydraulic conductivity;
- Complete one (1) groundwater chemistry sample for comparison with Ontario Drinking Water Standards (ODWS);
- Installation of one (1) drive-point piezometer to assess surface water/ groundwater interactions in the tributary to the Humber River located north of the site;
- Monthly groundwater and MP water level monitoring over a 1-year period to confirm seasonality of site water levels;
- Instrumentation of two (2) wells with Solinst Leveloggers to continuously record groundwater levels;
- Conduct a pre-to-post-development site water balance; and,
- Provide a Hydrogeological Investigation Report to support preliminary site design, CEISMP reporting.

Cnbl l dms O' sg989Df nxd/Rg' gdc/Cnldbrt/@nd/06/05, Aqnnj U' Wdx Gnl dr/06/052, Bgth ' cdd K' rd Dbnrf x' mc Gxcqnf dnlnf x/L ' oohrf || wc/06/052* Eln t qd0* Rhd-l wc



- Legend**
- ◆ L mthOelynl dslq
 - ◆ L mthandrf V dlk
 - V ' sdqnt q d
 - Bmrrnt q' 0.1 (
 - Rd cx @p'



COQ/ MRA-Dk-dq
BGBJLDC3Q-Qnlh
COJL DBS06/052
C@D91 LK00+1/07
Data Sources: Imagery ©2017 Google, Overview
basemap credits at page bottom.

Rb: 14 039/11
TSL Ymnd 06M
M@ 0872

Prepared by:
PALMER ENVIRONMENTAL CONSULTING GROUP INC.

CLIENT: Aqnnj U' Wdx Gnl dr
PROJECT: Bgth ' cdd K' rd Dbnrf x
mc Gxcqnf dnlnf x

Site Location

FIGURE 1

2. Regional Existing Conditions

2.1 Physiography and Regional Geology

The site is located within the South Slope physiographic region, characterised as a slightly drumlinized region that lies to the south of the Oak Ridges Moraine and north of the Peel Plain (Chapman and Putman, 1984).

The surficial geology of the site, as described by Ontario Geological Survey (OGS) mapping, is characterized as Halton Till with clayey to silt-textured sediments derived from glaciolacustrine deposits or shale (**Figure 2**). The Halton Till overlies the Newmarket Till, and where present, these tills are separated by the sandy deposits of the Oak Ridges Moraine.

Paleozoic bedrock at the site is characterized by the shale and limestone of the Georgian Bay Formation. Bedrock was not encountered during the most recent borehole drilling, and based on Ministry of Environment, Conservation and Parks (MECP) water well database information, this formation is encountered at approximately 156 m below ground surface, or 100 meters above sea level (masl) at the site location.

2.2 Hydrostratigraphy

2.2.1 Regional Aquifers and Aquitards

Hydrostratigraphic units can be classified into two distinct groups based on their capacity for permitting groundwater movement: an aquifer or an aquitard. An aquifer is generally defined as a layer of soil permeable enough to conduct a usable supply of water, while an aquitard is a layer of soil that inhibits groundwater movement due to low permeability. The major regional hydrostratigraphic units that control groundwater at the site are described below.


The **Halton Till** and underlying **Newmarket Till** are often grouped together in this area and act as significant regional aquitards of fine textured sediments. The low permeability of the unit limits groundwater recharge and contaminant migration, however the presence of sand and gravel within the tills can also act as confined aquifers on a local scale in some areas. The bulk hydraulic conductivity (K) of these units ranges from approximately 5×10^{-6} m/s to 5×10^{-8} m/s (CAMC-YPDT, 2006). Groundwater flow within these units is typically downwards towards more permeable units. Within the study area, Halton Till sediments are approximately 20 m to 40 m thick, making it the dominant aquitard unit.

The **Oak Ridges Moraine (ORM)** acts as a major aquifer and recharge complex within the region. Near the study area it is expected that the ORM is between approximately 1 m and 15 m in thickness and is confined by the lower permeability Halton Till and Newmarket Till aquitards.

The **Thorncliffe Aquifer** consists of glaciofluvial and glaciolacustrine sediments of stratified sands, silty sand, and silt and clay. This aquifer is confined by the **Newmarket Till** aquitard and is approximately 5 m to 10 m in thickness near to the study area. Overall groundwater flow within this aquifer is south towards Lake Ontario or within discharge areas in major river valleys.



Figure Extent



Legend

- ✦ L hnhOtdynl dsdq
- ✦ L nntndmf V dtk
- V' sdqnt q d
- Bnnnt q'0 l (
- Rst cx @gt'


Surficial Geology

Halton Till:

aqtv mkn' l sn rlskn' l slk

Modern Alluvium:

rksr' mc+fq udk



COG M9A- Dcddq
 BG0BJ DC9Q- Onhej
 CONI DBS906/ 052
 C@DBI L K00+1/07
 R' id 081 / /
 TSL Ynrd 06M
 M@ 0872
 Data Sources: Imagery ©2017 Google, Overview
 basemap credits at page bottom. 1. Ontario
 Geological Survey 2010. Surficial geology of
 Southern Ontario.

Prepared by:



CLIENT: Aqtnj U hdx Gnl dr
 PROJECT: Bghe' cdd K mtd Dbnkt x
 mc Gxcqtl dntkt x

Surficial Geology

FIGURE 2

2.2.2 Water Supply Wells

Based on a search of the MECP water well database, 18 water wells were identified within a 500 m radius of the site, none of which exist within the Region of Peel Wellhead Protection Area (WHPA). Of these wells, 9 are used for domestic water supply. The remaining 9 wells are either abandoned or used as observation wells.

2.3 Drainage

The study area lies within the Main Humber River Subwatershed, which forms the northernmost and largest portion of the Humber River Watershed, contributing 32% of total baseflow to the overall watershed. The subwatershed encompasses three secondary subwatersheds systems, Centreville Creek, Cold Creek, and Rainbow Creek. The subwatershed drains an area of approximately 357 km² and has the highest baseflow to total flow ratios (Baseflow Index, BFI) of the five primary subwatersheds that constitute the Humber River Watershed. This ratio indicates a largely groundwater dominated flow regime and a greater likelihood to contain cold water habitats for aquatic organisms (TRCA, 2008-a).

The study area does not contain any critical habitat for aquatic species listed under the species at risk act (SARA; DFO, 2017).

The subwatershed consists of primarily agriculture (40.8%) and natural (46.3%) land, and of the five primary subwatersheds has the lowest urban use (12.1%) and contains the majority of identified higher quality terrestrial habitat. However, the subwatershed is rated as fair for quality distribution of natural cover, and the lower reach is currently undergoing urbanization as part of municipal growth requirements.

3. Local Existing Conditions

3.1 Site Geology

3.1.1 Methodology

Borehole drilling at the site for hydrogeological purposes was conducted from February 23 to February 29, 2018. Fourteen boreholes were drilled under the supervision of Soil Engineers Ltd. staff to depths ranging from 6.10 mbgs to 32.0 mbgs. Borehole drilling was completed using solid stem augers, and six boreholes were completed as 51 mm diameter schedule 40 PVC pipe monitoring wells with 1.5 m long screens (MW2-S/N, MW2-D, MW5, MW6, MW12-S/N, and MW12-D). MW2S/D and MW12S/D were installed as nested wells, with S and D indicating shallow or deep well, respectively. The location of each monitoring well is shown on **Figure 1**, and well details are provided in **Table 1**. Borehole logs are presented in **Appendix B**.

A watercourse was noted in the Greenbelt lands to the northwest of the site which contributes to the tributary to the Humber River (**Figure 1**). One mini piezometer (MP1) was installed within the feature to measure the magnitude and direction of the hydraulic gradient within the tributary (**Table 2**).

Table 1. Monitoring Well Installation Details and Groundwater Levels

MW ID	Surface Elevation (masl)	Stick Up (m)	Depth (mbgs)	Screened Interval (mbgs)	Screened Geology	Water Level (mbgs)						
						March 15, 2018	March 19, 2018	April 4, 2018	May 17, 2018	June 13, 2018	July 19, 2018	August 27, 2018
MW2-S	256	0.79	7.60	6.10 – 7.60	Silty Clay Till	0.85	0.97	0.12	0.95	2.62	3.87	4.72
MW2-D	256	0.73	19.80	18.30 – 19.80	Silty Clay Till	11.94	11.88	11.98	11.35	11.81	12.72	13.70
MW5	261	0.64	5.98	4.60 – 6.10	Silty Clay Till	0.89	0.94	0.56	0.88	0.69	1.64	2.50
MW6	259	0.68	4.59	4.60 – 6.10	Silty Clay Till	0.47	1.80	0.48	0.47	1.05	1.83	1.26
MW12-S	256	0.71	9.16	6.10 – 7.60	Silty Clay Till	6.06	8.71	8.07	4.60	3.84	4.26	4.73
MW12-D	256	0.80	30.20	30.50 – 32.00	Silty Clay Till	23.29	29.12	21.85	14.30	22.31	25.33	25.93

Table 2. Mini Piezometer Installation Details, Water Levels, and Hydraulic Gradients

MP ID	Surface Elevation (masl)	Stick Up (m)	Depth to Screen (m)	Water Level (mbtoc)*		April 4, 2018	May 17, 2018	June 13, 2018	July 19, 2018	August 27, 2018
				In	Out					
MP1	243	1.00	0.85	1.50	0.91	1.50	1.11	1.00	1.03	1.02
							0.94	Dry	Dry	Dry
					Hydraulic Gradient	-0.69	-0.20	-	-	-

*In/Out measurements are expressed in meters below top of casing (mbtoc), Hydraulic gradients are unitless

3.1.2 Results

Surficial geology at the site is consistent with regional OGS mapping (**Figure 2**). The overall lithology of the silty clay till unit is consistent with the Halton Till, containing trace gravel and occasional sand seams, cobbles and boulders. This unit of silty clay till was encountered throughout the length of all boreholes, indicating a very thick aquitard unit stretching across the area. Site stratigraphy encountered during borehole drilling is summarized below.

Topsoil: All boreholes encountered topsoil ranging in thickness from 0.16 m to 0.46 m.

Earth Fill: Five boreholes encountered earth fill beneath the topsoil ranging in thickness from 0.39 m to 1.96 m. This fill is generally described as brown to grey silty clay with pockets of topsoil and occasional rootlets, wood debris, and brick fragments.

Silty Clay Till: Sediments of silty clay till from the Halton Till formation were encountered in all boreholes underlying either topsoil or earth fill. The thickness of this unit ranged from 4.10 m to 31.54 m, and the bottom of this unit was not encountered during drilling. This unit is expected to be approximately 40 m thick in this area.

3.2 Groundwater Levels

Groundwater levels in the monitoring wells were measured on March 15th and 19th, April 4th, May 17th, June 13th, July 19th, and August 27th, 2018. The shallow groundwater table ranged in depth from 0.12 mbgs (MW2-S on April 4, 2018) to 8.71 mbgs (MW12-S on March 19, 2018), and the deep groundwater table ranged from 11.35 mbgs (MW2-D on May 17, 2018) to 29.12 mbgs (MW12-D on March 19, 2018), as indicated in **Table 1**.

The shallow water levels measured in some wells indicate the presence of perched water table conditions at the site. These conditions arise due to the very poor drainage of the Halton Till aquitard to deeper material that results in slow downward percolation rates and an increased response of shallow soils to surface water inputs. The actual level of the water table ranges from approximately 5 m to 8 m below ground surface across the site, indicated by a shift in soil colour from brown (oxidized) to grey (wet, low oxygen) seen in borehole logs for MW2, MW6, and MW12S/D (**Appendix B**).

It is therefore important to consider that groundwater levels are subject to fluctuations due to seasonality and precipitation input. As the monitoring events took place during the pre- and post-spring freshet, these values are unlikely to be representative of the seasonal highs, however late season manual ground water levels are likely indicative of seasonal lows (**Figure 3**).

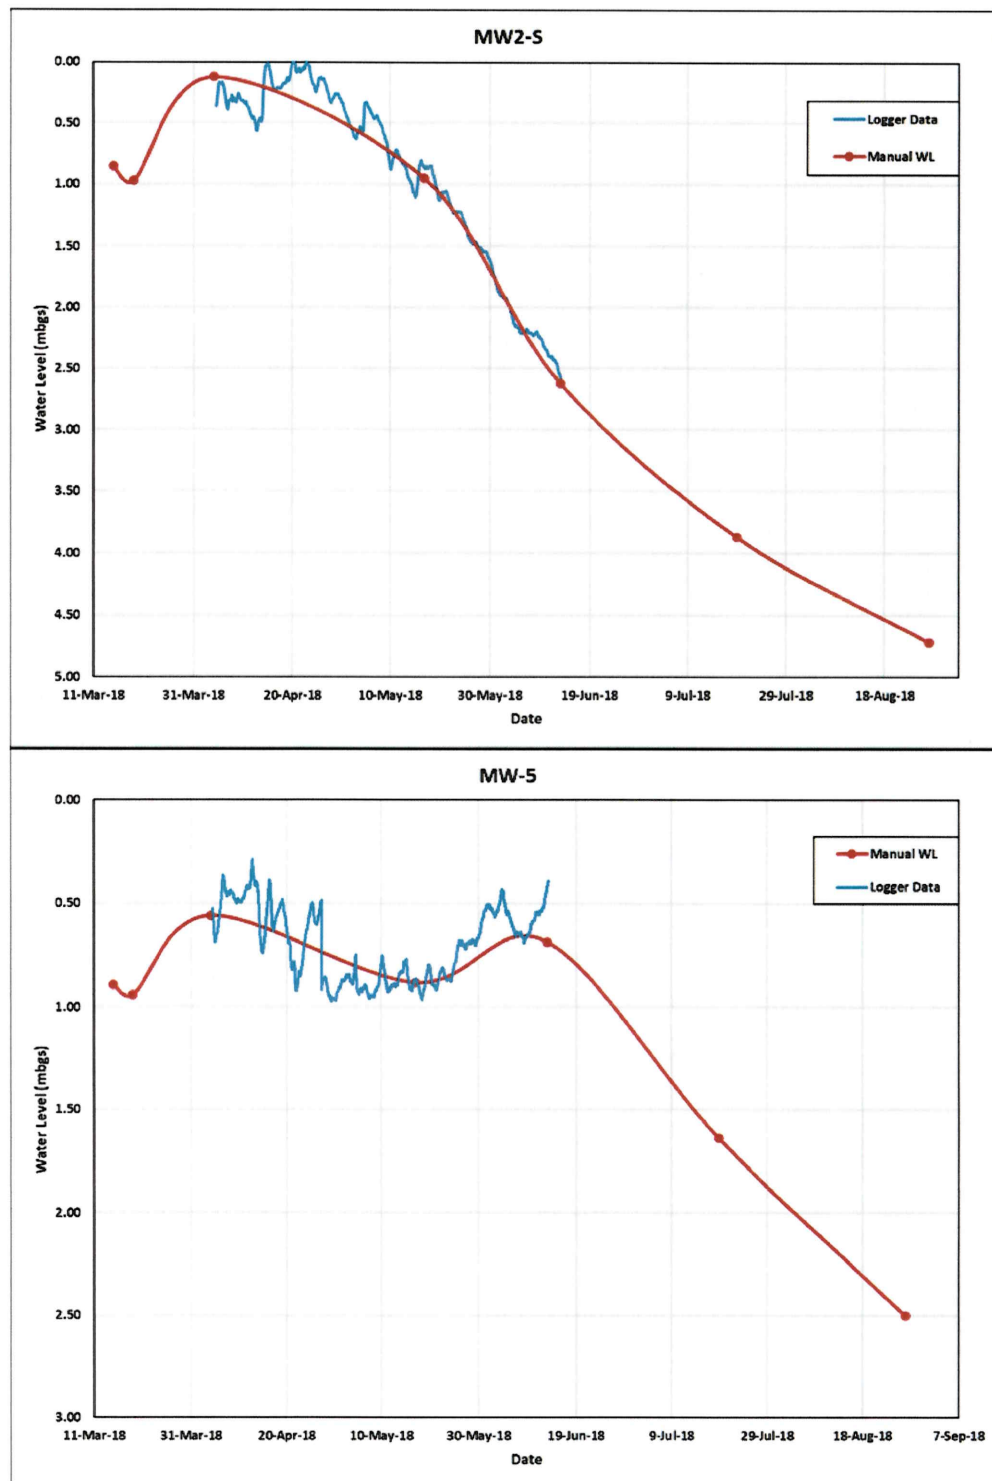


Figure 3. Recorded Groundwater Levels in MW-5 and MW-2S

3.3 Hydraulic Gradients

Groundwater flow at the site generally follows topography and flows either in a northeast direction, or northwest towards the Humber River tributary depending upon site location (**Figure 4**). Based on these results, there is a local groundwater flow divide through the middle of the site. A mean horizontal groundwater water gradient of 0.02 is observed towards both the northwest (MW2) and northeast (MW12) of the site area.

A very strong downward hydraulic gradient was observed in the nested monitoring wells on the east (MW2 = -0.86 m/m) and west (MW12 = -1.22 m/m) margins of the site. This is expected due to the steep downwards topography of the Humber River Valley that is immediately adjacent to either of the well locations.

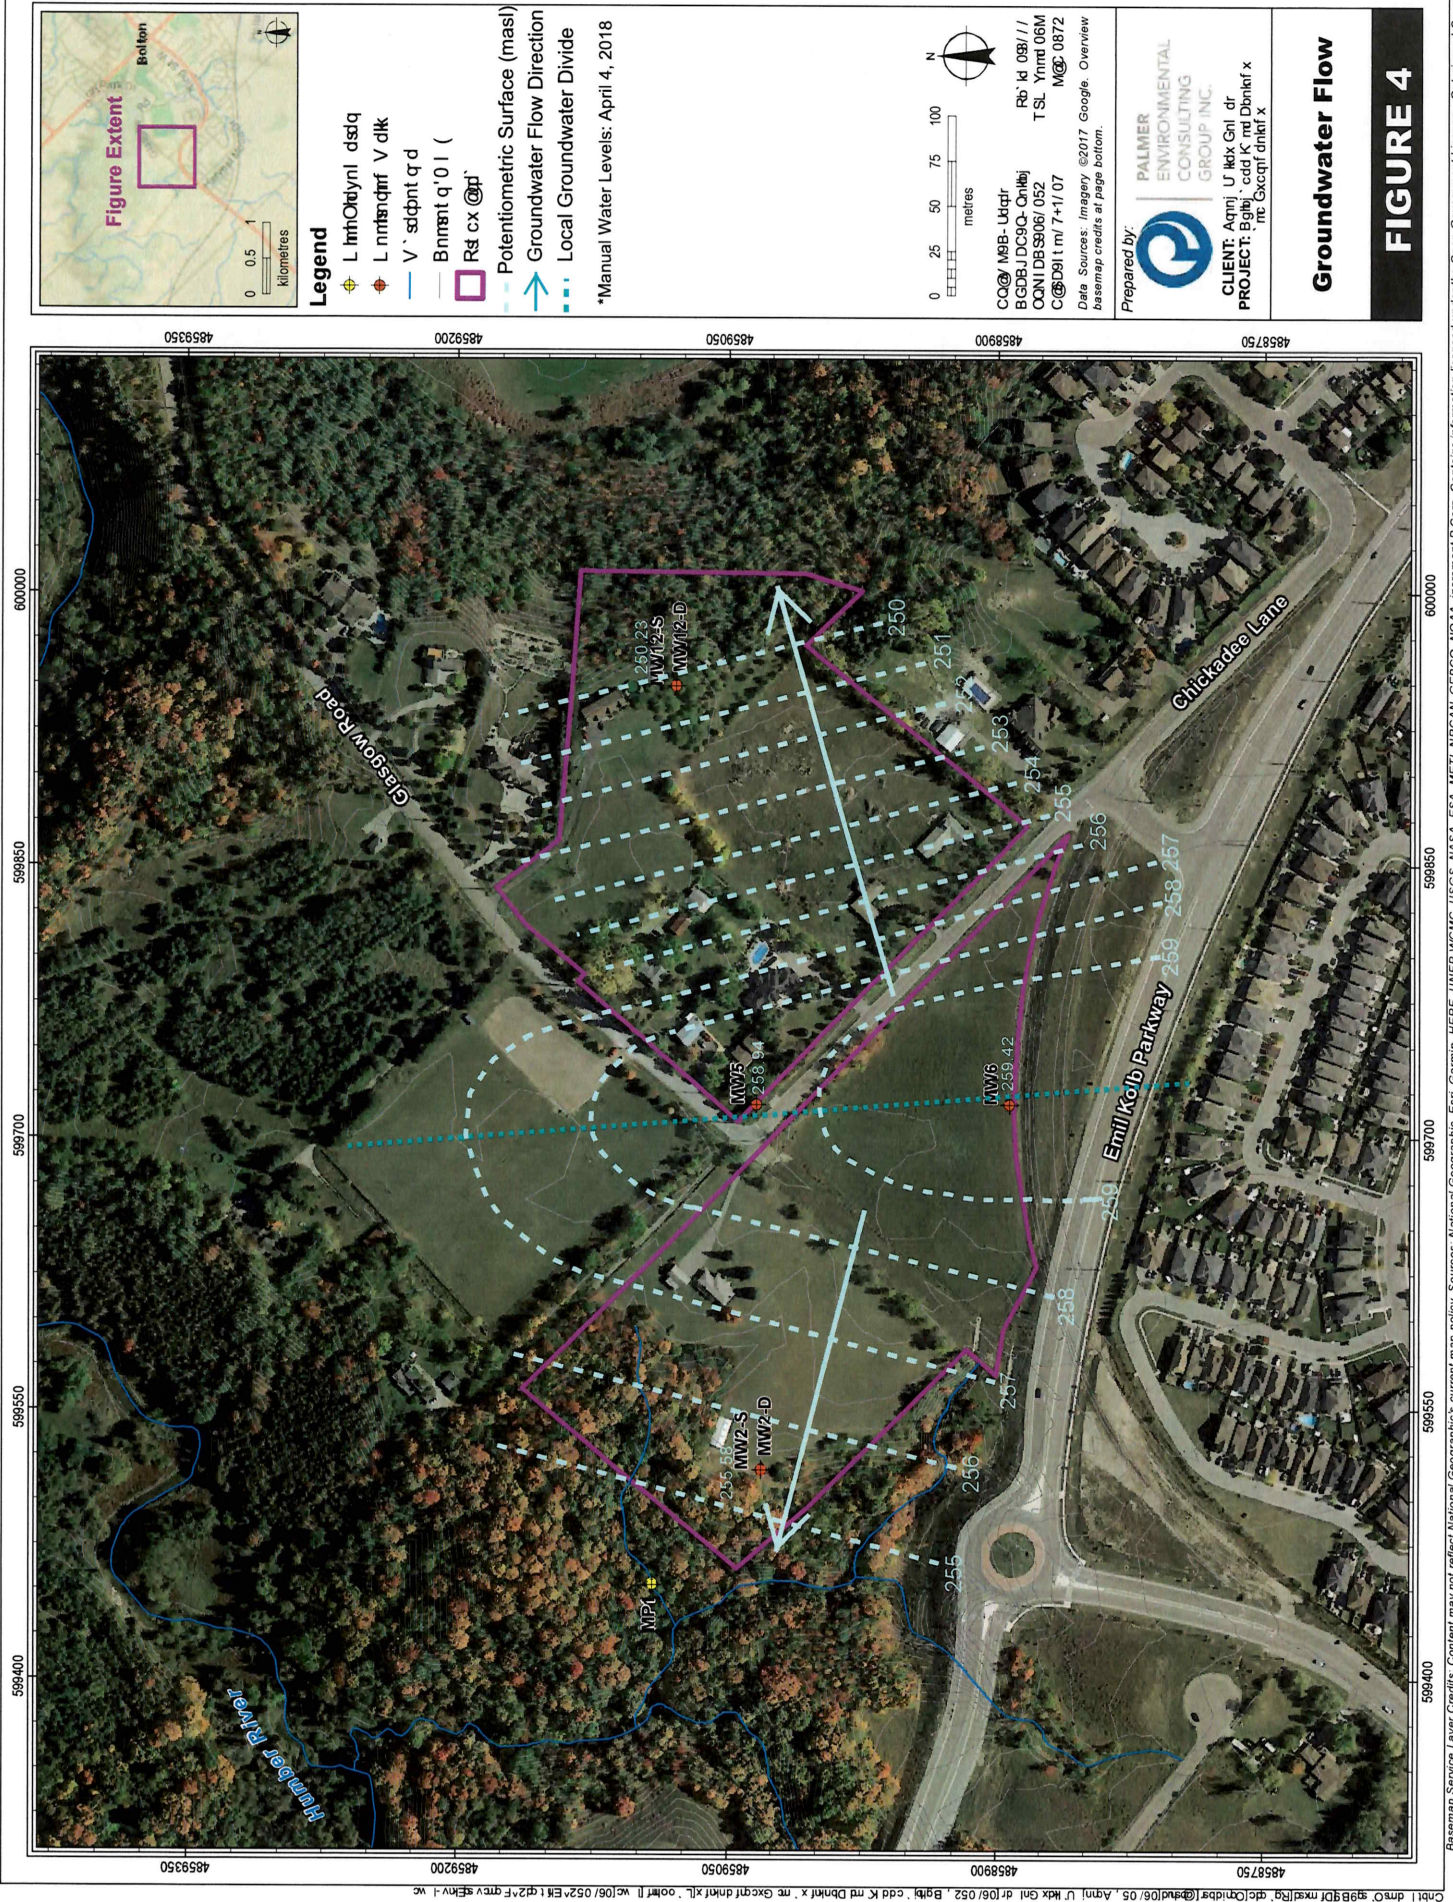



Figure Extent

Legend

- L mthOrdynl dslq
- L nntstqnt V dlk
- V' sdqnt qd
- Bmnt q'01 (
- Rd cx @pt

- Potentiometric Surface (masl)
- Groundwater Flow Direction
- Local Groundwater Divide

*Manual Water Levels: April 4, 2018



COQ/M8B-Udqr
BGDBJ DC9Q-QnHlj
CQNI DBS906/052
C@D91 t m 7+1/07
M@ 0872
Data Sources: Imagery ©2017 Google, Overview
basemap credits at page bottom.

Prepared by:



CLIENT: Aqinj U'kdx Gnl dr
PROJECT: Bglj, cdd K mtd Dbnrl x
int Gxcqll dnlrl x

Groundwater Flow

FIGURE 4

3.4 Hydraulic Conductivity

On March 19 and April 4, 2018, PECG personnel conducted single well response tests (i.e., slug tests) at four locations to determine the hydraulic conductivity (K) of the surrounding soils. Both rising head (RH) and falling head (FH) tests were conducted by creating a head change, through the insertion (FH Test) or removal (RH Test) of a 1-m long slug. The rate of recovery in each well was measured using a datalogger to record water levels at a 1 or 2-second frequency. During the tests, manual water level measurements were also recorded to gauge recovery. Tests were terminated when either 30 minutes had elapsed or an 80% recovery in water level was attained.

Hydraulic conductivity (K) values were calculated using the displacement-time data and were analysed using the Hvorslev (1951) method for confined aquifers, modelled using Aqtesolv™ software. The analysis results are presented in **Appendix C**, and the range of calculated hydraulic conductivity values are summarized in **Table 3**. Calculated K values ranged from 3.5×10^{-6} m/s to 4.4×10^{-8} m/s, with a site-wide geometric mean K of 6.1×10^{-7} m/s. This value is within the expected range for the Halton Till Aquitard (5×10^{-6} m/s to 5×10^{-8} m/s, **Section 2.2.1**).

Observed variations in K values measured across the site are likely due to spatial variations in soil horizons. For example, MW6 is screened within a sandier unit, resulting in higher K values (10^{-6} m/s), while MW5 is within a more continuous silt and clay unit, thus resulting in a lower observed hydraulic conductivity (10^{-8} m/s).

Table 3. Hydraulic Conductivity Results

Well	Test	Hydraulic Conductivity, (m/s)	Aquifer Material	Aquifer Type	K Geometric Mean (m s ⁻¹)
MW2-S	FH	5.1×10^{-7}	Silty Clay Till	Confined	6.1×10^{-7}
	RH	6.3×10^{-7}			
MW2-D	FH	1.2×10^{-7}			
	RH	1.3×10^{-7}			
MW5	FH	4.4×10^{-8}			
	RH	-			
MW6	FH	3.5×10^{-6}			
	RH	4.3×10^{-6}			
MW12-S	FH	-			
	RH	-			
MW12-D	FH	-			
	RH	-			

*Response test data for MW12-S/D, and the RH component of MW5 was unable to be used for determination of K and was thus excluded from geometric mean K value

3.5 Groundwater – Surface Water Interactions

The Humber River tributary location northwest of the site showed a mean downward vertical hydraulic gradient of -0.45 m/m based on water level monitoring at MP1 (**Table 2**). Surface water flow was present within the feature on April 4th and May 17th, 2018, and absent during monitoring on June 13th, July 19th, and August 27th, 2018. This suggests that this feature is predominantly runoff supported and may be ephemeral.

3.6 Groundwater Chemistry

Groundwater chemistry samples were collected on March 15, 2018 from MW6 and analyzed for a suite of water quality parameters such as turbidity, TSS, pH, metals, and cations and anions. A summary table of the groundwater analysis results is presented on **Table 4**, with the Certificate of Analysis provided in **Appendix D**. Results were compared against Ontario Provincial Water Quality Objectives (PWQO) and indicate that the sample exceeds PWQO criteria for both total aluminum (Al) and total iron (Fe), most likely as a result of high TSS in the collected sample.

Table 4. Groundwater Chemistry Results

Parameter	Units	Detection Limit	PWQO	Concentration (MW4)
Physical Tests (Water)				
Colour, Apparent	CU	2.0		30.9
Conductivity	umhos/cm	3.0		941
Hardness (as CaCO ₃)	mg/L	10		461
pH	pH units	0.10	6.5-8.5	7.88
Redox Potential	mV	-1000		317
Total Dissolved Solids	mg/L	20		560
Turbidity	NTU	0.10		72.0
Anions and Nutrients (Water)				
Acidity (as CaCO ₃)	mg/L	5.0		30.0
Alkalinity, Total (as CaCO ₃)	mg/L	10		387
Ammonia, Total (as N)	mg/L	0.020		0.022
Bromide (Br)	mg/L	0.10		<0.10
Chloride (Cl)	mg/L	0.50		55.8
Fluoride (F)	mg/L	0.020		0.226
Nitrate (as N)	mg/L	0.020		<0.020
Nitrite (as N)	mg/L	0.010		<0.010
Orthophosphate-Dissolved (as P)	mg/L	0.0030		<0.0030
Phosphorus, Total	mg/L	0.0030		0.0560
Sulfate (SO ₄)	mg/L	0.30		77.1
Bacteriological Tests (Water)				
Escherichia Coli	MPN/100mL	0	0	0
Total Coliforms	MPN/100mL	0		>201
Total Metals (Water)				
Aluminum (Al)-Total	mg/L	0.0050	0.075	1.24

Parameter	Units	Detection Limit	PWQO	Concentration (MW4)
Antimony (Sb)-Total	mg/L	0.00010	0.02	0.00017
Arsenic (As)-Total	mg/L	0.00010	0.005	0.00126
Barium (Ba)-Total	mg/L	0.00020		0.0943
Beryllium (Be)-Total	mg/L	0.00010	0.011-1.1	<0.00010
Bismuth (Bi)-Total	mg/L	0.000050		<0.000050
Boron (B)-Total	mg/L	0.010	0.2	0.027
Cadmium (Cd)-Total	ug/L	0.0000050	0.1-0.5	0.0000197
Calcium (Ca)-Total	mg/L	0.50		108
Cesium (Cs)-Total	mg/L	0.000010		0.000180
Chromium (Cr)-Total	mg/L	0.00050	CR(VI) 0.001; CR(III) 0.0089	0.00296
Cobalt (Co)-Total	mg/L	0.00010		0.00168
Copper (Cu)-Total	mg/L	0.0010	0.001-0.005	0.0026
Iron (Fe)-Total	mg/L	0.050	0.3	2.07
Lead (Pb)-Total	mg/L	0.000050	0.001-0.005	0.00144
Lithium (Li)-Total	mg/L	0.0010		0.0275
Magnesium (Mg)-Total	mg/L	0.050		46.3
Manganese (Mn)-Total	mg/L	0.00050		0.114
Molybdenum (Mo)-Total	mg/L	0.000050		0.00215
Nickel (Ni)-Total	mg/L	0.00050		0.00366
Phosphorus (P)-Total	mg/L	0.050		0.083
Potassium (K)-Total	mg/L	0.050		3.57
Rubidium (Rb)-Total	mg/L	0.00020		0.00324
Selenium (Se)-Total	mg/L	0.000050	0.01	0.000282
Silicon (Si)-Total	mg/L	0.10		8.78
Silver (Ag)-Total	mg/L	0.000050		<0.000050
Sodium (Na)-Total	mg/L	0.50		39.0
Strontium (Sr)-Total	mg/L	0.0010		0.431
Sulfur (S)-Total	mg/L	0.50		27.3
Tellurium (Te)-Total	mg/L	0.00020		<0.00020
Thallium (Tl)-Total	mg/L	0.000010		0.000028
Thorium (Th)-Total	mg/L	0.00010		0.00039
Tin (Sn)-Total	mg/L	0.00010		0.00156
Titanium (Ti)-Total	mg/L	0.00030		0.0342
Tungsten (W)-Total	mg/L	0.00010		<0.00010
Uranium (U)-Total	mg/L	0.000010	0.005	0.00481
Vanadium (V)-Total	mg/L	0.00050		0.00305
Zinc (Zn)-Total	mg/L	0.0030	0.02	0.0071
Zirconium (Zr)-Total	mg/L	0.00030		0.00054

Note: PWQO – Provincial Water Quality Objectives

4. Water Balance

4.1 Methodology

A pre-development water balance was completed for the site using a monthly soil-moisture balance approach (Thornthwaite and Mather, 1957). Water balance calculations use factors such as monthly precipitation, temperature, and latitude to estimate site specific average annual evapotranspiration (ET). Long-term climate data (30-year duration, 1981 to 2010) were obtained from the meteorological station nearest to the study area, the Toronto Pearson International Airport (43°40' N, 79°37' W).

The site was divided into the two respective pre-development land use components of forested and agriculture/rural residential, and the mean annual water surplus (water available for infiltration and runoff processes) for each area was calculated by subtracting the mean annual evapotranspiration from the mean annual precipitation. To represent the silty clay till soils, soil moisture storage values of 250 mm and 400 mm were used to represent the respective agricultural/rural residential and forested components of the site.

The calculated mean annual water surplus was then partitioned using infiltration factors dependent on three components: soil type (**Figure 2**), topography/slope (**Figure 5**), and land use (**Figure 6**) (MOEE, 1995). Geographic Information System (GIS) mapping was used to divide the land use components into discrete sections and assign respective infiltration factors. Total average annual infiltration for each land use component was then determined by multiplying the appropriate water surplus value by the sum of the three individual factors. Infiltration factors used in the assessment are summarized in **Table 5**.



Table 5. Summary of Infiltration Factors (MOEE, 1995)

Area Description	Infiltration Factor
Surficial Geology	
Halton Till: Silty Clay Till	0.1
Topography/Slope (%)	
>10	0.001
10	0.05
5	0.1
2.5	0.15
1	0.2
0.5	0.25
0.1	0.3
Pre-development Landuse	
Agriculture/Rural Residential	0.1
Forest	0.15

A post-development water balance was then conducted using the same monthly soil-moisture balance approach (Thorntwaite and Mather, 1957) based on proposed site plan land use design provided by Humphries Planning Group (HPG, 2018; **Appendix A**). As impervious surfaces lack vegetation and prevent infiltration, the transpiration (T) component in the water balance is removed over these areas. Therefore, water available for both runoff and infiltration is considered as precipitation minus evaporation (P-E) in these areas. Evaporation over impervious areas is estimated to be approximately 10% of annual precipitation. Over pervious vegetated surfaces, the available water for infiltration and runoff is considered as precipitation minus evapotranspiration (P-ET).

Available water for infiltration over pervious areas was assumed to be the same from pre- to post-development scenarios as fill composition is not outlined in the proposed site plan.



Proposed methods to balance infiltration volumes post-development include a storm water management (SWM) pond, as well as parkland and natural heritage system areas at locations shown in **Appendix A**. The completed pre- to post-development water balance can be used to determine the appropriateness of these mitigation measures for this site, and whether additional Low Impact Development (LID) structures are recommended.

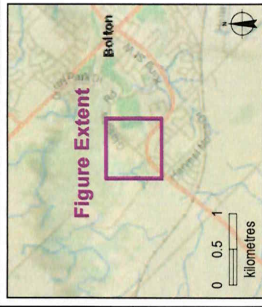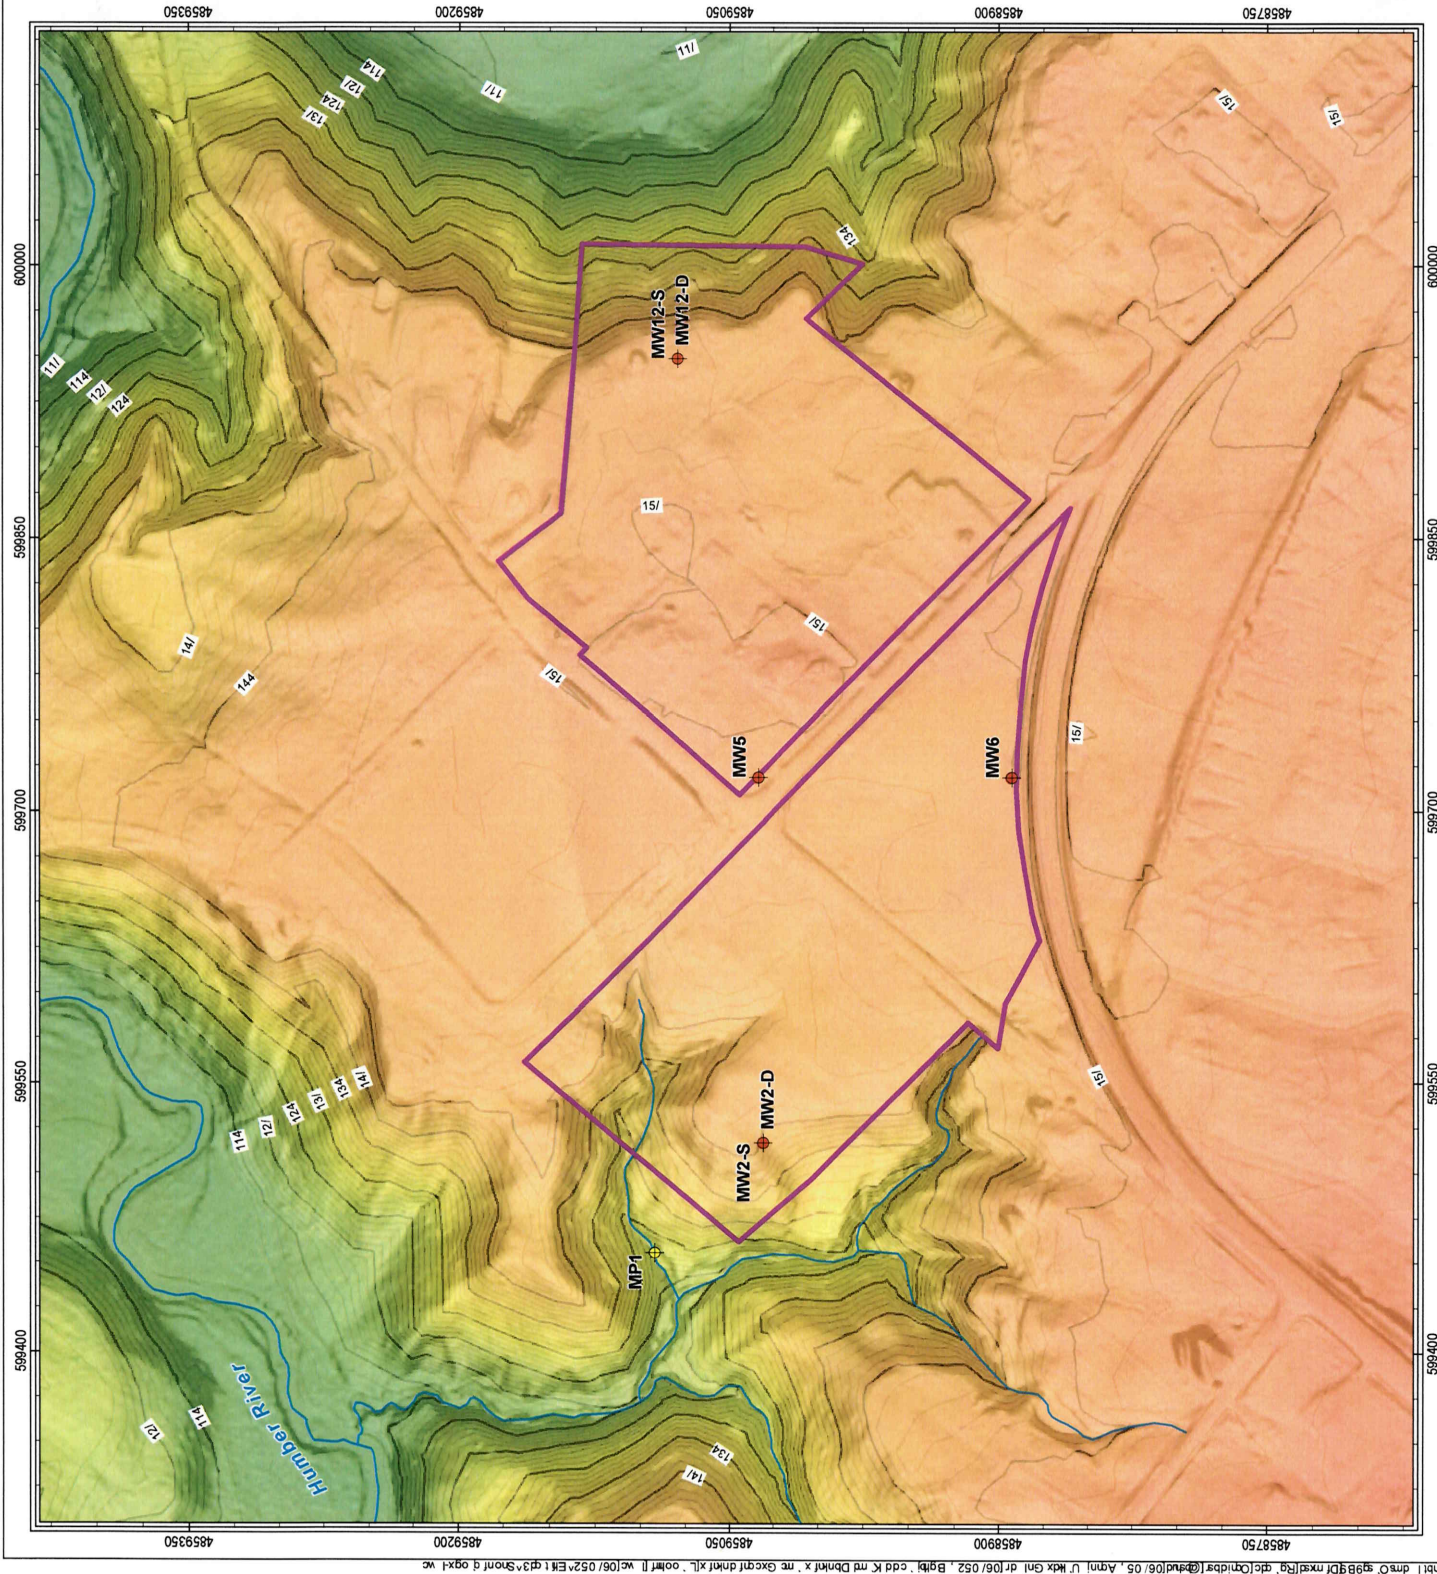

Legend

- ◆ L hnnOrdynl dsdq
- ◆ L nntndrf V dk
- V' sdqnt q d
- Bnnst q'0 l (
- Rd cx @t'

Elevation



CQG/ M8A- Dcdq
 BGDBJ DC9Q- QnHej
 CQNI DBS906/ 052
 C@D81 k00+1/ 07
 Data Sources: Ldtr hllshade provided by TRCA
 web map service.

Prepared by:



CLIENT: Aqni U' kdx Gnl dr
 PROJECT: Bglj, cdd K' ntd Dbnkl x
 nt Gxcqtl dntf x

Topography

FIGURE 5

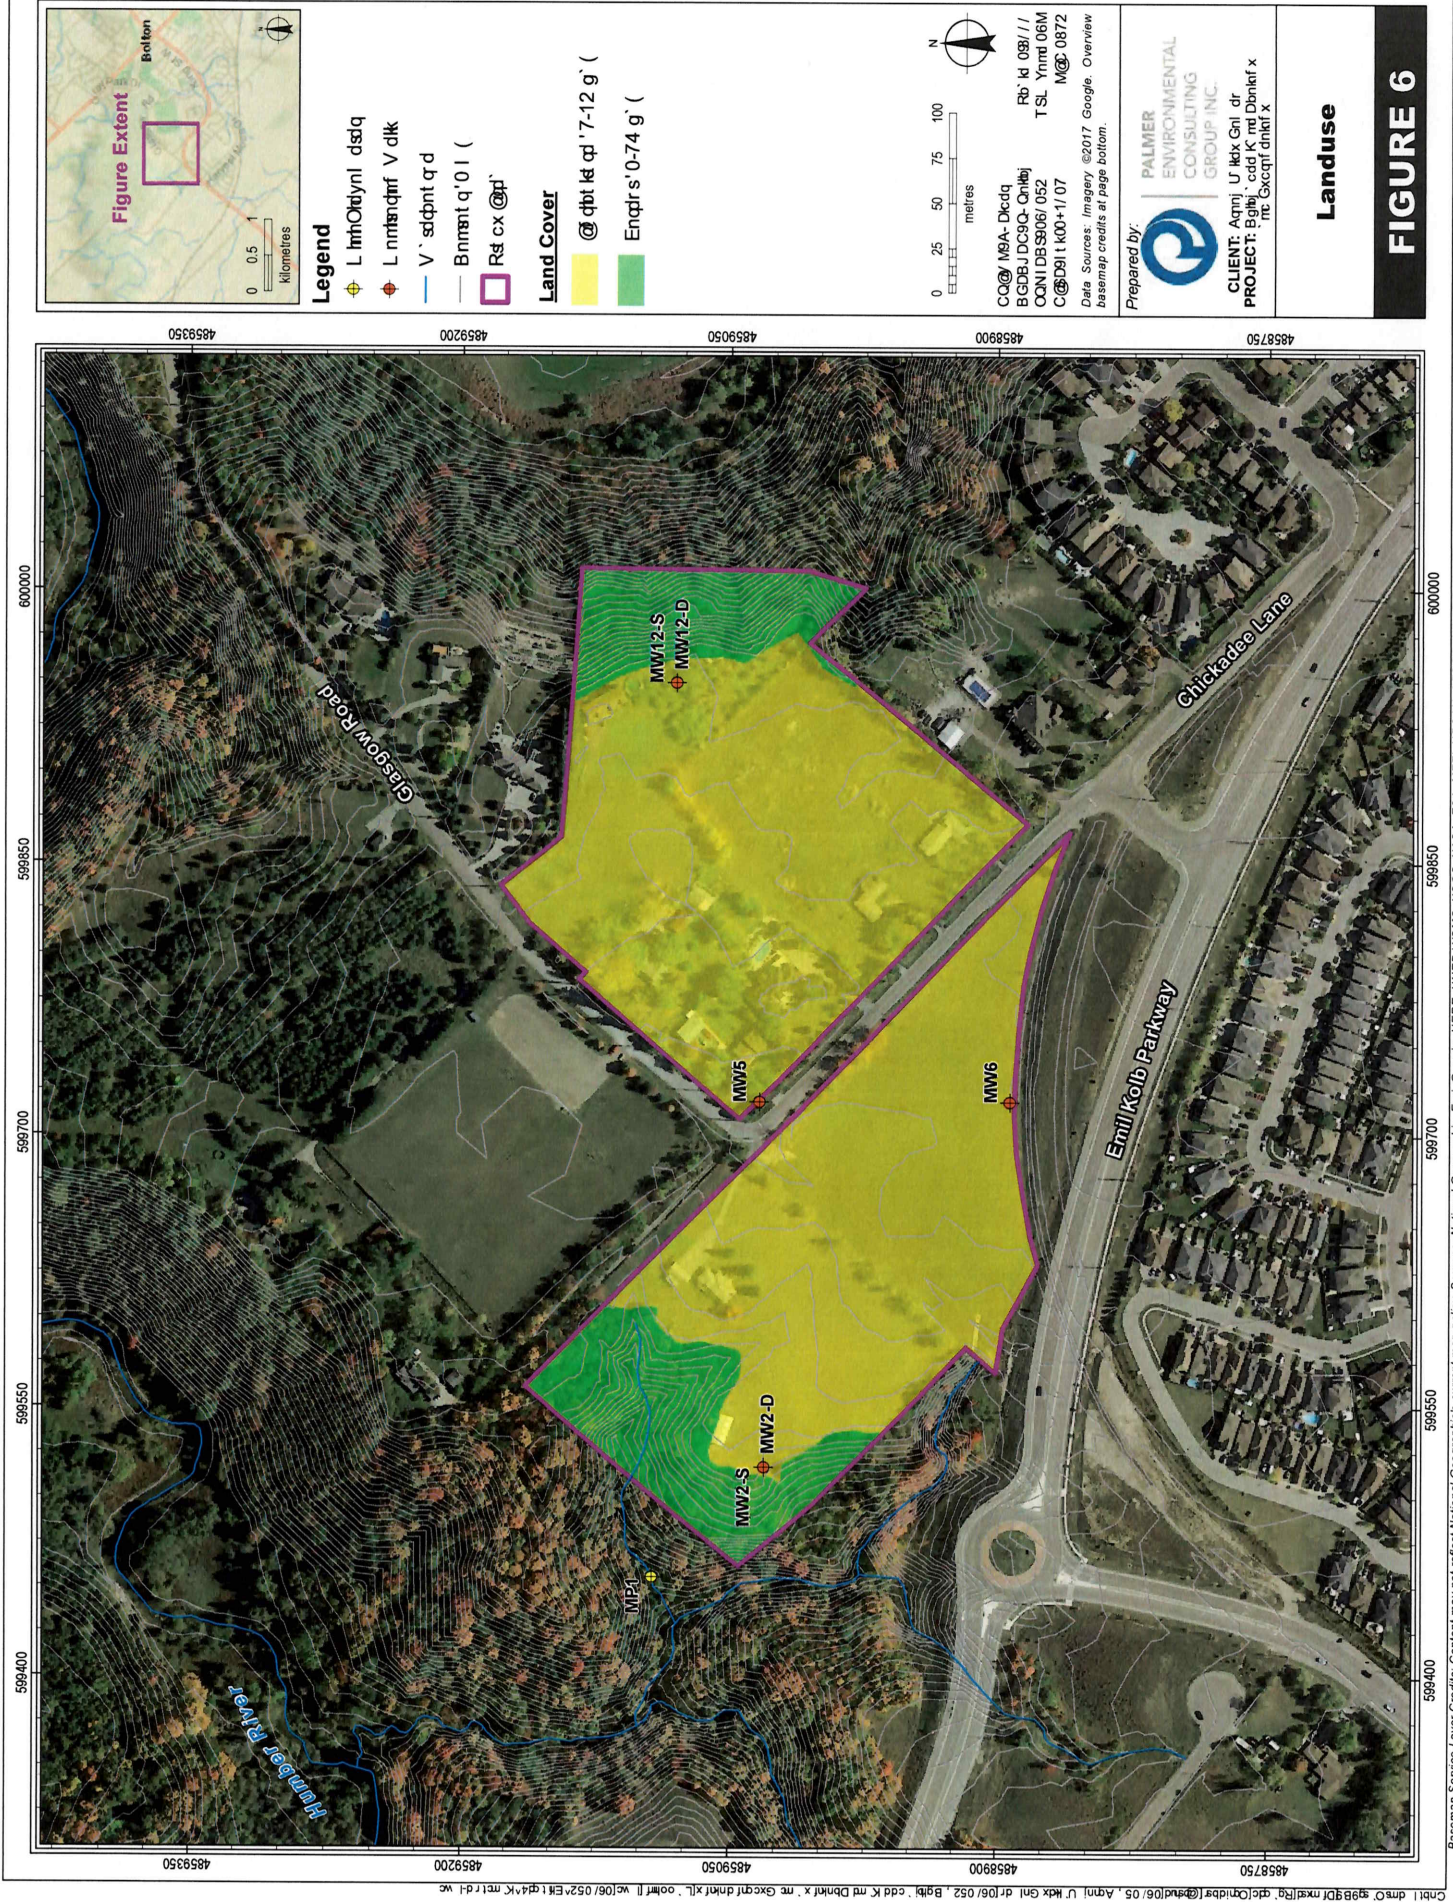


Figure Extent




Legend

- L mthOdylnl dsq
- L nrtndntf V dlk
- V' sdcpnt qrd
- Bnnt q'0 l (
- Rq cx @p'

Land Cover

- @ qbt kt q' 7-12 g' (
- Enqtrs 0-74 g' (



COO/ M9A- Dcdq
 BGDBJ DC9Q- OnHqj
 COOI DBS906/ 052
 C@D91 t K00+1/ 07
 Date Sources: Imagery ©2017 Google, Overview
 basemap credits at page bottom.

Prepared by:



CLIENT: Aqtnj U' kdx Gnl dr
 PROJECT: Bqlj - cdd K md Dbnkf x
 nrc Gxcqti dnkf x

Landuse

FIGURE 6

Copyright © 2017 Palmer Environmental Consulting Group Inc. All rights reserved. This map is a reproduction of a map prepared by Palmer Environmental Consulting Group Inc. for the purpose of the project described herein. It is not to be used for any other purpose without the written consent of Palmer Environmental Consulting Group Inc. The map is provided as a guide only and does not constitute a warranty or guarantee of accuracy. The map is subject to change without notice. The map is not to be used for any purpose other than the project described herein. The map is not to be used for any purpose other than the project described herein. The map is not to be used for any purpose other than the project described herein.

4.2 Pre-Development Water Balance Results

Based on 30-year climate normals, total precipitation at the site is approximately 786 mm/yr. This precipitation will either infiltrate through the unsaturated zone soils or be removed through evapotranspiration (ET). Actual ET (AET) is calculated based on potential evapotranspiration (PET) and soil-moisture storage withdrawal. Based on the Thornthwaite and Mather (1957) model, calculated AET for the Agricultural/Rural Residential and Forested land use areas is 499 mm/yr and 502 mm/yr, respectively (**Table 6**). These results are consistent with those reported by TRCA (2008-b) for the Humber River Watershed, which indicates a mean AET value of 525 mm/yr.

Monthly PET is estimated using monthly temperature data and is defined as water loss through evaporation or transpiration from a homogeneous vegetated area that does not lack water (Thornthwaite, 1948; Mather, 1978). Calculated PET for the total site area is 629 mm/yr (approximately 80% of total precipitation), while the soil moisture deficit is between 127 mm/yr (Forested) and 130 mm yr⁻¹ (Agricultural/Rural Residential).

Estimated water surplus within the site ranges from approximately 284 mm/yr (Forested; 36% of total precipitation) to 287 mm/yr (Agricultural; 37% of total precipitation) and is divided into two components: infiltration and runoff. Using the method outlined in the MOE SWM manual and MOEE (1995), approximately 70% (401.77 mm/yr) of the surplus runs off, while the remaining 30% (169.23 mm/yr) infiltrates. Over the entire site area (100,800 m²), this translates to approximately 9,363 m³/yr of infiltration, and approximately 19,719 m³/yr of runoff (**Table 7; Figures 7 & 8**). These values are consistent with the reported low permeability of the Halton Till combined with the very steep terrain bordering the northwest and northeast sections of the study area.

Table 6. Available Water Surplus Values by Pre-Development Land Use

Water Balance		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year
Precipitation (mm)		51.8	47.7	49.8	68.5	74.3	71.5	75.7	78.1	74.5	61.1	75.1	57.9	786
Temperature (°C)		-5.5	-4.5	0.1	7.1	13.1	18.6	21.5	20.6	16.2	9.5	3.7	-2.2	8.18
Potential Evapotranspiration (PET) (mm)		0	0	0.3	34.7	78.4	117.5	140.5	123.8	81.5	40.5	11.8	0	628.9
P – PET		52	48	50	34	-4	-46	-65	-46	-7	21	63	58	157
Forested Area (400 mm)	Change in Soil Moisture Storage	0	0	0	-34	-38	-31	-16	11	33	36	27	0	-12
	Soil Moisture Storage	400	400	400	366	328	297	281	292	325	361	388	400	-
	Actual Evapotranspiration (AET)	0	0	0	35	112	103	92	67	42	40	12	0	502
	Soil Moisture Deficit (mm)	0	0	0	0	-34	15	49	57	40	0	0	0	127
	Surplus (P – AET)	52	48	50	34	-38	-31	-16	11	33	21	63	58	283.6
Agricultural/Rural Residential Area (250 mm)	Change in Soil Moisture Storage	0	0	0	-33	-35	-26	-14	10	27	33	26	0	-12
	Soil Moisture Storage	250	250	250	217	182	156	142	152	179	212	238	250	-
	Actual Evapotranspiration (AET)	0	0	0	35	109	98	90	68	48	40	12	0	499
	Soil Moisture Deficit (mm)	0	0	0	0	-31	20	51	56	34	0	0	0	130
	Surplus (P – AET)	52	48	50	34	-35	-26	-14	10	27	21	63	58	286.6

Table 7. Summary of Pre-Development Water Balance Analysis

Land Use	Area (ha)	GIS-Based Infiltration (mm/yr)	GIS-Based Runoff (mm/yr)	GIS-Based Infiltration (m³/yr)	GIS-Based Runoff (m³/yr)
Agricultural/Rural Residential Area	8.23	96.64	190.36	8,007	15,771
Forested Area	1.85	72.59	211.41	1,356	3,948
Site Total	10.08	169.23	401.77	9,363	19,719

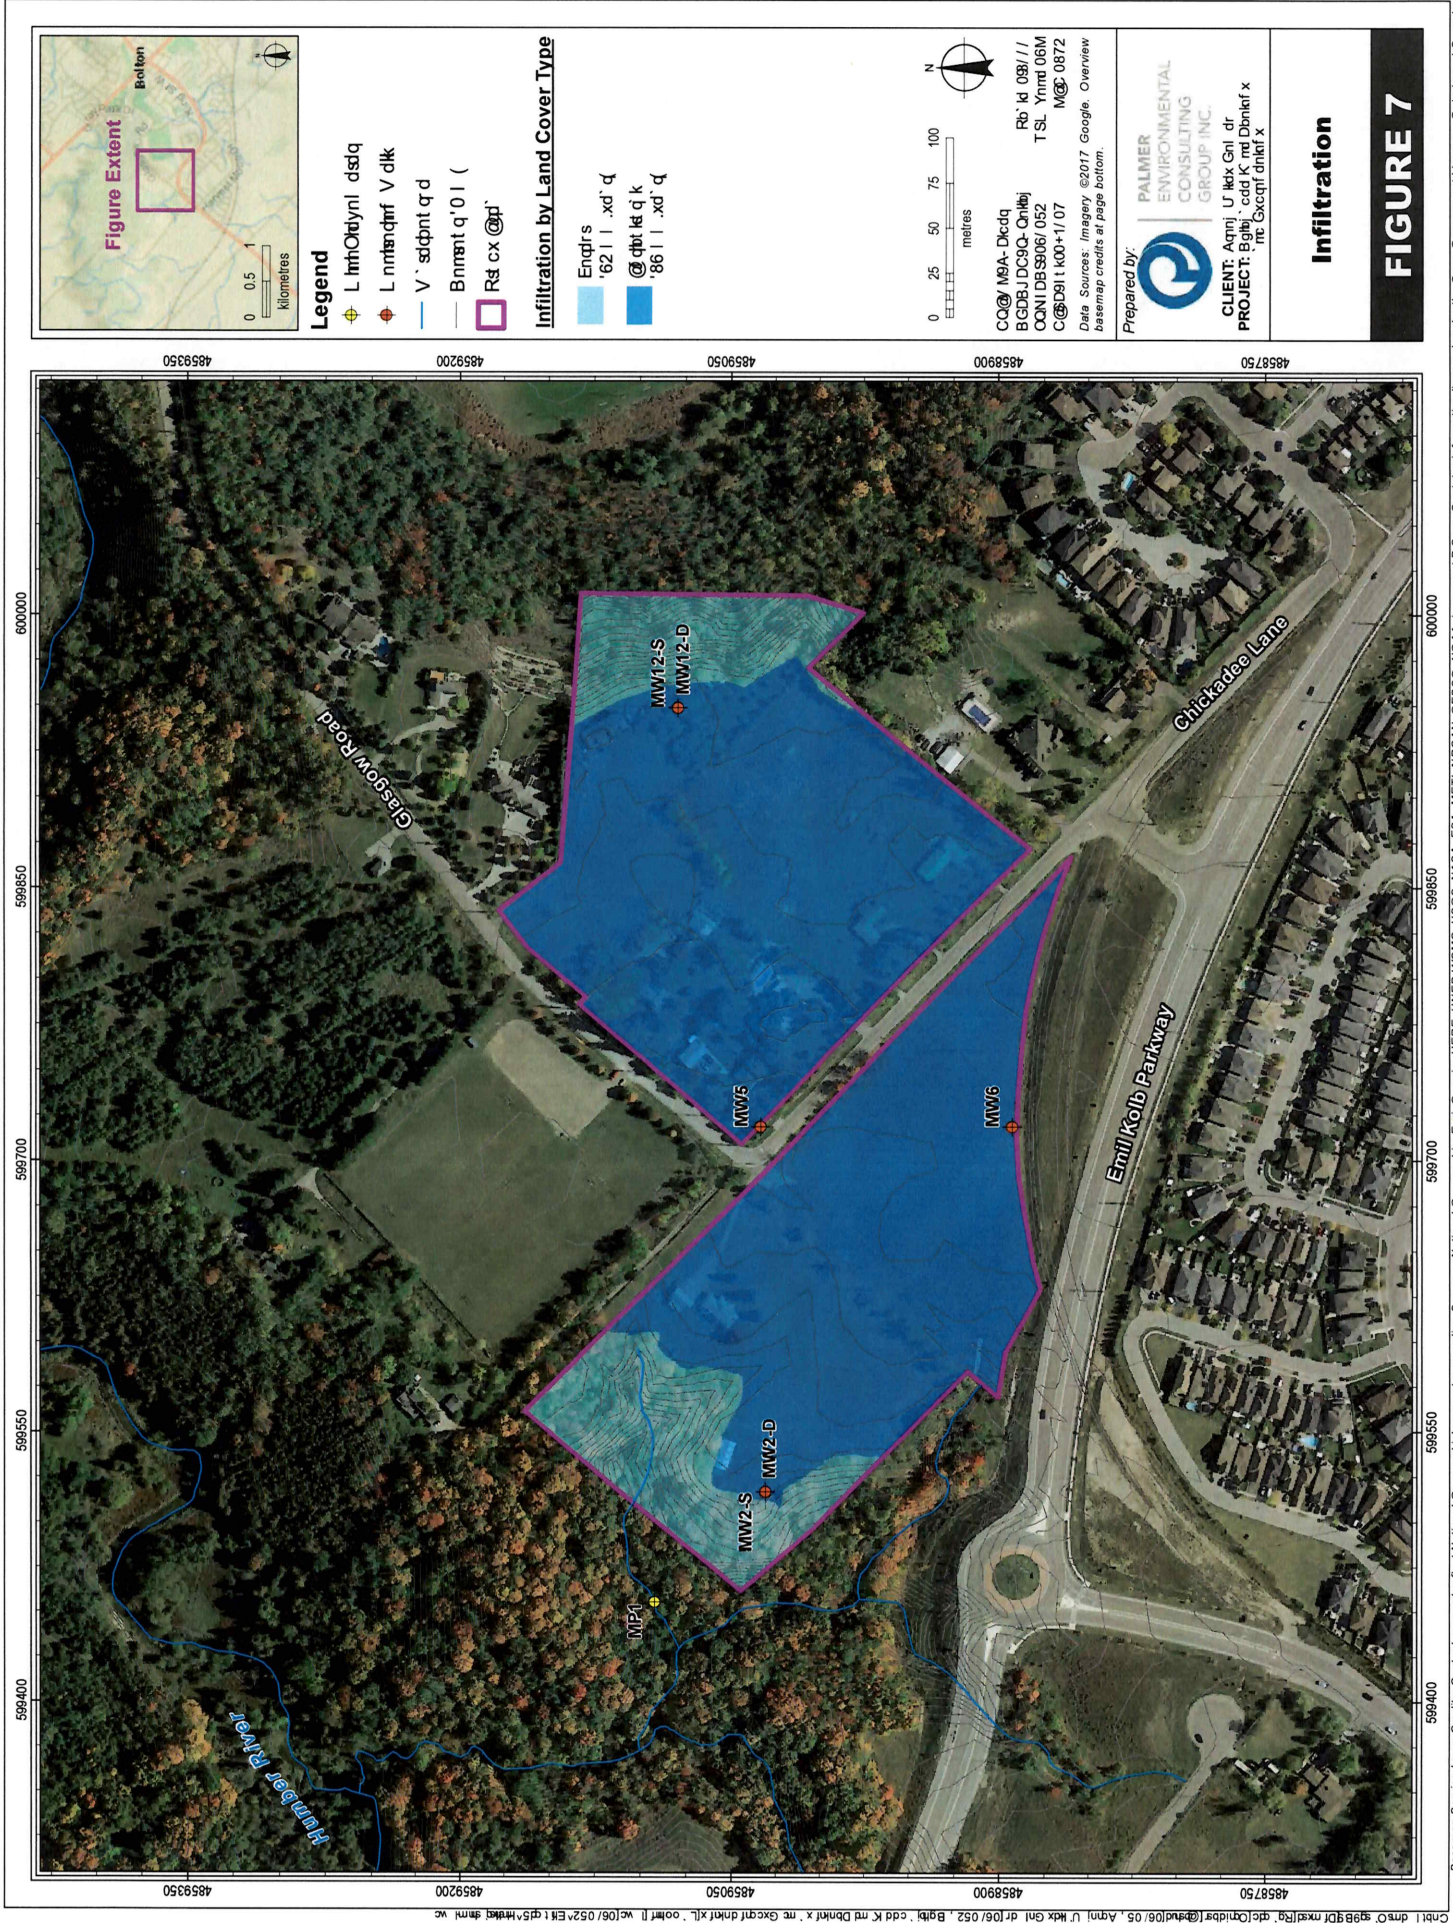


Figure Extent

Legend

- L hnnOtdynl dsdq
- L nntndrf V dlk
- V' sdqnt q d
- Bnnnt q' O l (
- Rd cx @ti

Infiltration by Land Cover Type

- Endrs '62 l l .xd' q
- @ qbt k q k '86 l l .xd' q



CQ@ M8A- Dkdq
 BGDBJ DC9Q- Qnllq
 CQNI DBS906/ 052
 C@D81 k00+1/ 07
 Data Sources: Imagery ©2017 Google, Overview
 basemap credits at page bottom.


Prepared by:



CLIENT: Aqnlj U kdx Gnl dr
 PROJECT: Bglqj cdd K md Dbnrl x
 int Gxcqtl dnlrl x

Infiltration

FIGURE 7




Legend

- ◆ L mthOtynl dslq
- ◆ L nntandrt V dlk
- V ' sdpt q d
- Bmnt q'01 (
- Rd cx @p'

Runoff by Land Cover Type

- @ dht k q k
- '08/ | | .xd' q
- Enfr's
- '100 | | .xd' q



CO@ MBA- Dcdq
BGDBJ DC9C- QnlbJ
CONIDB S906/052
C@911 K00+1/07
Data Sources: Imagery ©2017 Google, Overview
basemap credits at page bottom.

Prepared by:



CLIENT: AgnJ U' Mdx Gnl dr
PROJECT: Bqbtj ' cdd K' mt Dbnkf x
mc Gxcqnf dnkf x

FIGURE 8

5. Development Considerations

5.1 LID Considerations

The use of Low Impact Development (LID) measures are recommended as part of the overall stormwater management plan to help achieve at least 5 mm of stormwater retention and minimize changes to the existing water budget. As stated in *Low Impact Development Stormwater Management Planning and Design Guide Version 1.0* (2010) by CVC and TRCA,

“Developing stormwater management plans requires an understanding of the depth to water table, depth to bedrock, native soil infiltration rates, estimated annual groundwater recharge rates, locations of significant groundwater recharge and discharge, groundwater flow patterns and the characteristics of the aquifers and aquitards that underlay the area” (TRCA and CVC, 2010).

For sites with deep water table conditions and high permeability soils, LID practices can significantly improve infiltration and groundwater recharge to maintain the groundwater characteristics of the underlying aquifer. Conversely, for sites with low permeability soils and high-water table conditions, the amount of infiltration is limited by the saturated hydraulic conductivity of the soil (i.e., the rate at which water can infiltrate). Based on our understanding of site geology and groundwater conditions, it is expected that there is sufficient depth to the water table east of Blocks 17 to 20 and Blocks 9 to 14 (Street Townhouses). Additionally, this assumption assumes site grading following development remains the same as pre-development. It is possible that sufficient depth to the water table is achieved through the addition of at least 1 m of fill, particularly near the region of higher water table conditions located near the groundwater divide (**Figure 3**). This will assist in accounting for the apparent perched water table resulting from poor percolation through surficial material into the deeper actual water table at depths of 5 – 8 mbgs.

The surficial materials generally consist of low permeability silt and clay (10^{-8} m/s) therefore LID measures need to take this into consideration. Infiltration trenches, vegetated swales and bioretention areas can all be effective in low permeability soils to increase infiltration. Increasing topsoil depth can also be effective. It is recommended that site grading and rear yard grading should be directed to the tributaries of the Humber River and the associated supporting areas to maintain the water balance, where applicable. It is recommended that site-specific investigations to confirm site geology, groundwater conditions, and in-situ soil permeability are completed to assess the feasibility of infiltration LIDs.

5.2 Source Water Protection

The Clean Water Act (2006) classifies the hydrogeological vulnerability of areas into categories such as Significant Groundwater Recharge Areas (SGRA), Highly Vulnerable Aquifer (HVA), and Wellhead Protection Areas (WHPA). Based on available Source Water Protection Information Mapping compiled by the MECP, the site is not considered to be within a HVA or WHPA. A small portion of the site area that corresponds with Lot 27 (Existing Residential) of the concept plan is characterized as a SGRA with a low vulnerability score of 2. Based on the 2017 Tables of Drinking Water Threats for Pathogens and

Chemicals, no activities in these areas have been identified that could pose a threat to groundwater under various circumstances.

In addition, ecological studies completed by PEEG did not identify any groundwater supported natural features (i.e., groundwater supported wetlands and watercourses) on or near the site. It is expected that vertical groundwater movement is restricted at the site due to the presence of the thick silty clay Halton Till aquitard unit (approximately 40 m thick, **Section 3.1.2**). The low permeability of the till (geometric mean $K = 6.1 \times 10^{-7}$ m/s, **Section 3.4**) greatly limits groundwater recharge and contaminant migration.

5.3 Permit To Take Water (PTTW)

Under the new EASR system, water takings that are greater than 50,000 L/day but less than 400,000 L/day do not require a Permit to Take Water (PTTW) from the Ministry of the Environment and Climate Change (MOECC), however the project must be registered on the EASR and meet a series of environmental protection criteria. Based on the low permeability and consistency of the Halton Till aquitard at the site, a PTTW is not expected to be required for construction dewatering.

6. Summary and Conclusions

The following summarizes the key results of the Hydrogeological Investigation and Water Balance Analyses conducted for the Chickadee Lane Rounding Out Area B Land Development:

- The Chickadee Lane study area lies within the South Slope physiographic region, characterized by silty clay loam sediments of the Halton Till. This was confirmed through OGS mapping of the site and borehole drilling results. On a regional scale the Halton Till acts as an unconfined aquitard, limiting groundwater recharge and discharge.
- Based on the single well response tests conducted in the monitoring wells (MW2-S/D, MW5, MW6, and MW12-S/D), the calculated geometric mean hydraulic conductivity value of the silty clay till is 6.1×10^{-7} m/s.
- Groundwater quality is considered typical for the area and shows an exceedance in PWQO criteria for total iron and total aluminum related to high TSS in the groundwater sample.
- Based on groundwater monitoring, shallow groundwater levels at the site are expected to be encountered between 0.12 mbgs to 8.71 mbgs, and deep groundwater levels range from 11.35 mbgs to 29.12 mbgs. A groundwater flow divide is present running southeast to northwest through the center of the site, such that groundwater flow east of the divide flows northeast, and west of the divide flows northwest.
- One drive-point piezometer (MP1) was installed within the watercourse in the northwest corner of the site. Based on monitoring in April and May 2018, surface water flow was present within the feature, and there was a mean downward vertical hydraulic gradient within the MP (-0.45 m/m). In June, July, and August 2018 surface water flow was absent. The lack of surface water flow in late season, combined with the downwards hydraulic gradient indicates this feature is predominantly runoff supported.
- A water balance was completed for the site under both pre- and post-development scenarios. Results of these analyses showed that under pre-development conditions, approximately 9,363 m³/yr of the annual surplus infiltrates the soils, and 19,719 m³/yr becomes runoff. Following development and assuming no LID mitigation measures are implemented, a decrease in infiltration by approximately 5,179 m³/yr (-55%) and an increase in runoff by approximately 27,385 m³/yr (+139%) across the site is expected.
- The use of LID is recommended to increase infiltration post-development. Based on the site geology, depth to water table and proposed development plan, rear yard infiltration trenches are expected to be effective to support infiltration.

7. Signatures

This report was prepared and reviewed by the undersigned:

Prepared By:



Ryan Rolick, M.Sc., GIT
Environmental Scientist

Reviewed By:



Jason Cole, M.Sc., P.Geo.
Principal, Senior Hydrogeologist

8. References

- Chapman, L.J. and D.F. Putnam. 1984. Physiography of Southern Ontario. Ontario Geological Survey, Special Volume 2: 270 p.
- Fisheries and Oceans Canada (DFO). 2017. Aquatic Species at Risk Maps: Ontario South West Map 11. (<http://www.dfo-mpo.gc.ca/species-especies/fpp-ppp/onsw-soon-11-eng.htm>).
- Kassenaar, J. D. C. and E. J. Wexler. 2006. Groundwater Modelling of the Oak Ridges Moraine Area. (YPDT-CAMC Technical Report No. 01-06).
- Mather, J.R., 1978. The climatic water budget in environmental analysis. Farnborough, Hants: Teakfield. xxi + 239 p.
- Ministry of the Environment and Energy (MOEE), 1995. Technical Information Requirements of Land Development Applications.
- Thornthwaite, C.W., 1948. An approach toward a rational classification of climate. Geographical Review, Volume 38. 55-94 p.
- Thornthwaite, C.W. and J.R. Mather, 1957. Instructions and tables for computing potential evapotranspiration and water balance. Drexel Institute of Technology, Laboratory of Climatology. Publications in Climatology, Volume X. No. 3, 311p.
- Toronto and Region Conservation Authority (TRCA). 2008-a. Humber River: State of the Watershed Report.
- Toronto and Region Conservation Authority (TRCA). 2008-b. Humber River Watershed: Scenario Modelling and Analysis Report.



PALMER
ENVIRONMENTAL
CONSULTING
GROUP INC.

Appendix A

Chickadee Lane Rounding Out Area B Concept Plan (HPG, 2018)



PALMER
ENVIRONMENTAL
CONSULTING
GROUP INC.


Appendix B

Borehole Logs

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 1


FIGURE NO.: 1

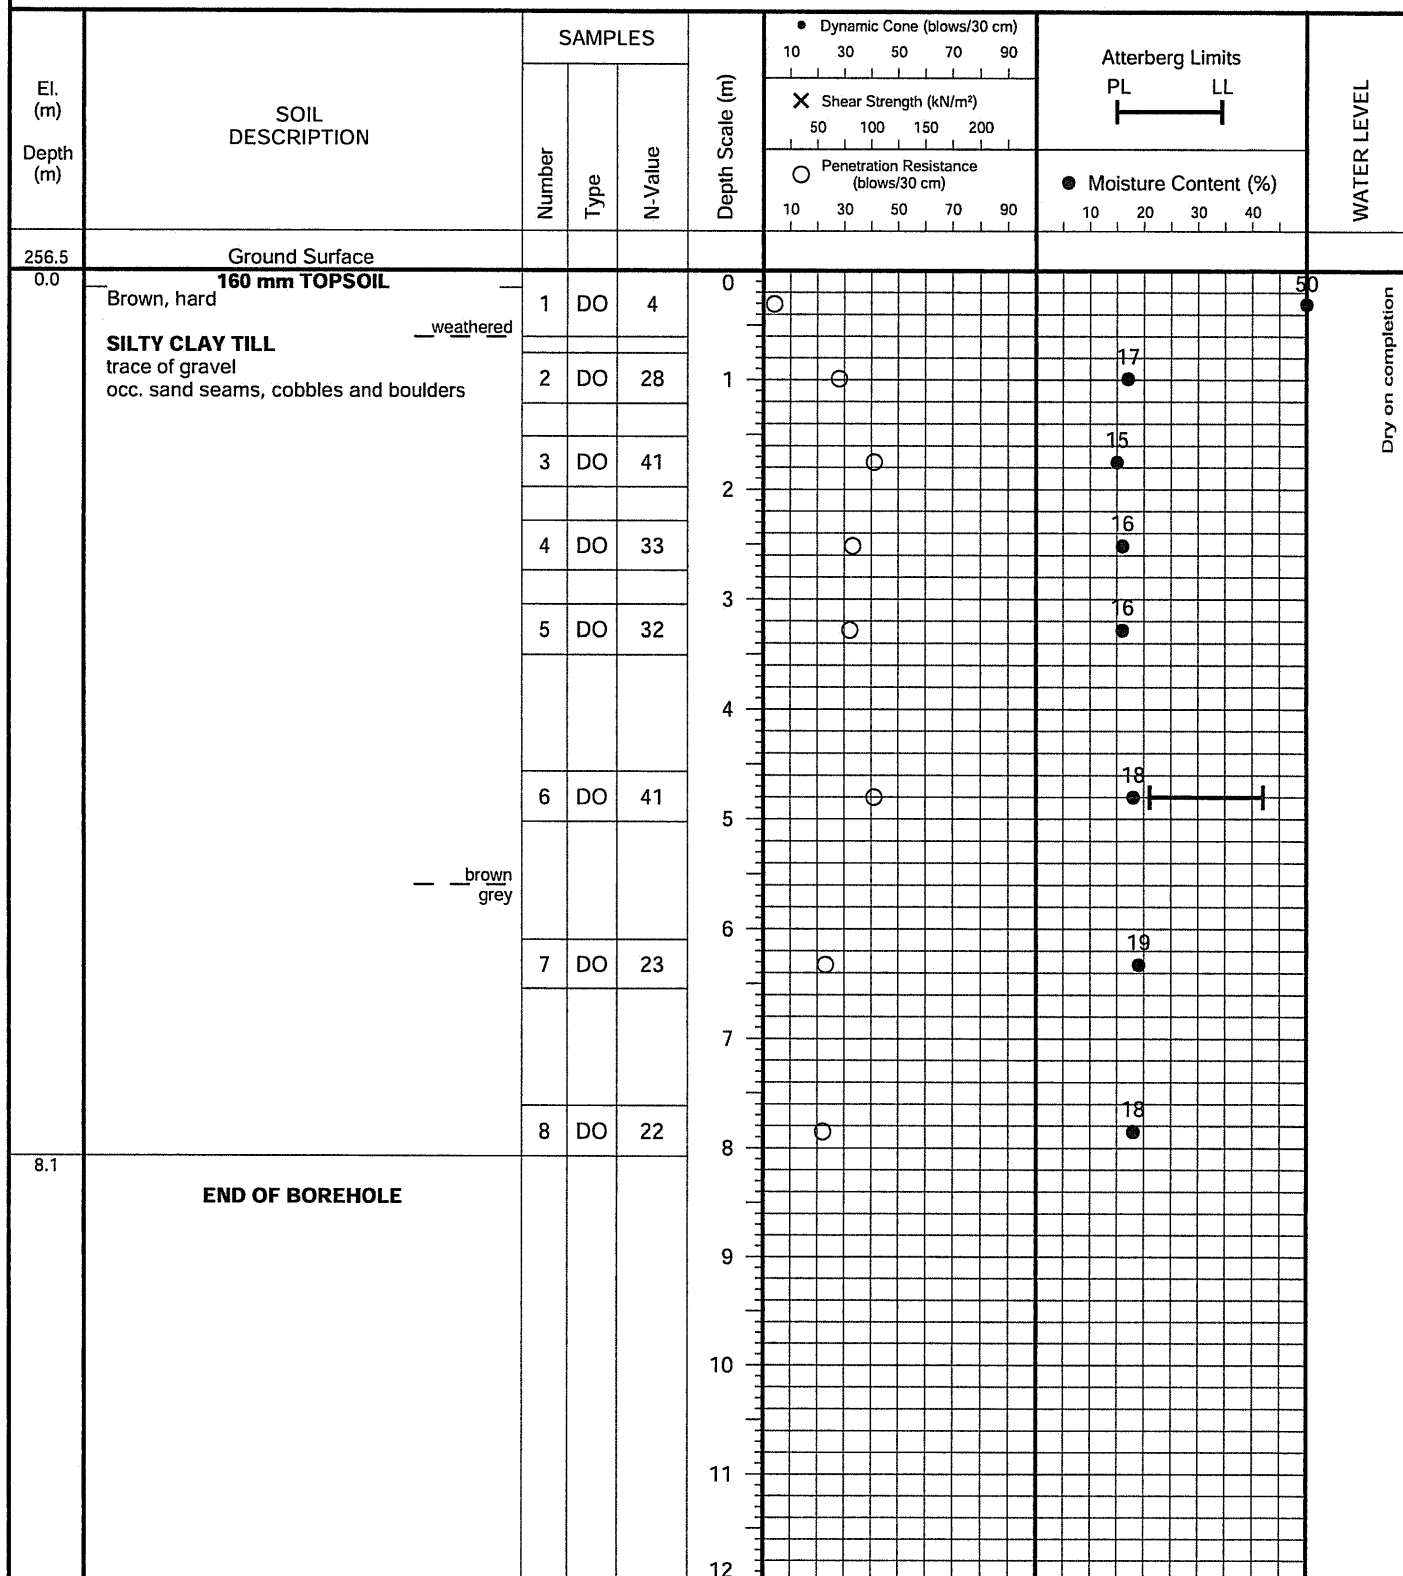PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 2


FIGURE NO.: 2

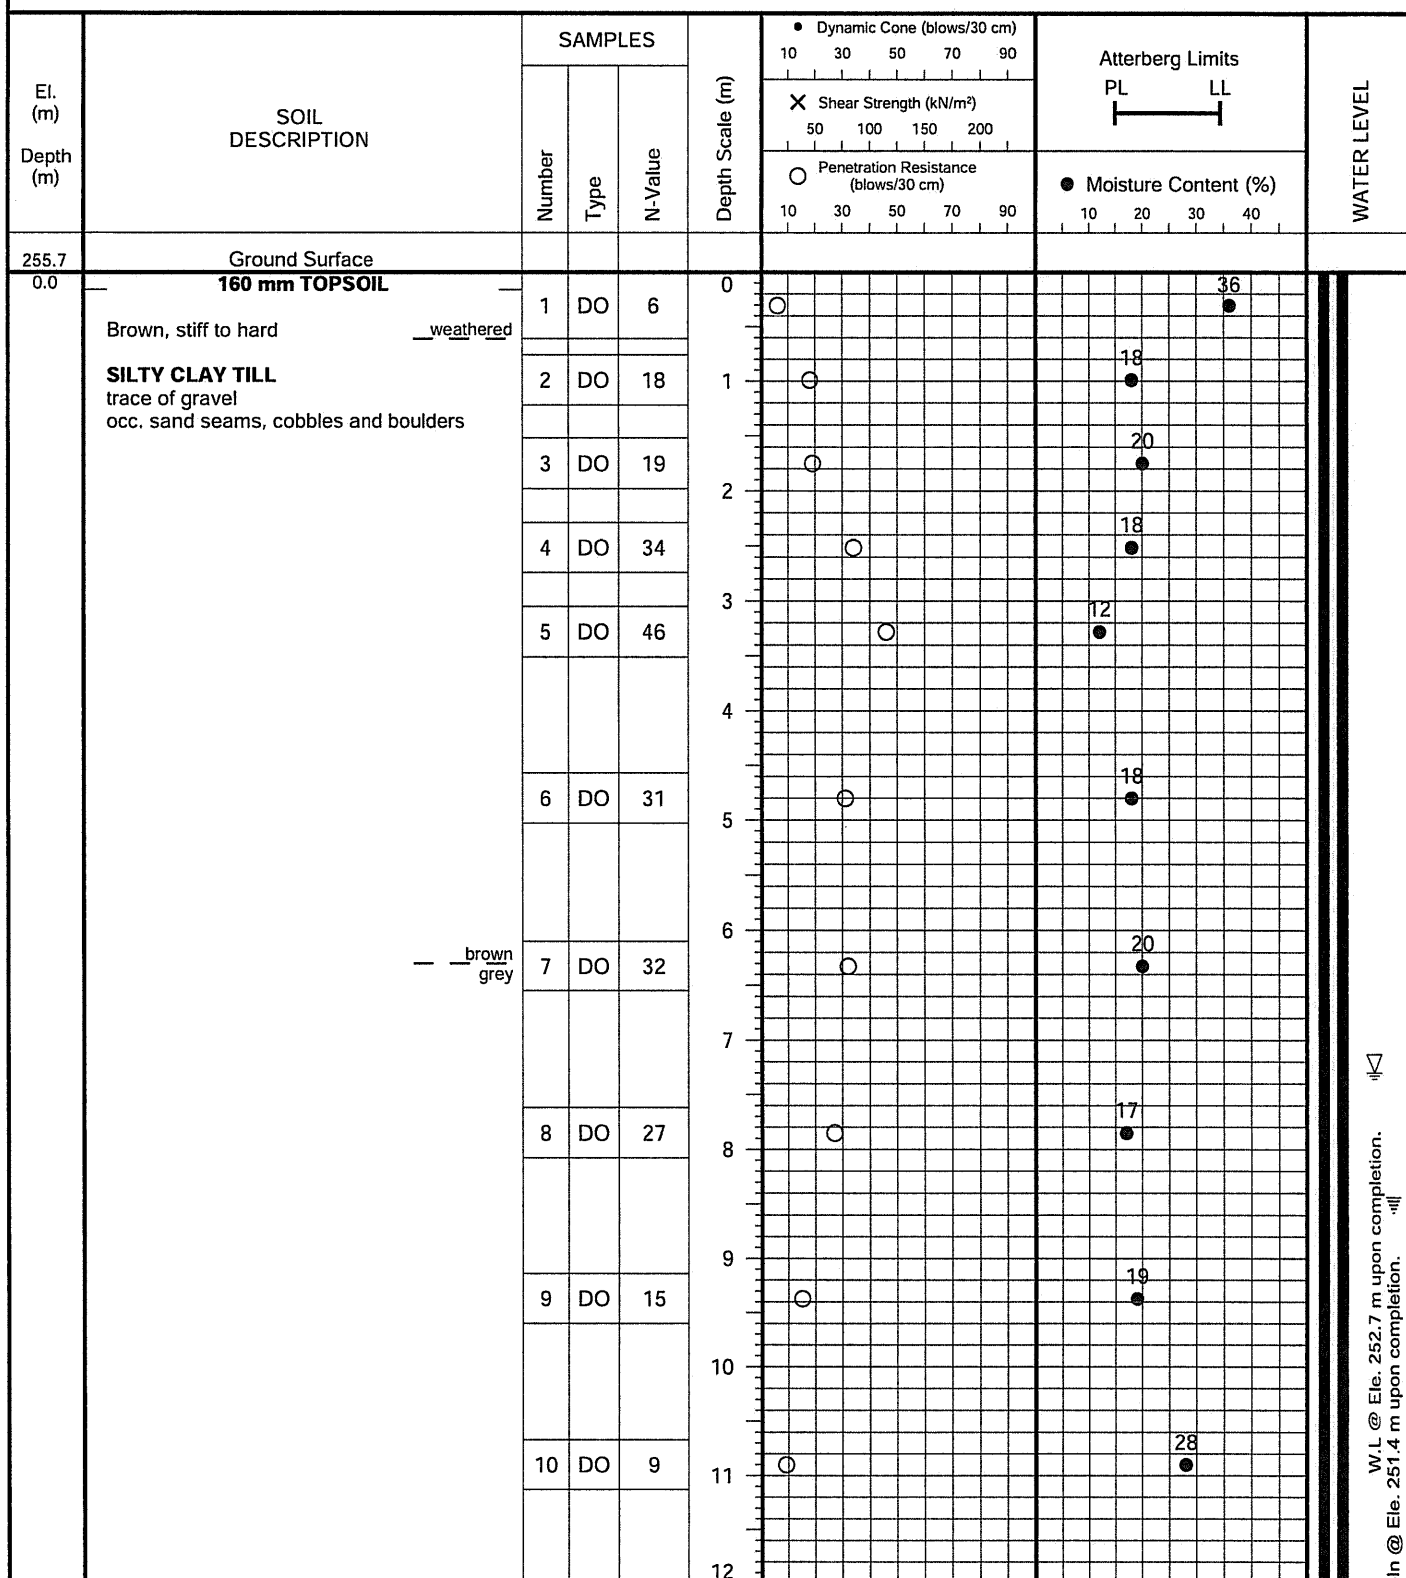PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 2

FIGURE NO.: 2

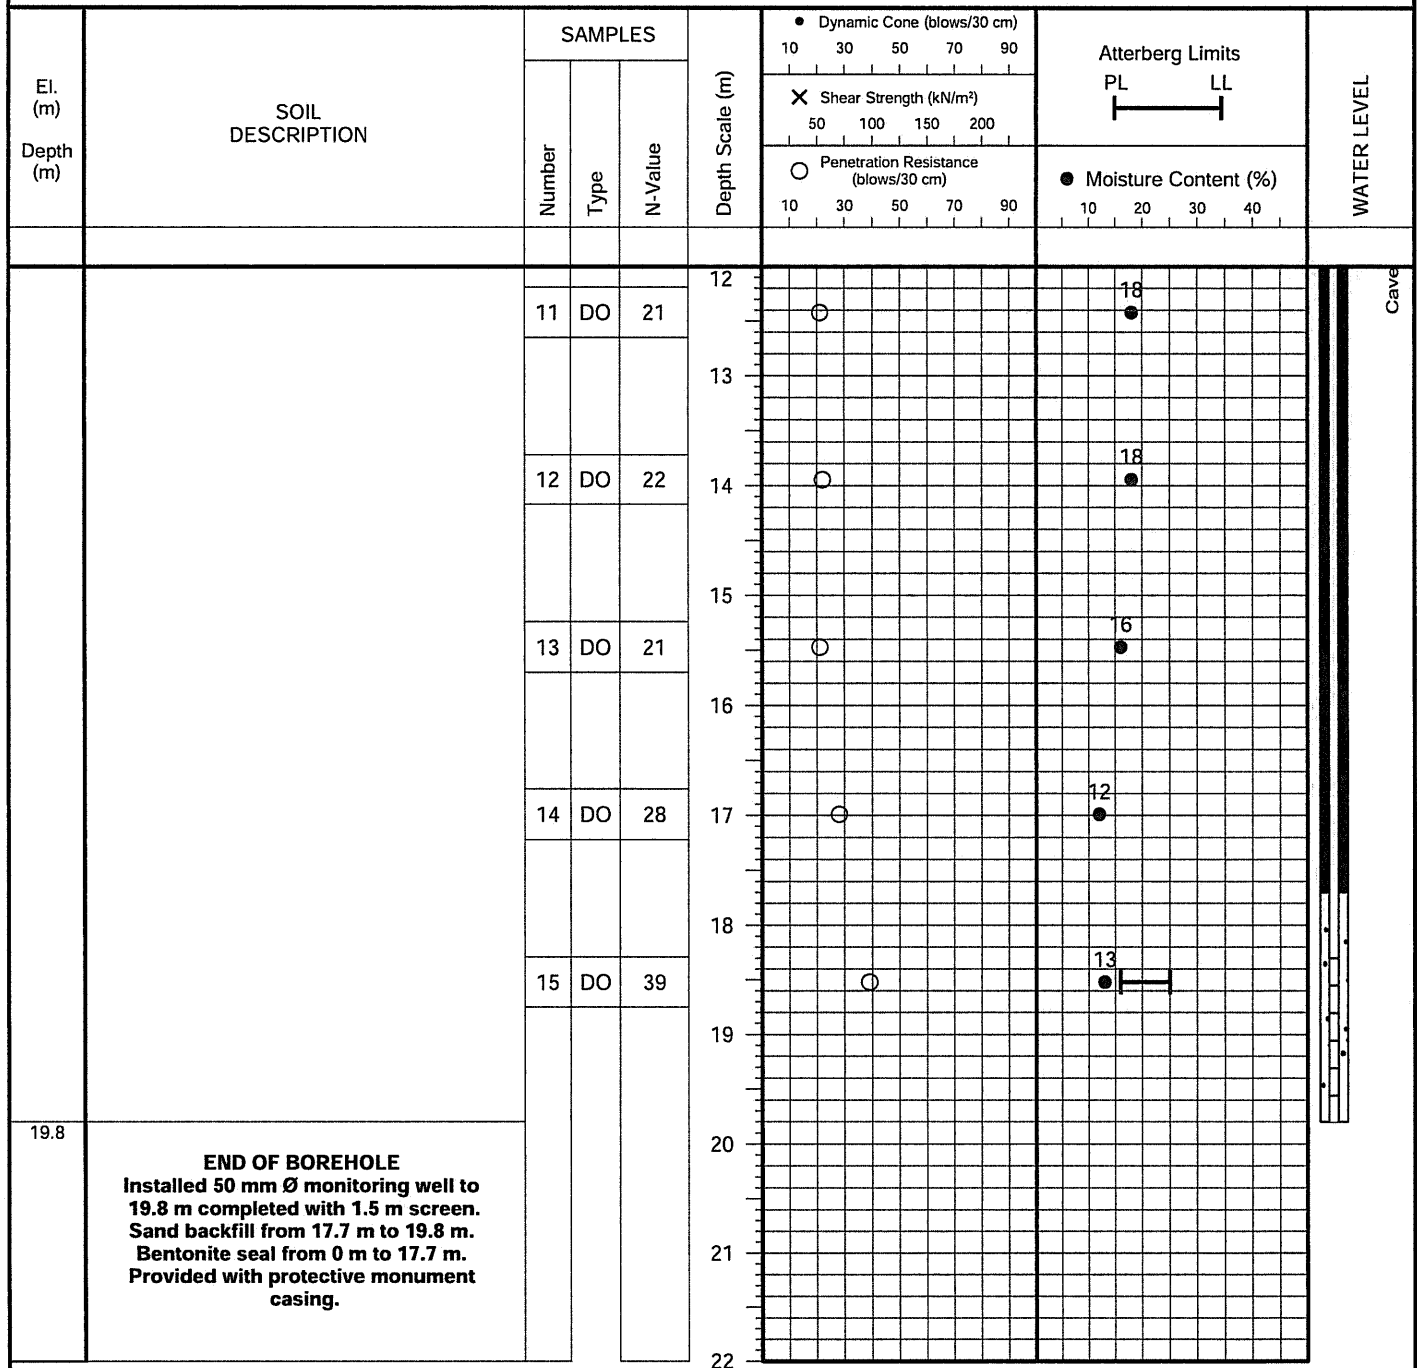PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 2N

FIGURE NO.: 2

PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018

El. (m)	Depth (m)	SOIL DESCRIPTION	SAMPLES			Depth Scale (m)	Dynamic Cone (blows/30 cm)		Atterberg Limits		WATER LEVEL
			Number	Type	N-Value		10 30 50 70 90	50 100 150 200	PL LL	Moisture Content (%)	
255.7	0.0	Ground Surface				0					
		Direct Auger to Water Table to Install Nested Monitoring Well				1					
						2					
						3					
						4					
						5					
						6					
						7					
7.6		END OF BOREHOLE Installed 50 mm Ø monitoring well to 7.6 m completed with 1.5 m screen. Sand backfill from 5.5 m to 7.6 m. Bentonite seal from 0 m to 5.5 m. Provided with protective monument casing.				8					
						9					
						10					
						11					
						12					


W.L. @ Ele. 252.7 m upon completion.
Cave-In @ Ele. 251.4 m upon completion.

**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 3


FIGURE NO.: 3

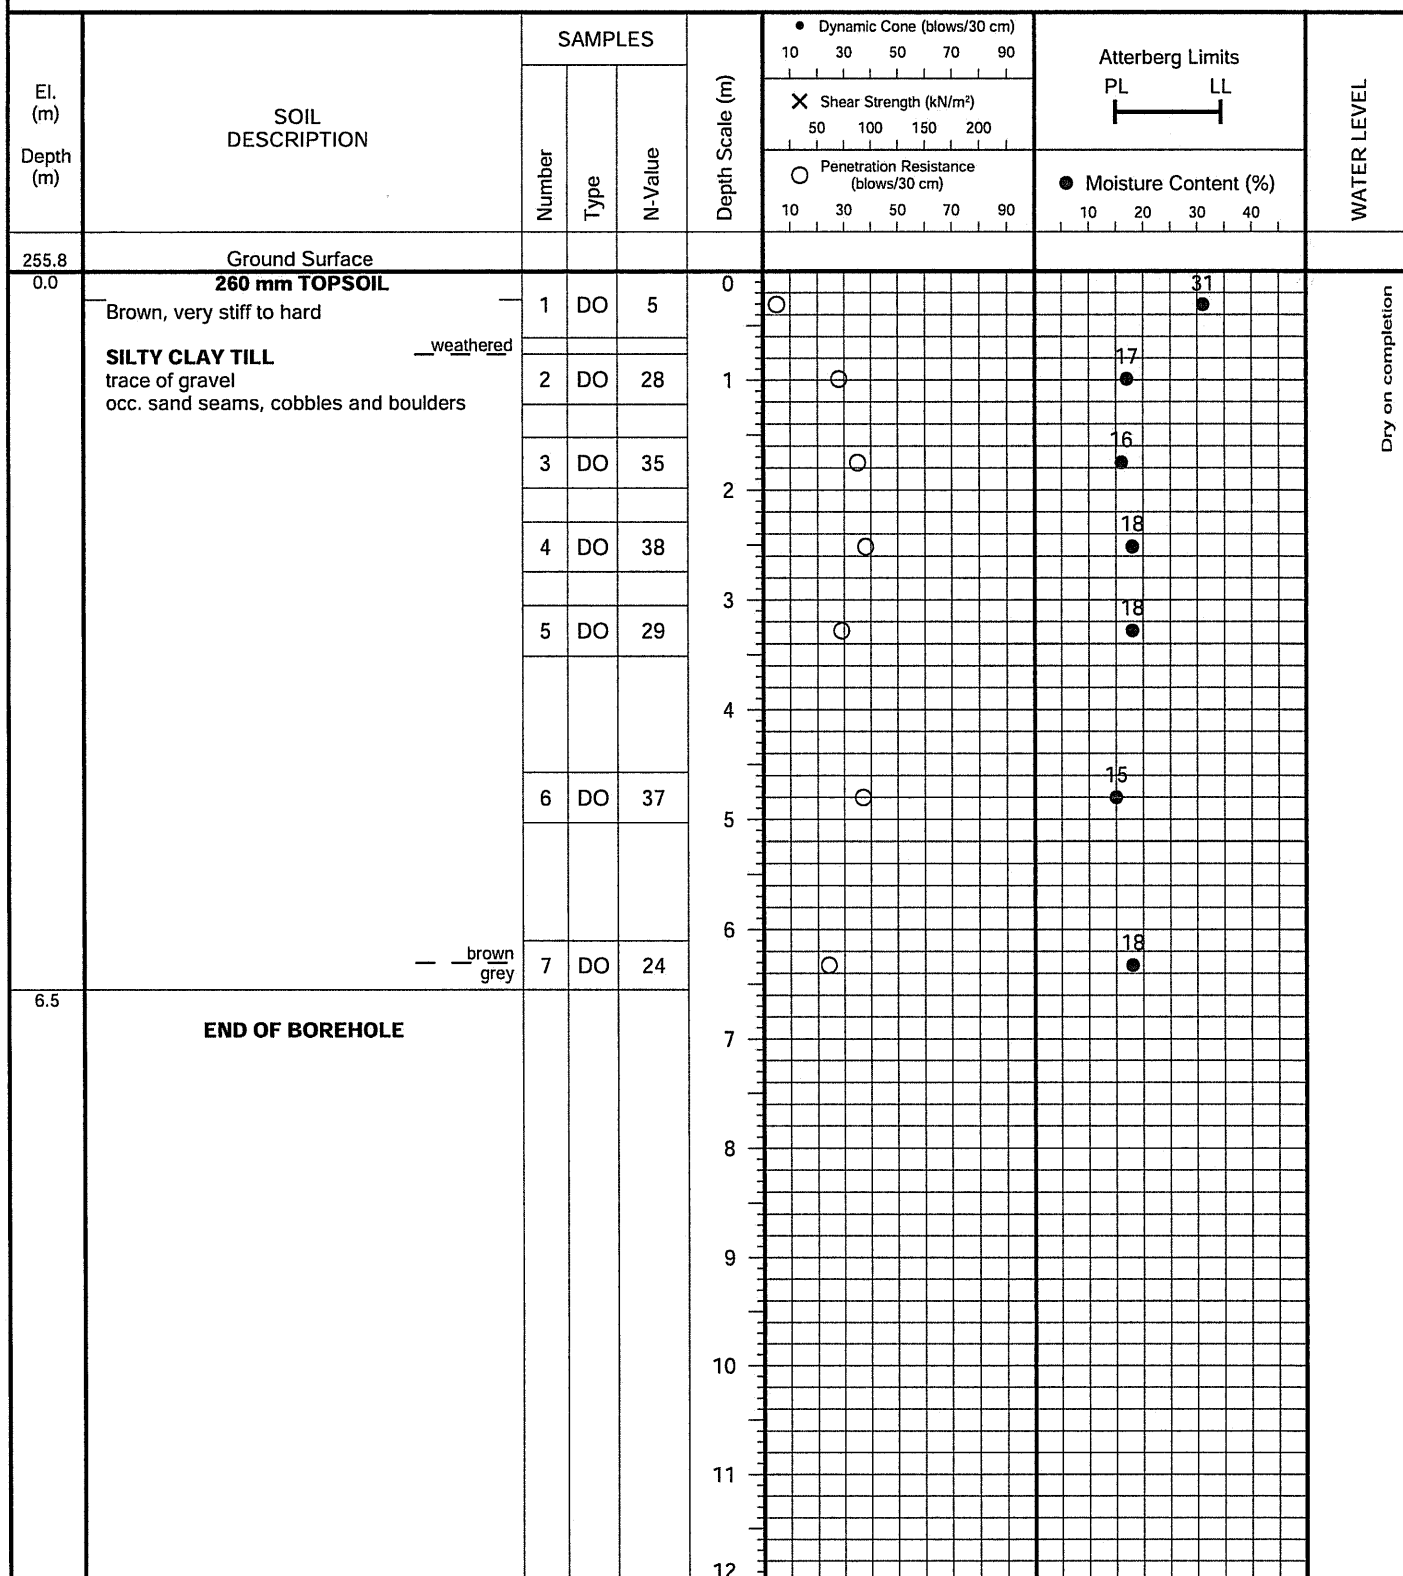PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 26, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 4


FIGURE NO.: 4

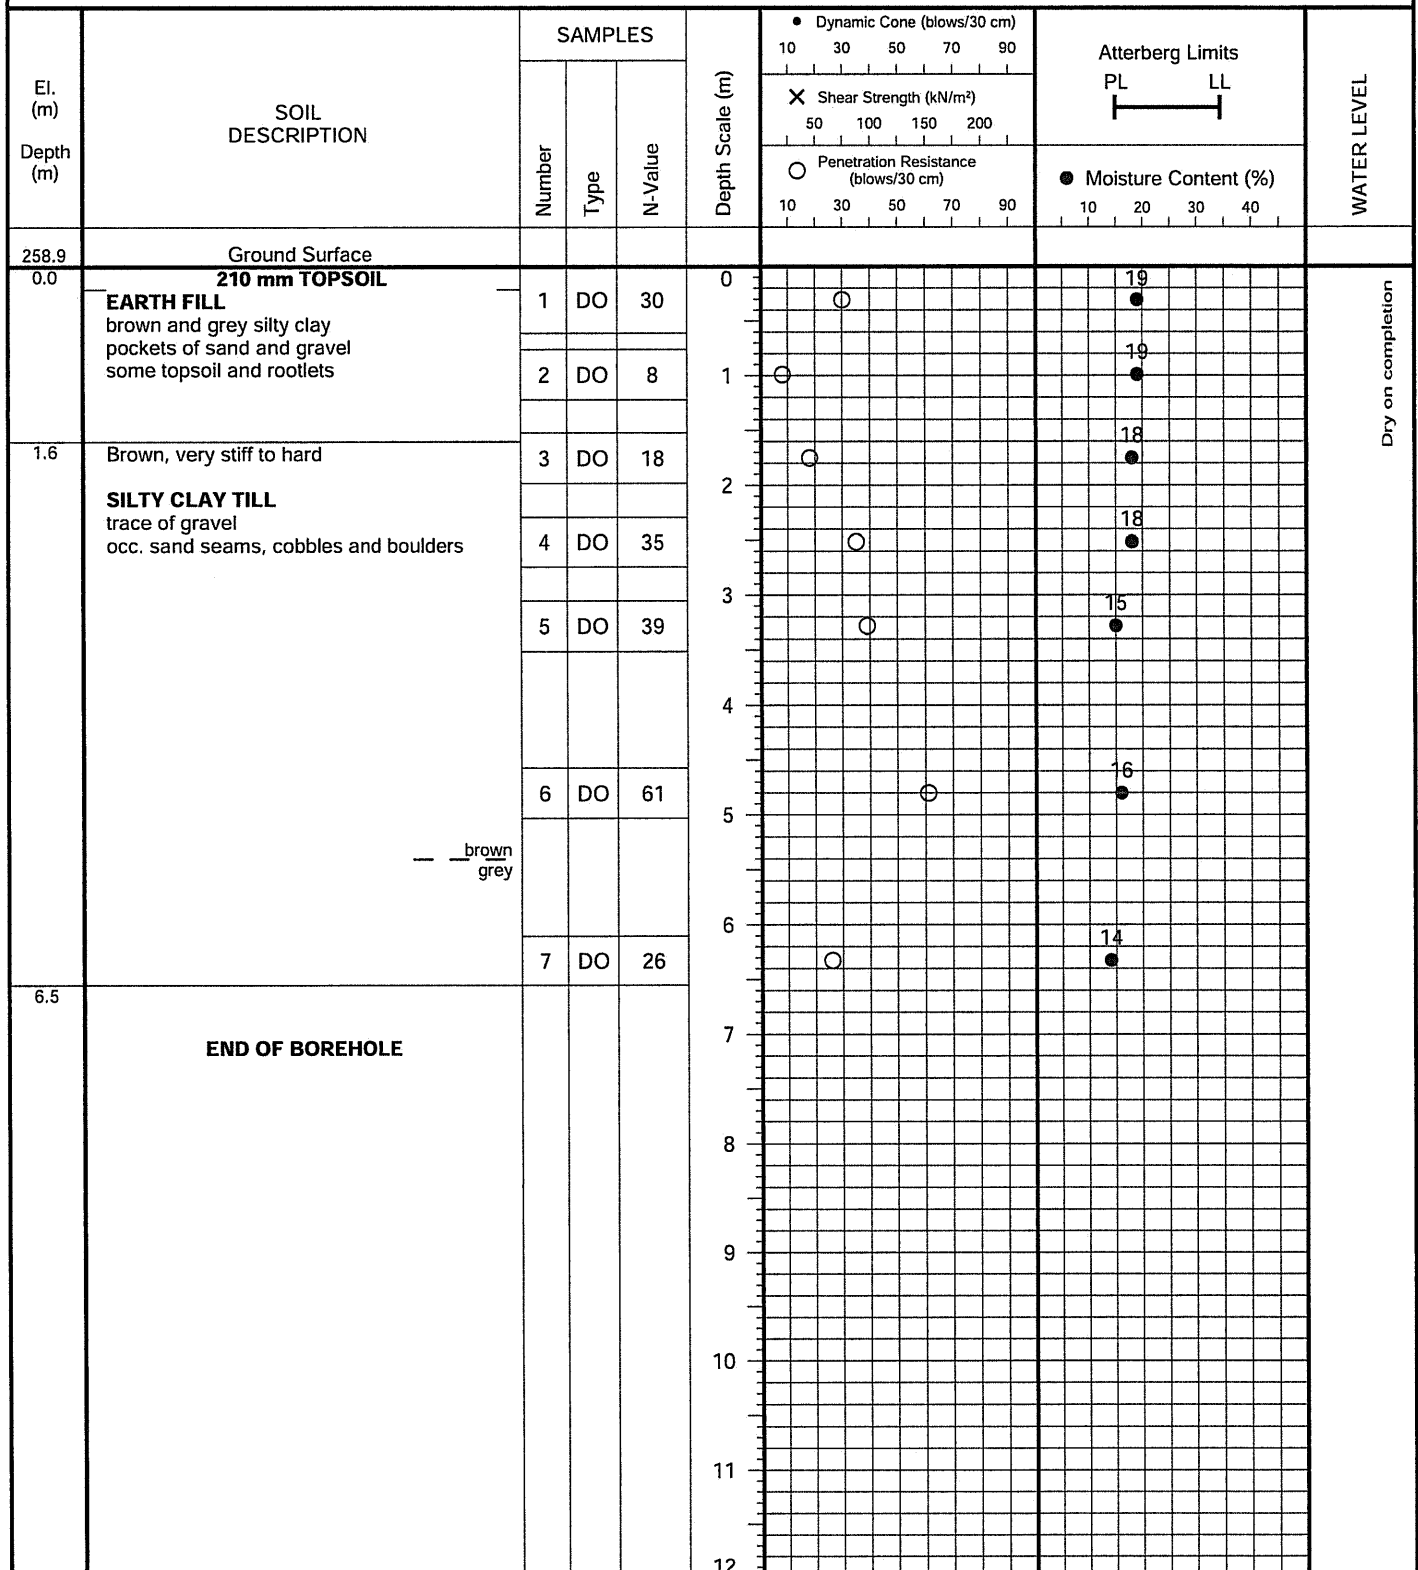PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 29, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 5


FIGURE NO.: 5

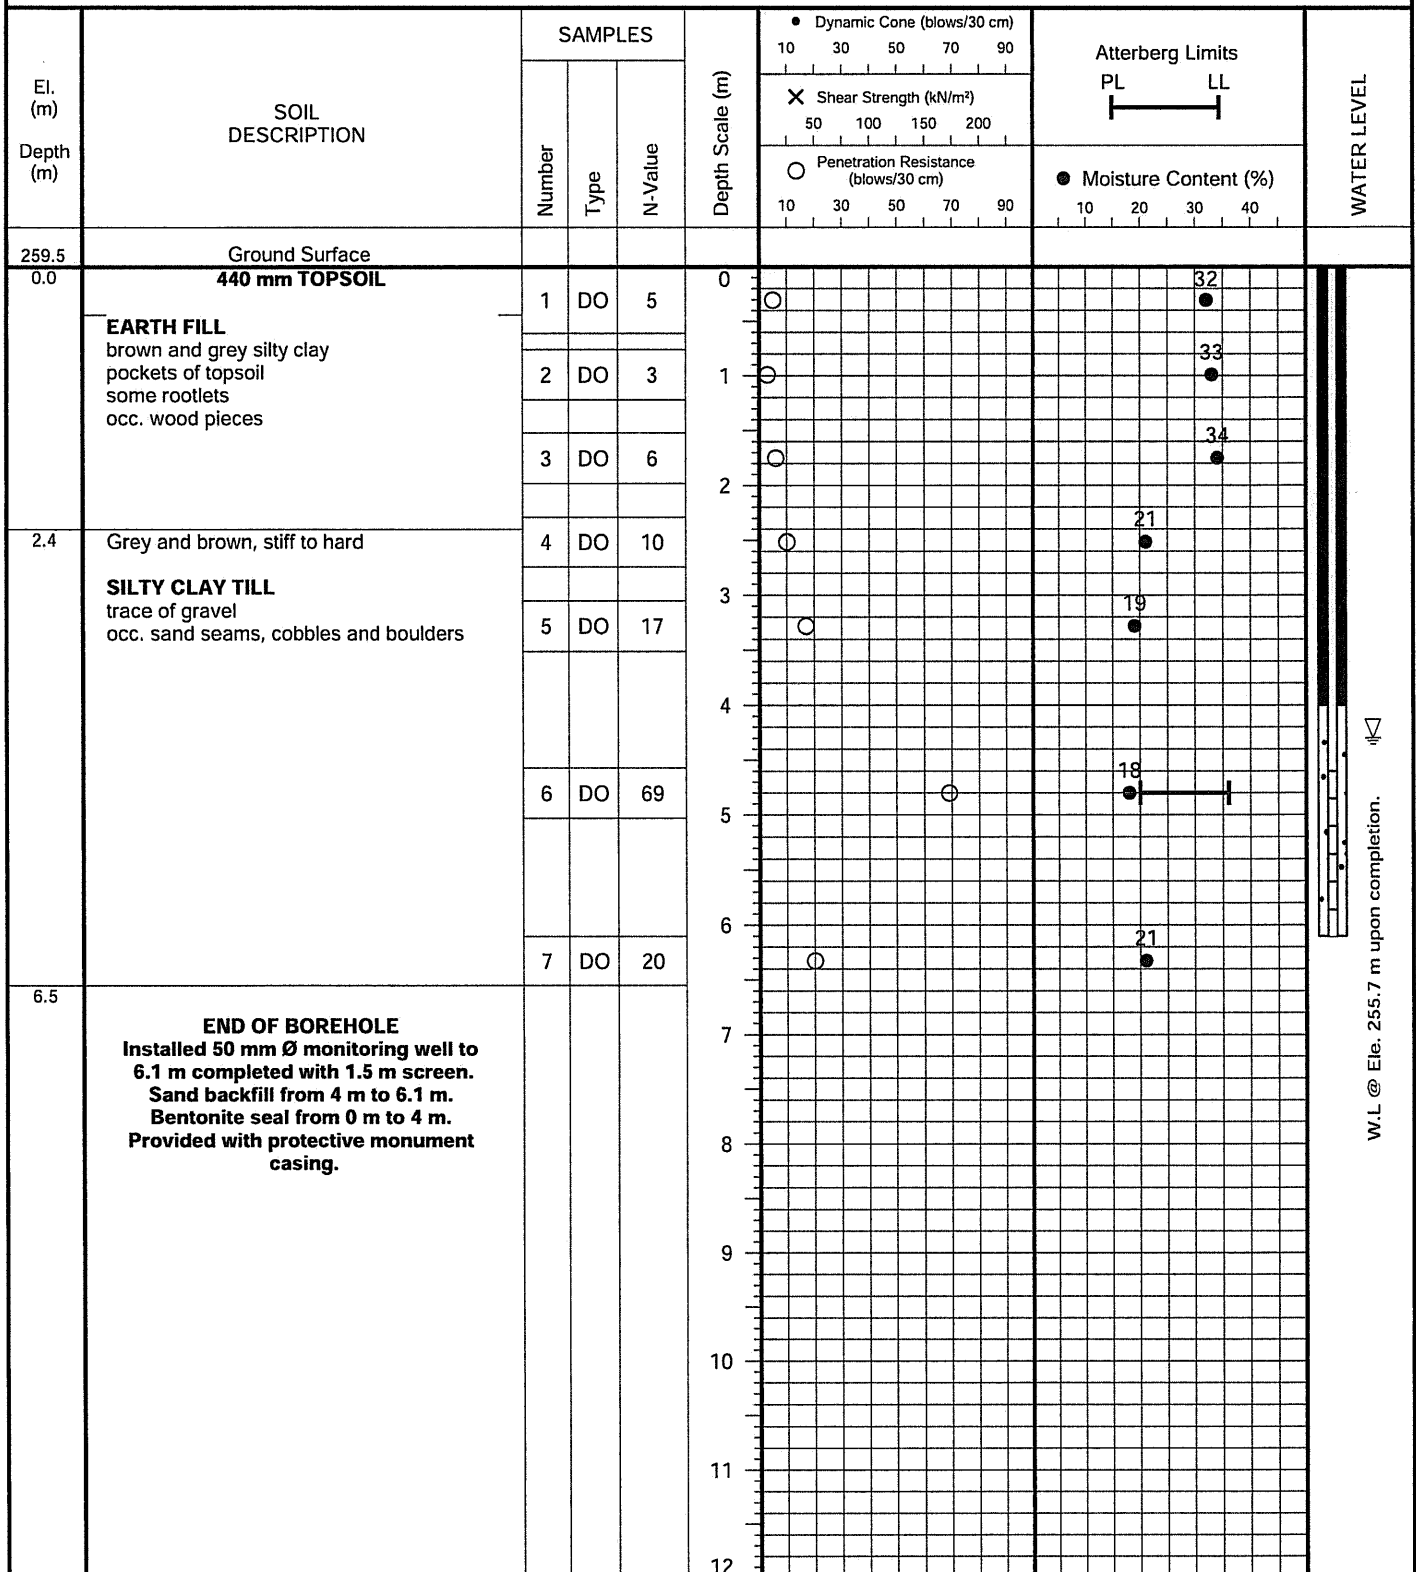PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 29, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 6


FIGURE NO.: 6

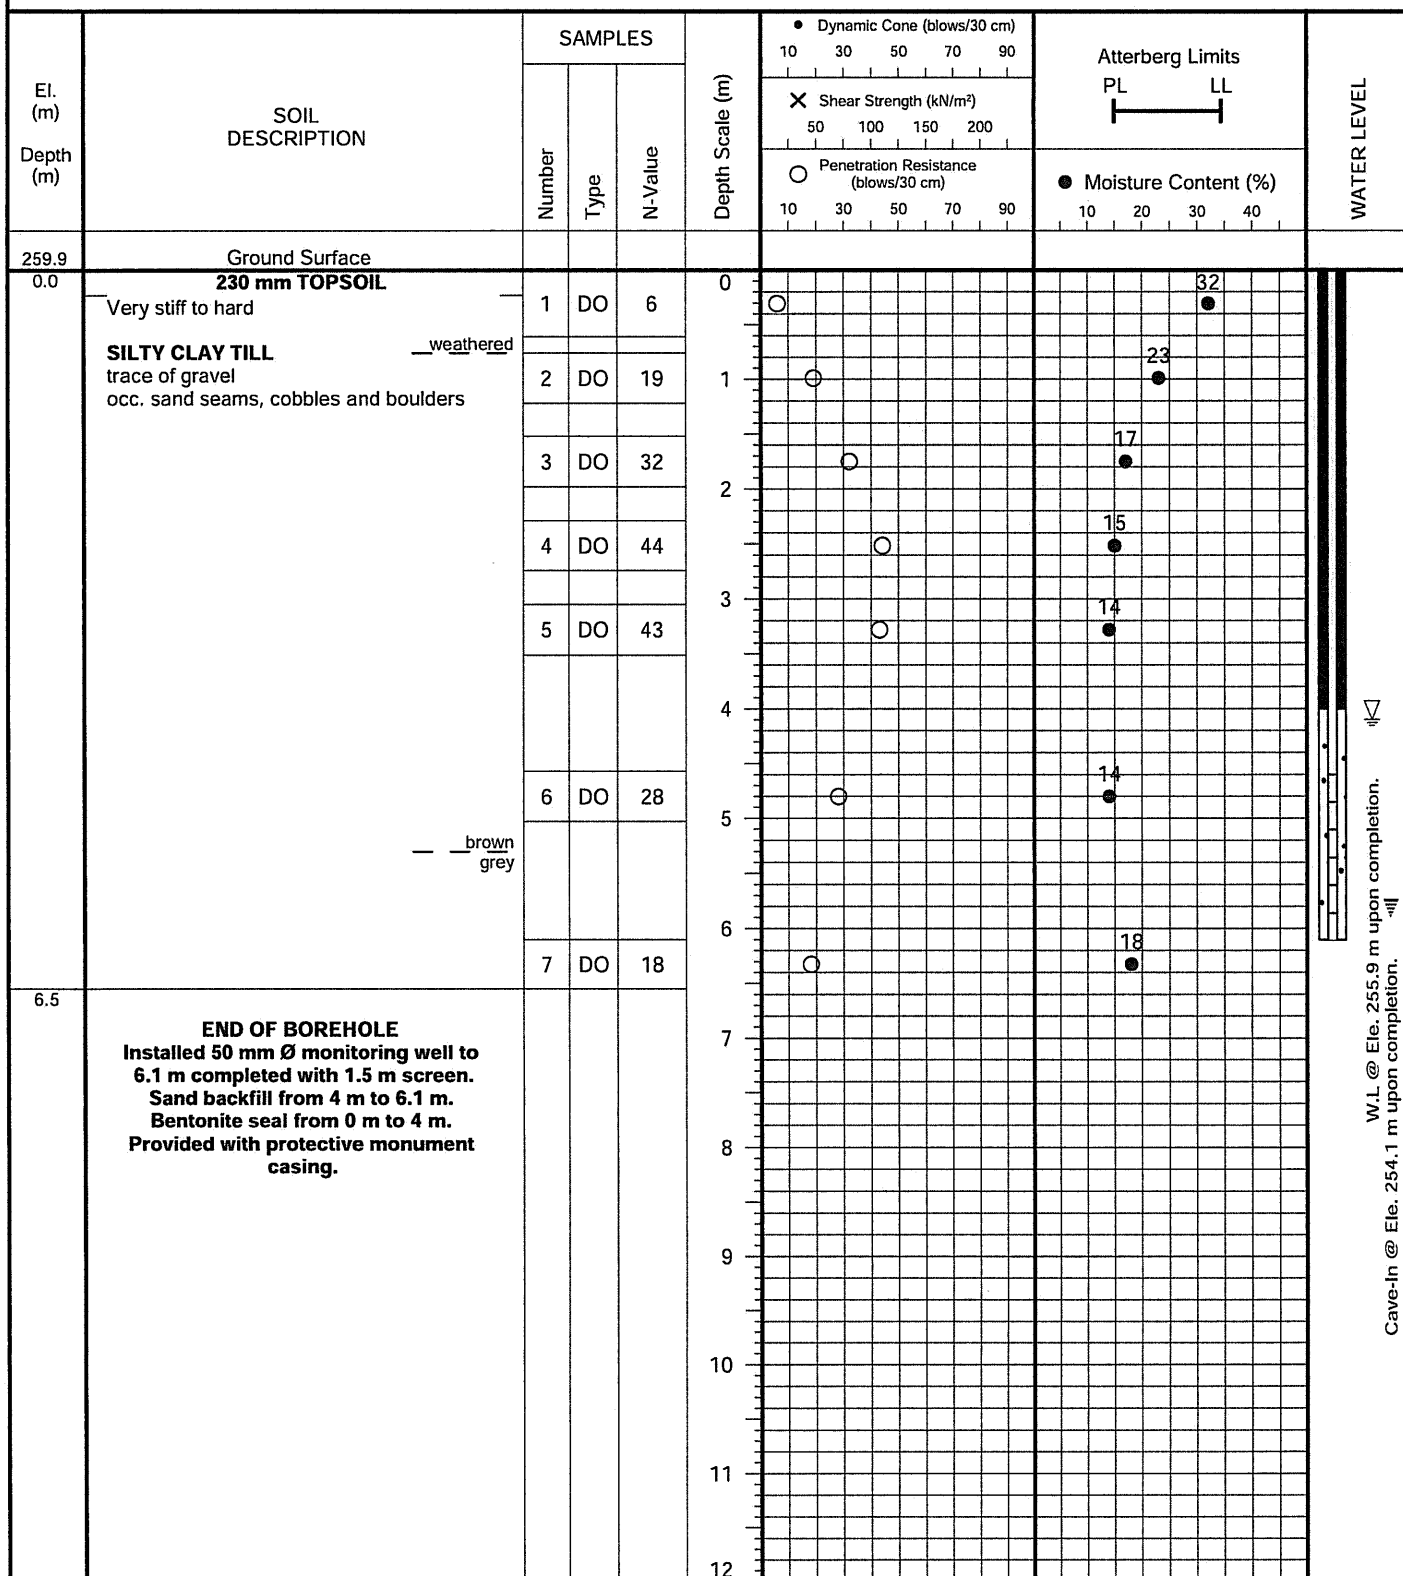PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 25, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 7


FIGURE NO.: 7

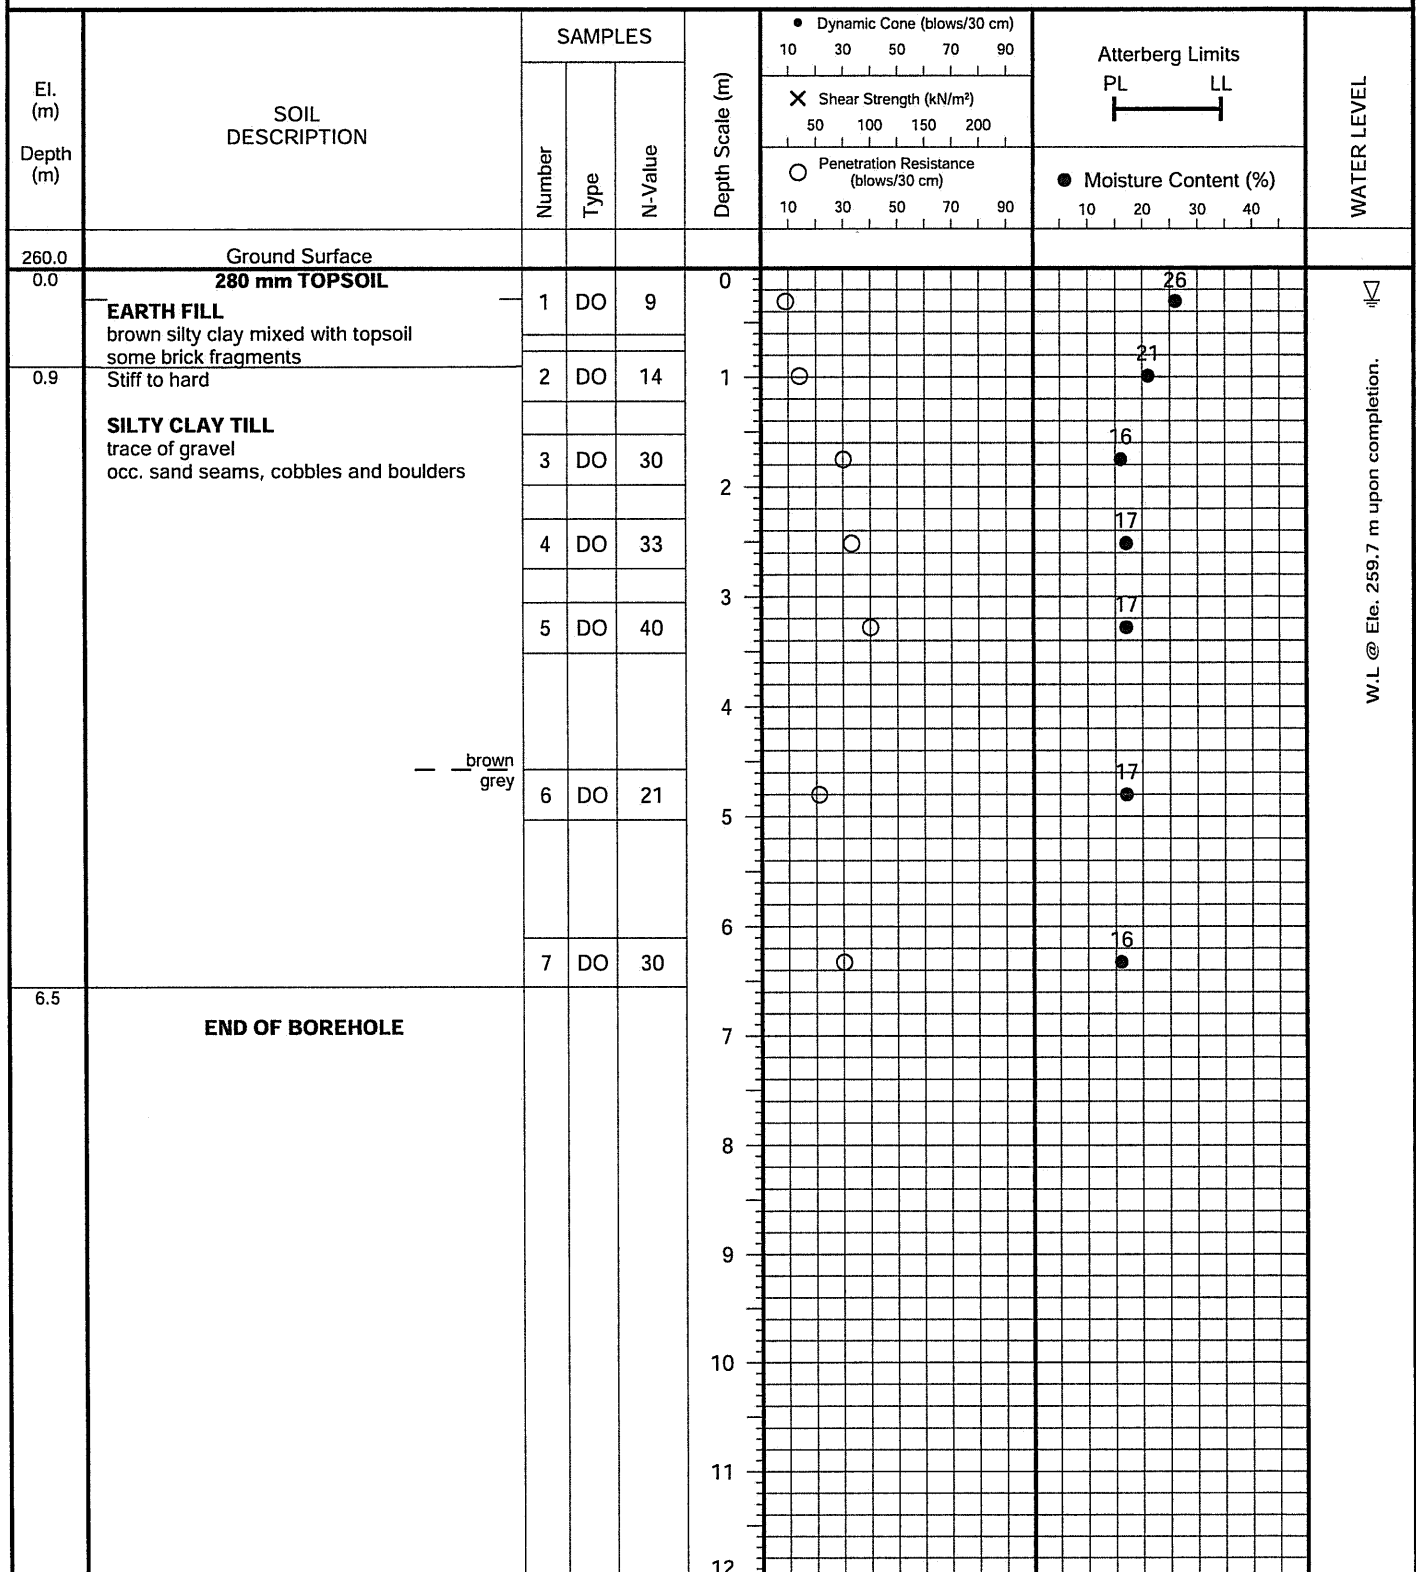PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 23, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 8


FIGURE NO.: 8

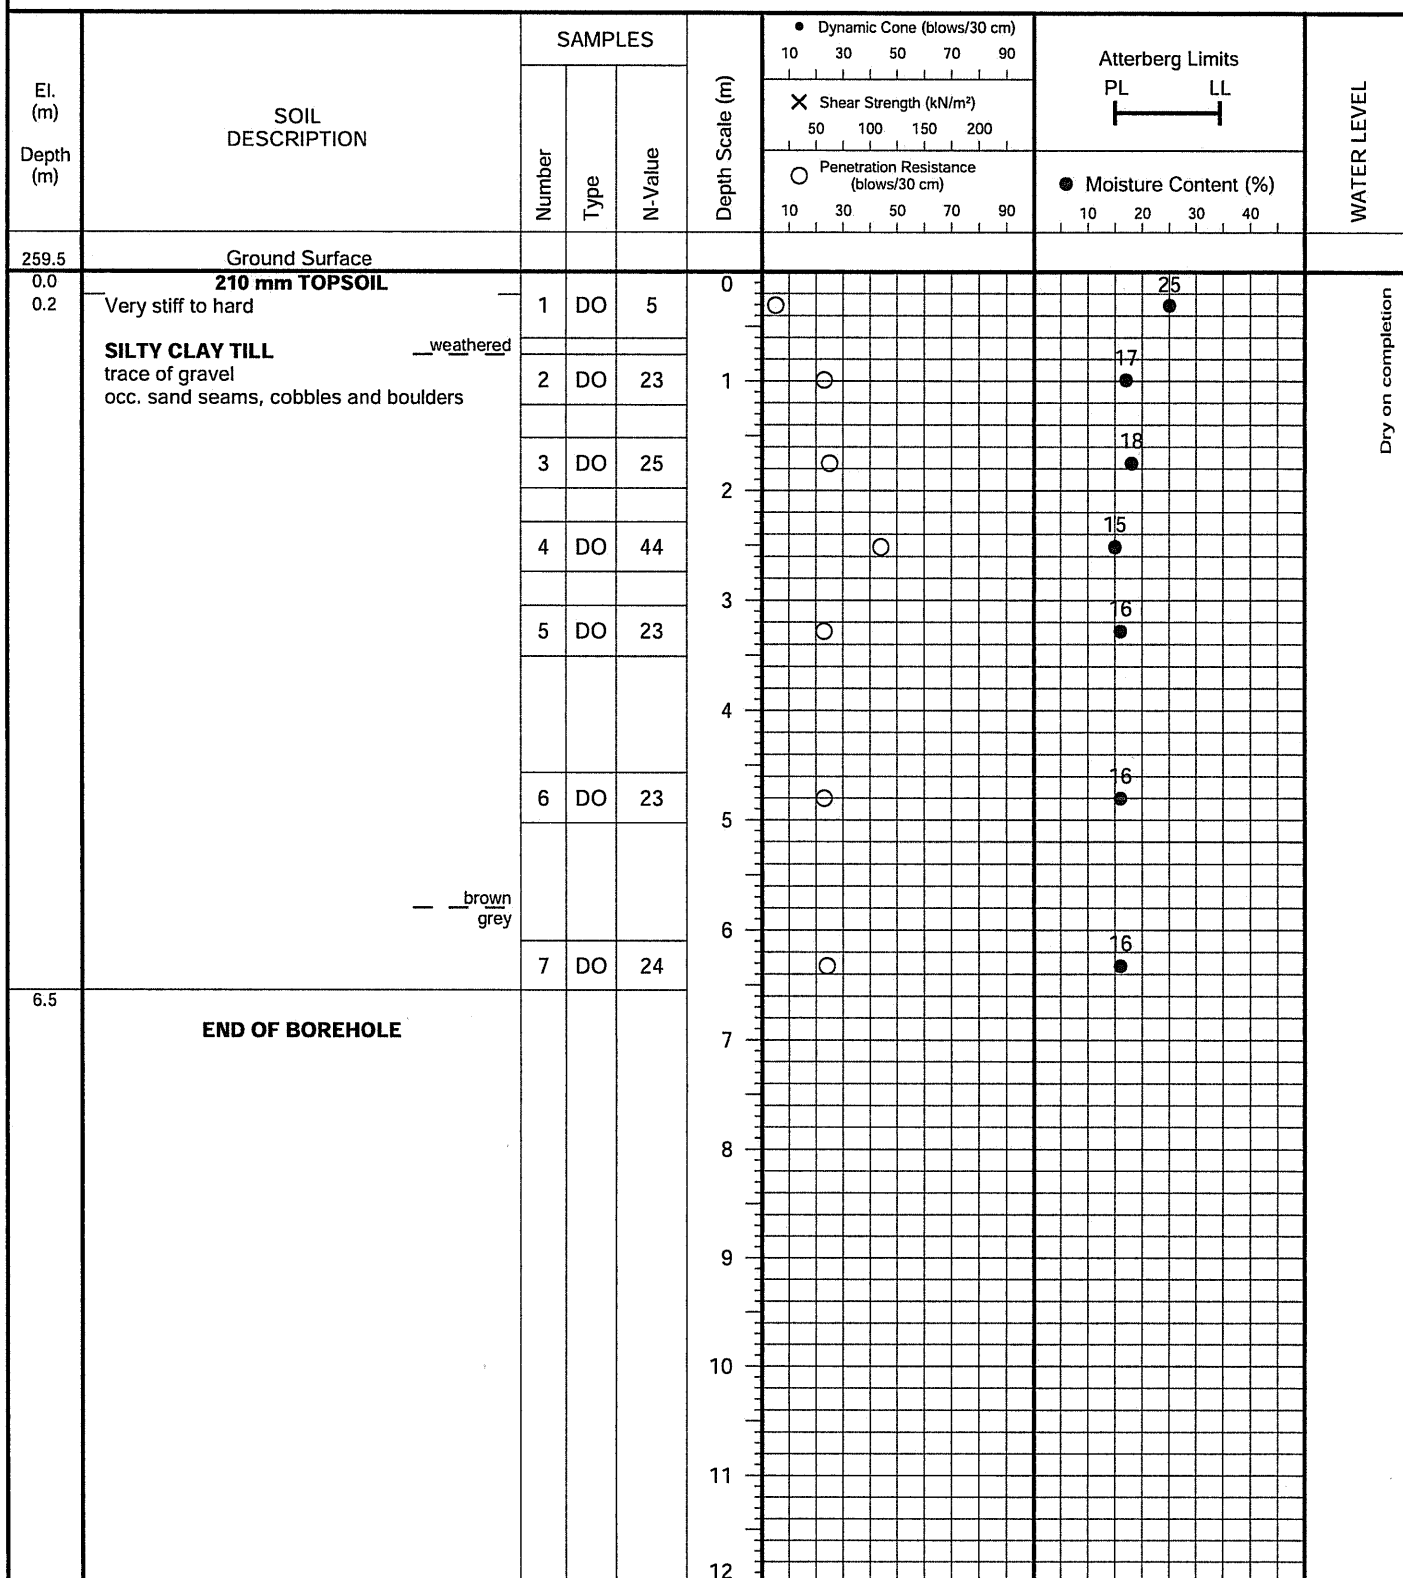PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 23, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 9


FIGURE NO.: 9

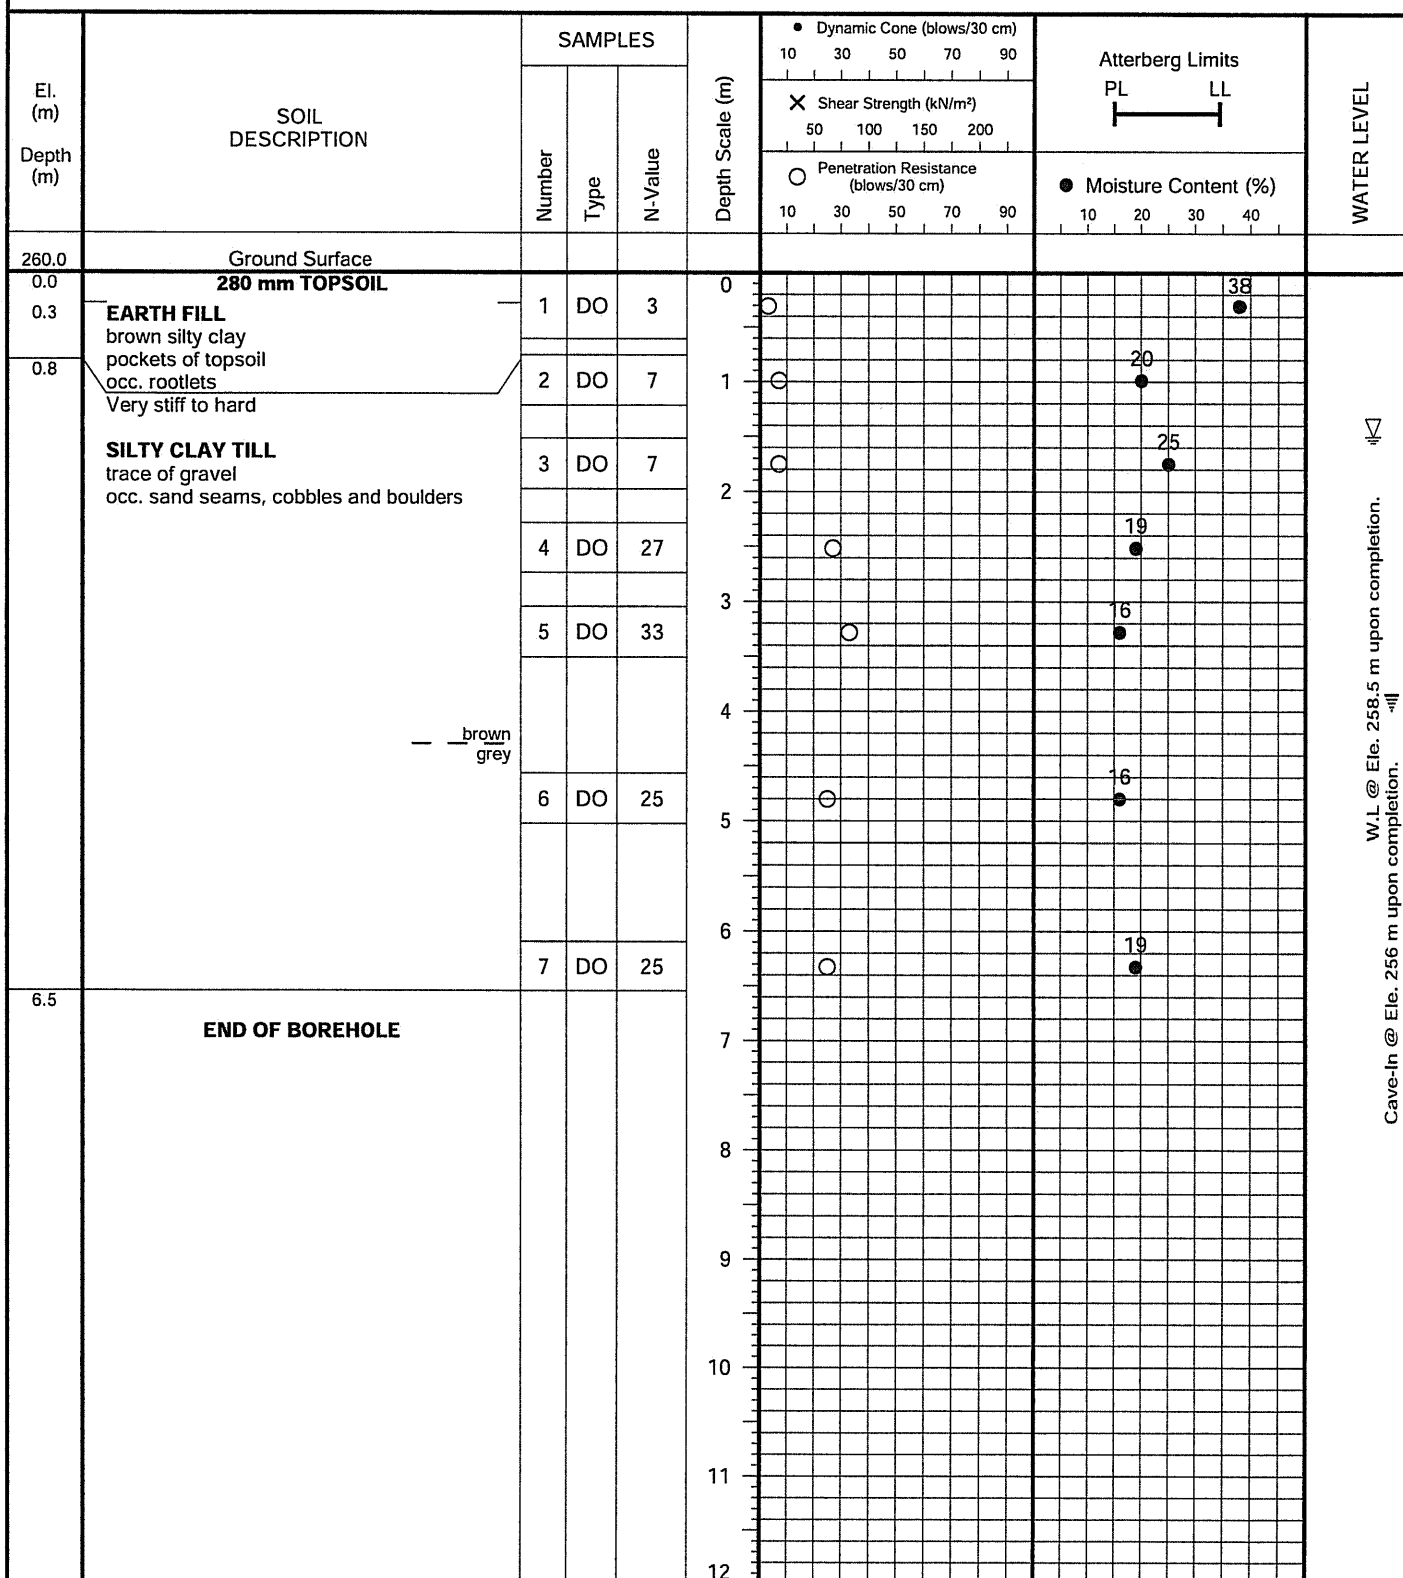PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 23, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 10


FIGURE NO.: 10

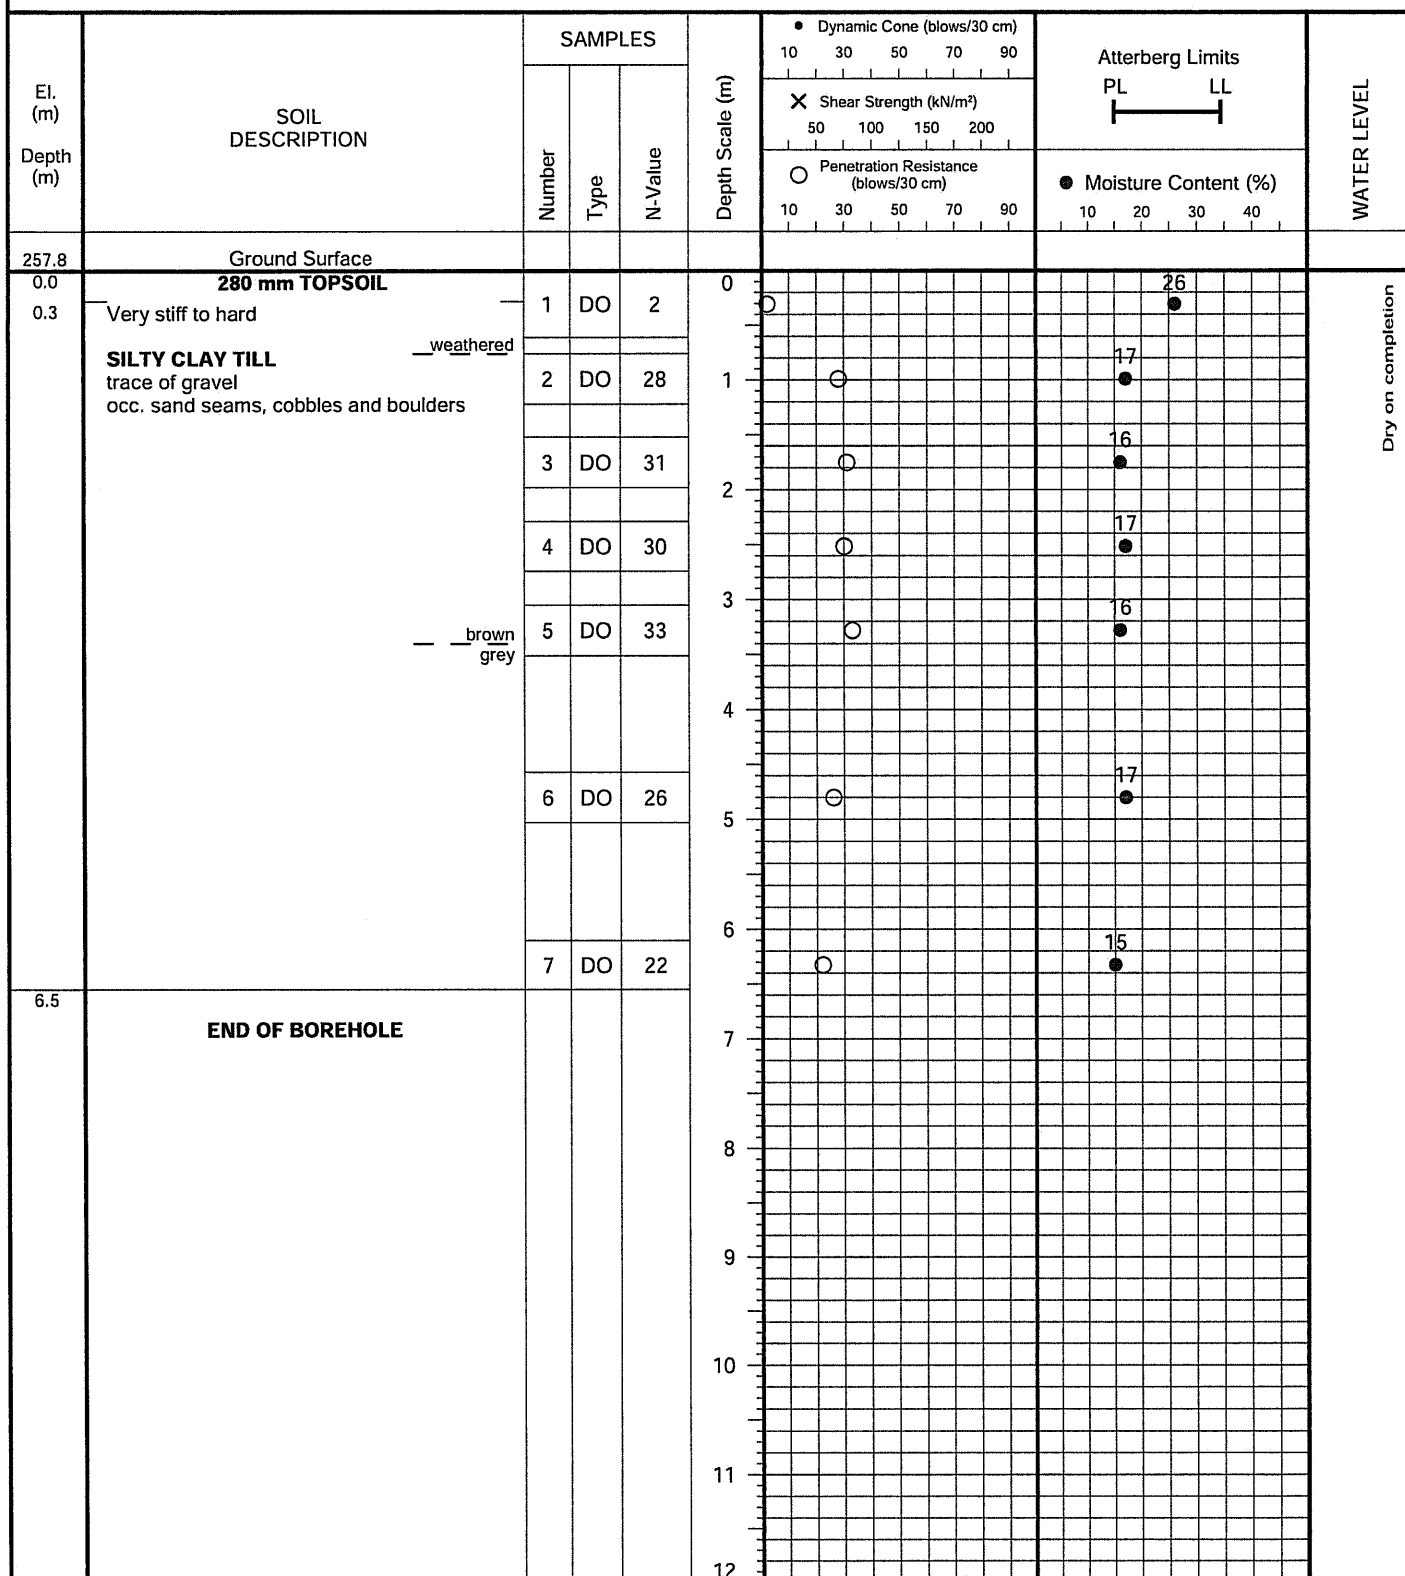PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 23, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 11


FIGURE NO.: 11

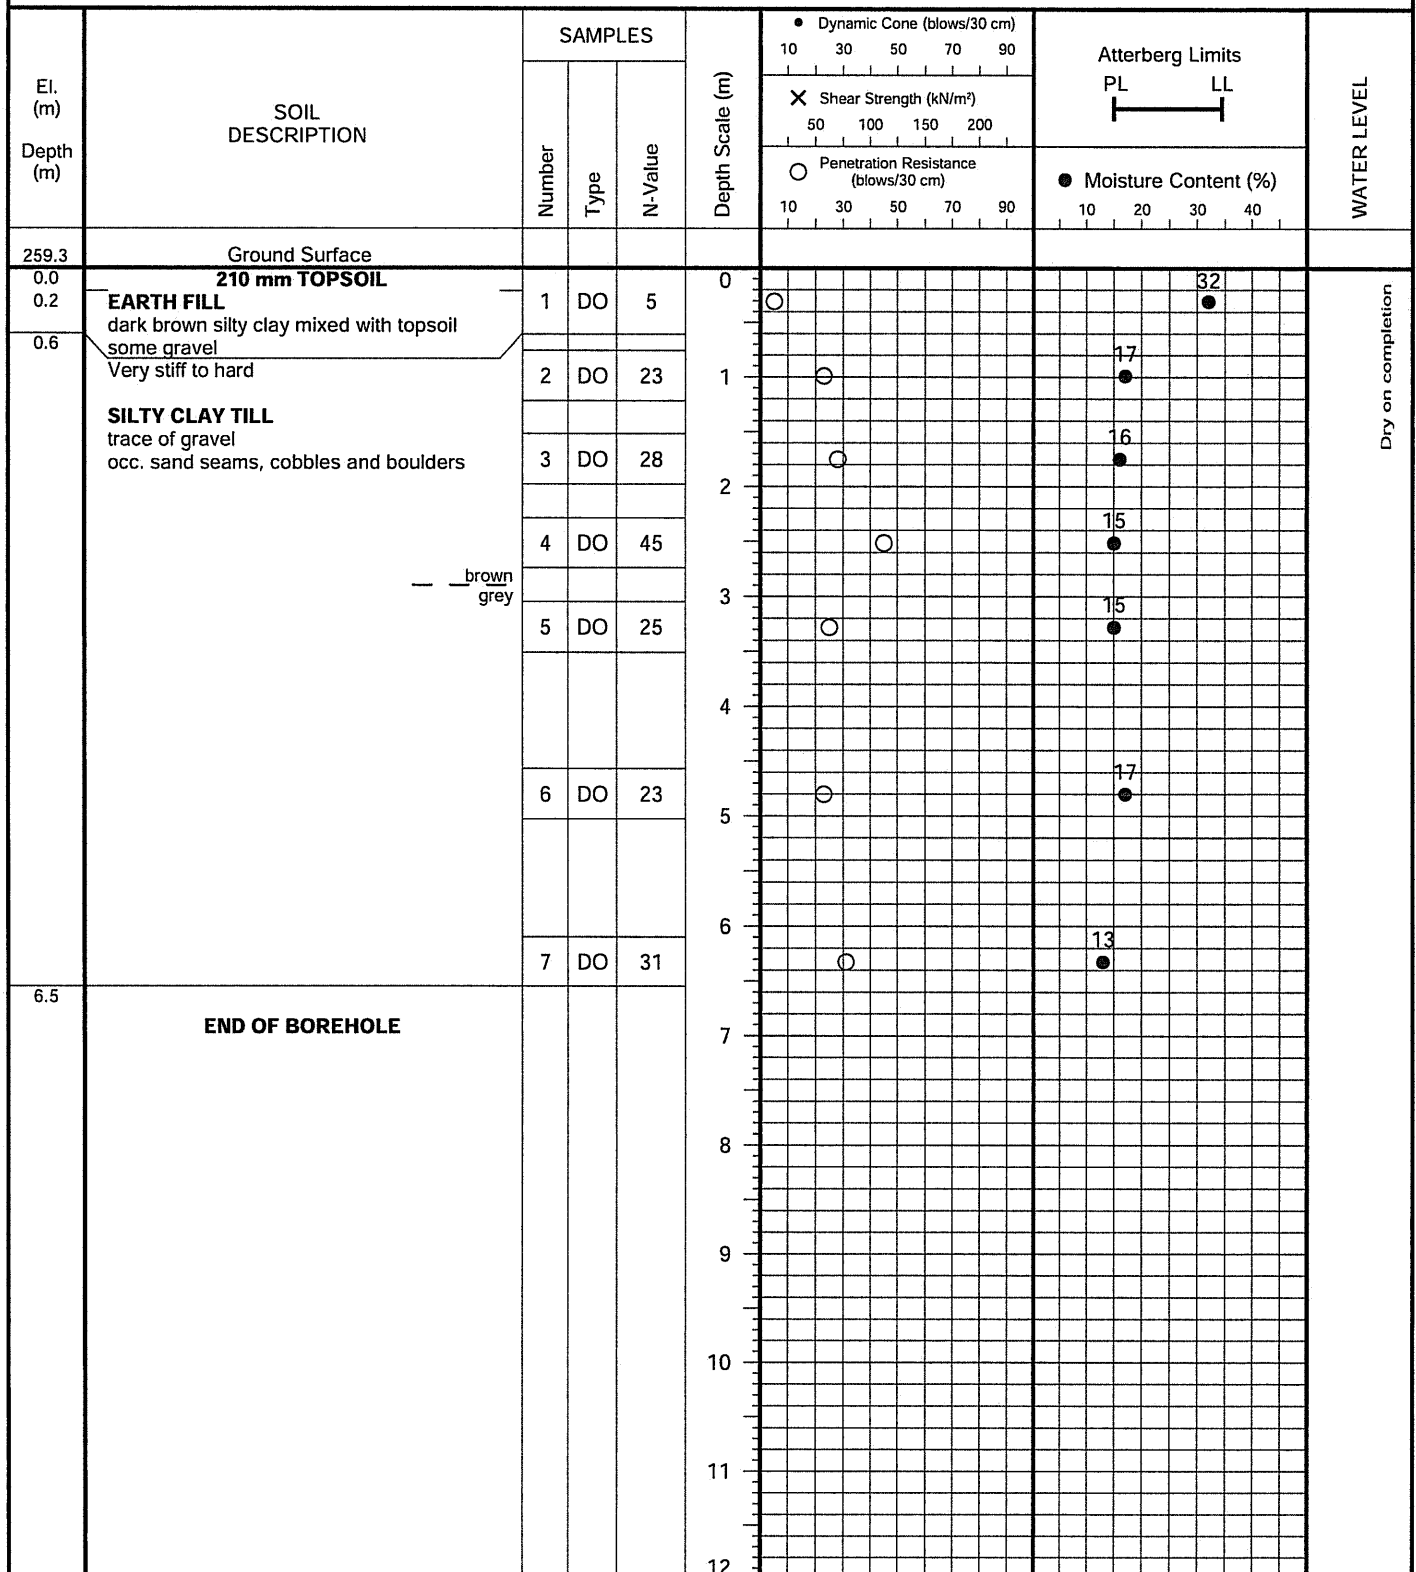PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 23, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 12


FIGURE NO.: 12

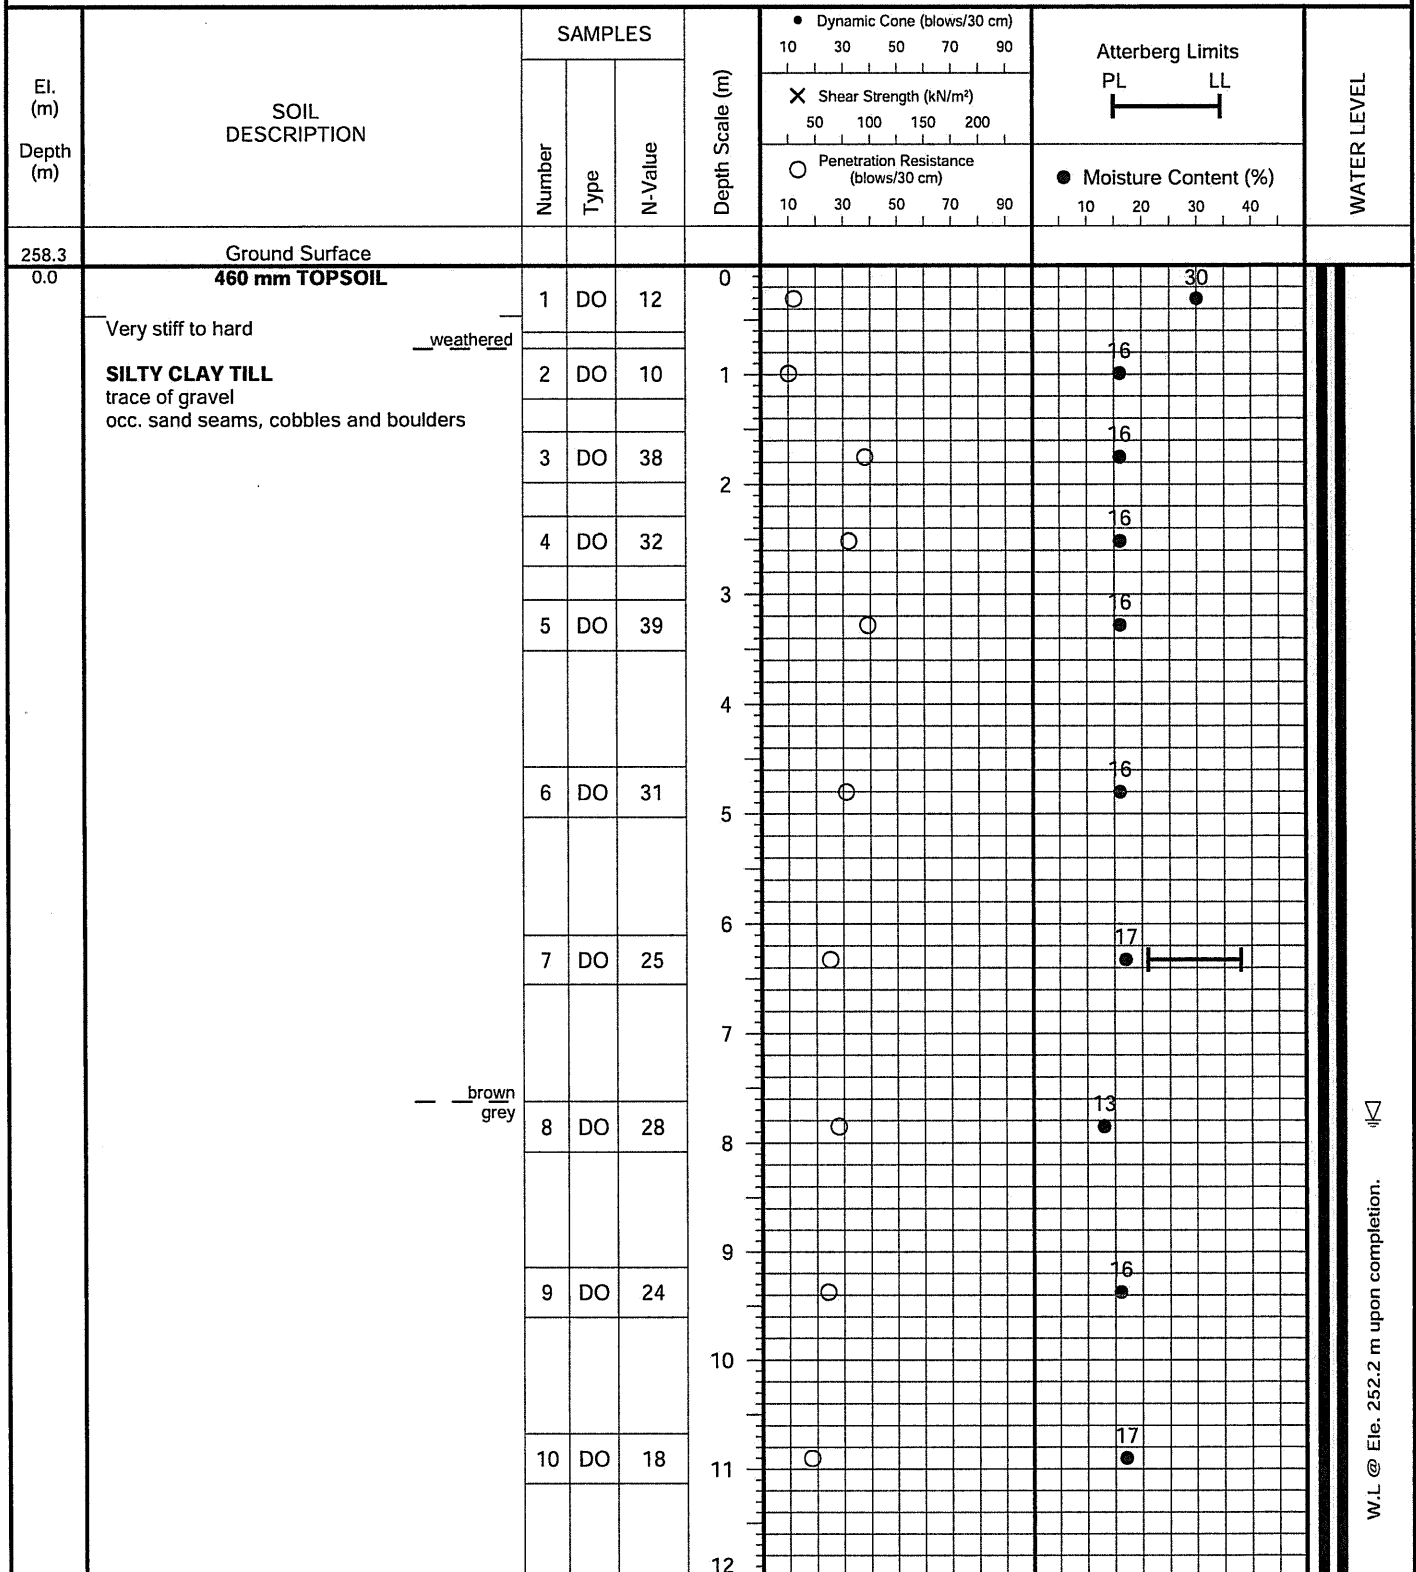PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 24, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 12


FIGURE NO.: 12

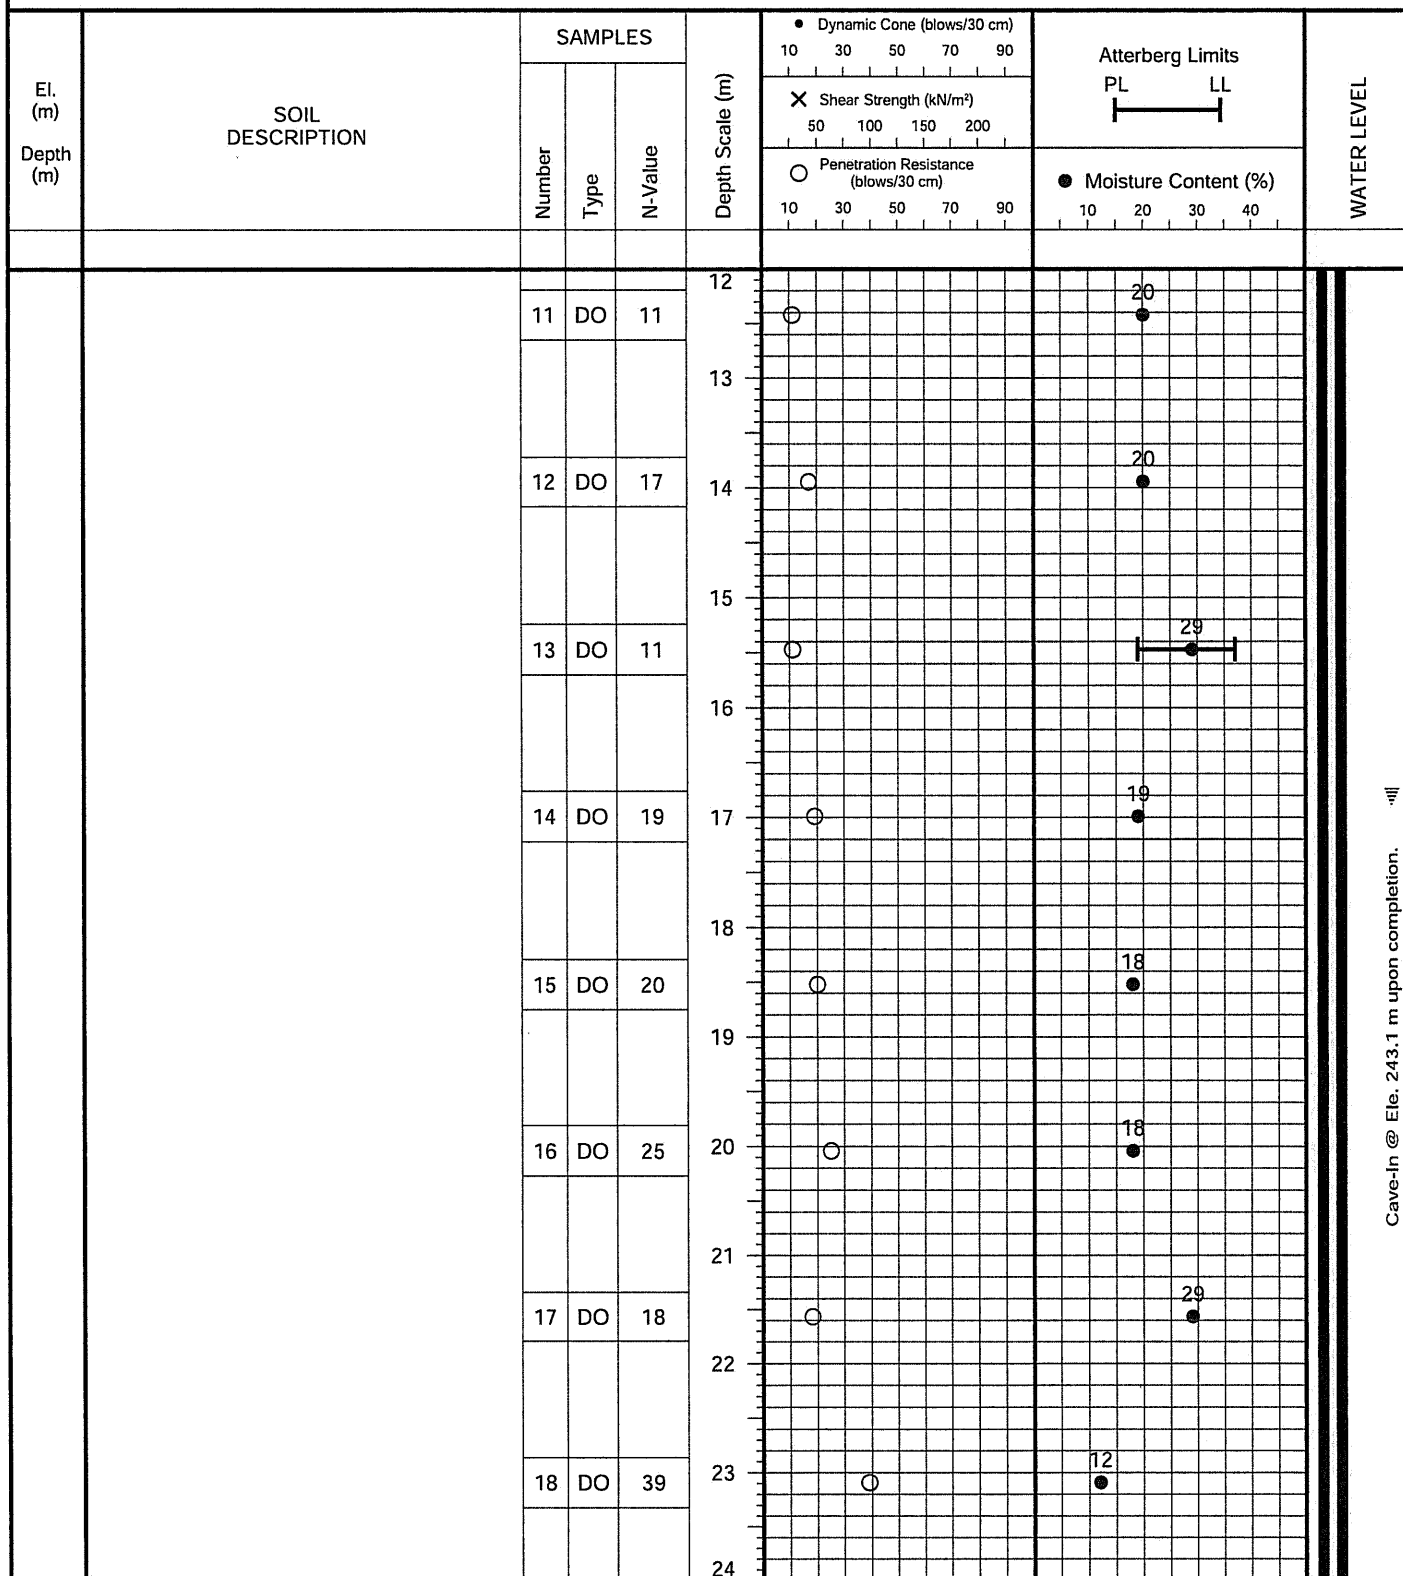PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 24, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 12

FIGURE NO.: 12

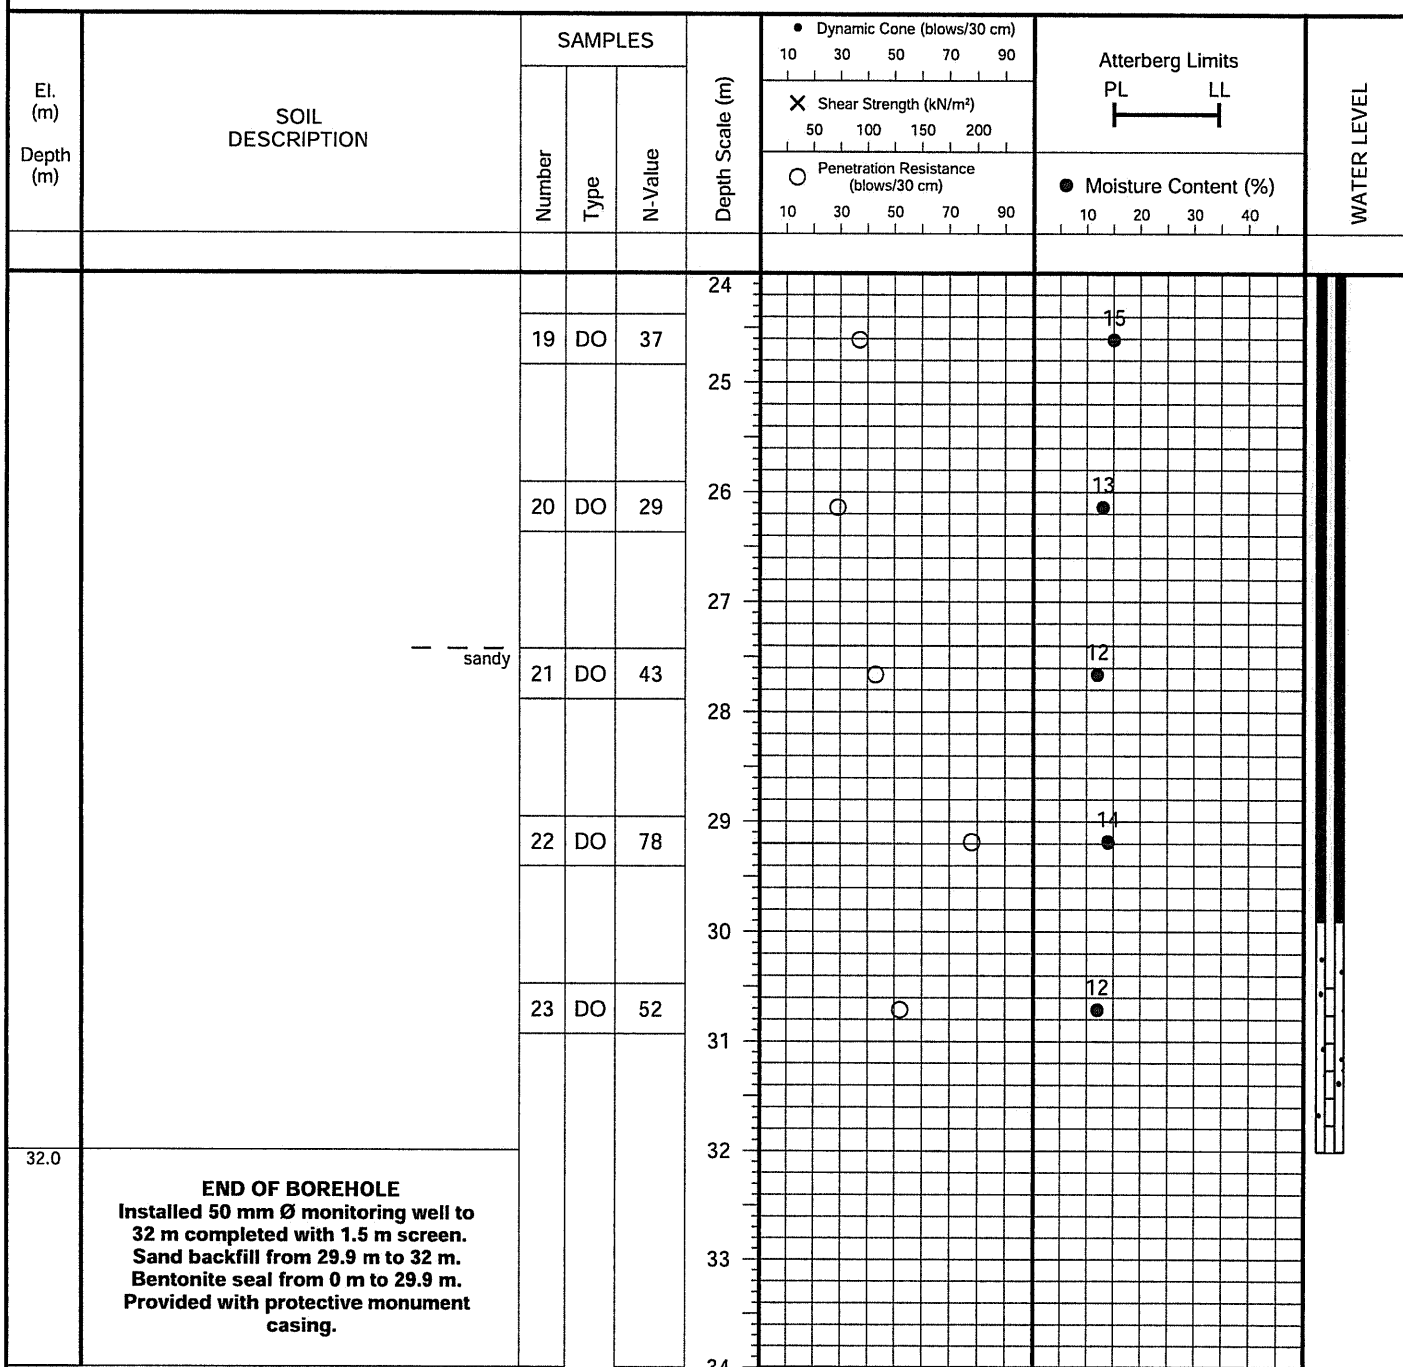PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 24, 2018**Soil Engineers Ltd.**

JOB NO.: 1801-S032

LOG OF BOREHOLE NO.: 12N

FIGURE NO.: 12

PROJECT DESCRIPTION: Proposed Residential Development**METHOD OF BORING:** Flight-Auger
(Solid-Stem)**PROJECT LOCATION:** Chickadee Lane and Glasgow Road, Town of Caledon**DRILLING DATE:** January 24, 2018

El. (m) Depth (m)	SOIL DESCRIPTION	SAMPLES			Depth Scale (m)	• Dynamic Cone (blows/30 cm) 10 30 50 70 90 X Shear Strength (kN/m²) 50 100 150 200 ○ Penetration Resistance (blows/30 cm) 10 30 50 70 90	Atterberg Limits PL LL 	WATER LEVEL
		Number	Type	N-Value		● Moisture Content (%) 10 20 30 40		
258.3 0.0	Ground Surface				0			W.L. @ Ele. 252.2 m upon completion. Cave-In @ Ele. 243.1 m upon completion.
Direct Auger to Water Table to Install Nested Monitoring Well					1			
					2			
					3			
					4			
					5			
					6			
					7			
					8			
					9			
					10			
					11			
					12			
7.6	END OF BOREHOLE Installed 50 mm Ø monitoring well to 7.6 m completed with 1.5 m screen. Sand backfill from 5.5 m to 7.6 m. Bentonite seal from 0 m to 5.5 m. Provided with protective monument casing.							


**Soil Engineers Ltd.**



PALMER
ENVIRONMENTAL
CONSULTING
GROUP INC.

Appendix C

Single Well Response Test Analyses

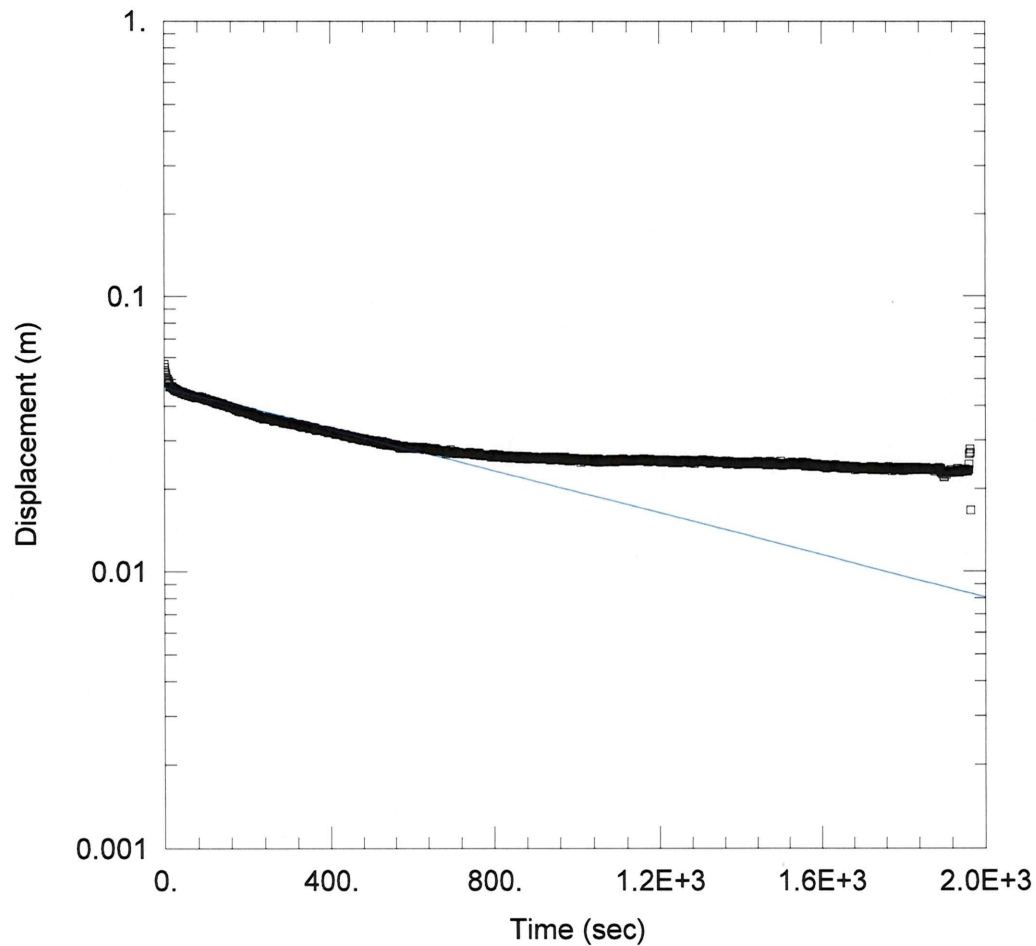

WELL TEST ANALYSIS

Data Set: C:\...\MW5R.aqt
 Date: 10/12/18

Time: 17:14:46

PROJECT INFORMATION

Company: PECG
 Client: Brook Valley Homes
 Project: 170163
 Location: Bolton
 Test Well: MW5
 Test Date: March 19, 2018

AQUIFER DATA

Saturated Thickness: 5.52 m

Anisotropy Ratio (K_z/K_r): 0.1

WELL DATA (MW5)


Initial Displacement: 0.0568 m
 Total Well Penetration Depth: 4.52 m
 Casing Radius: 0.0254 m

Static Water Column Height: 4.52 m
 Screen Length: 1.5 m
 Well Radius: 0.0254 m

SOLUTION

Aquifer Model: Confined
 $K = 9.929E-7$ m/sec

Solution Method: Hvorslev
 $y_0 = 0.04692$ m

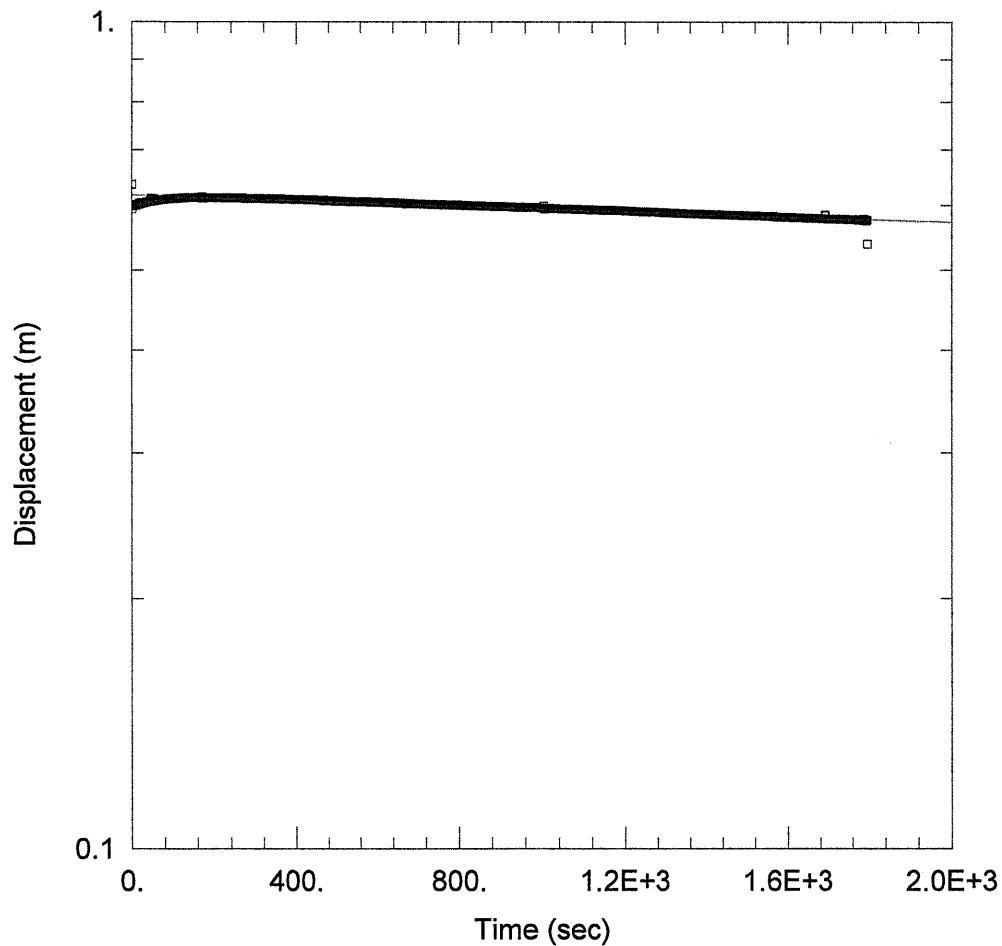

WELL TEST ANALYSIS

Data Set: C:\...MW5F.aqt

Date: 10/12/18

Time: 17:14:14

PROJECT INFORMATION

Company: PECG

Client: Brook Valley Homes

Project: 170163

Location: Bolton

Test Well: MW5

Test Date: March 19, 2018

AQUIFER DATA

Saturated Thickness: 5.52 m

Anisotropy Ratio (K_z/K_r): 0.1

WELL DATA (MW5)

Initial Displacement: 0.6361 m

Static Water Column Height: 4.52 m

Total Well Penetration Depth: 4.52 m

Screen Length: 1.5 m

Casing Radius: 0.0254 m

Well Radius: 0.0254 m


SOLUTION

Aquifer Model: Confined

Solution Method: Hvorslev

$K = 4.357E-8$ m/sec

$y_0 = 0.6175$ m

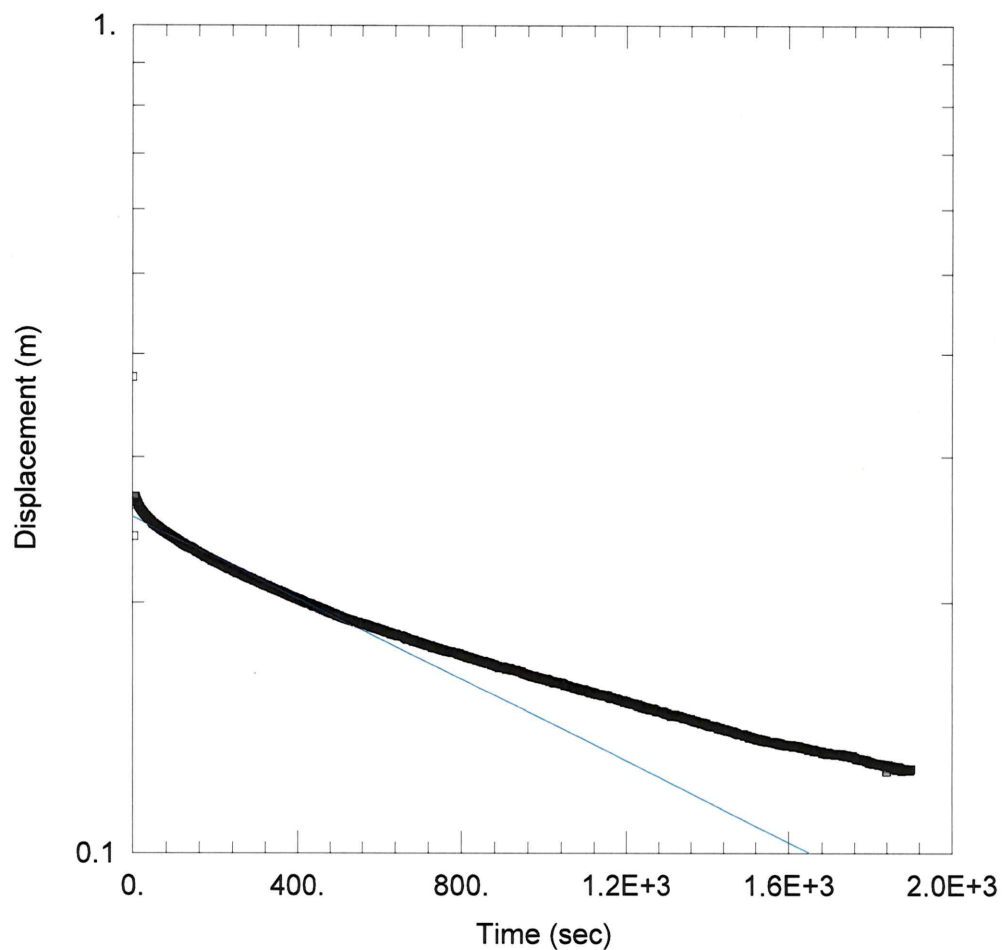

WELL TEST ANALYSIS

Data Set: C:\...MW2SR.aqt

Date: 10/12/18

Time: 17:13:58

PROJECT INFORMATION

Company: PECG

Client: Brook Valley Homes

Project: 170163

Location: Bolton

Test Well: MW2S

Test Date: March 19, 2018

AQUIFER DATA

Saturated Thickness: 6.84 m

Anisotropy Ratio (K_z/K_r): 0.1

WELL DATA (MW2S)

Initial Displacement: 0.3751 m

Static Water Column Height: 5.84 m

Total Well Penetration Depth: 5.84 m

Screen Length: 1.5 m

Casing Radius: 0.0254 m

Well Radius: 0.0254 m


SOLUTION

Aquifer Model: Confined

Solution Method: Hvorslev

$K = 6.341E-7$ m/sec

$y_0 = 0.2536$ m

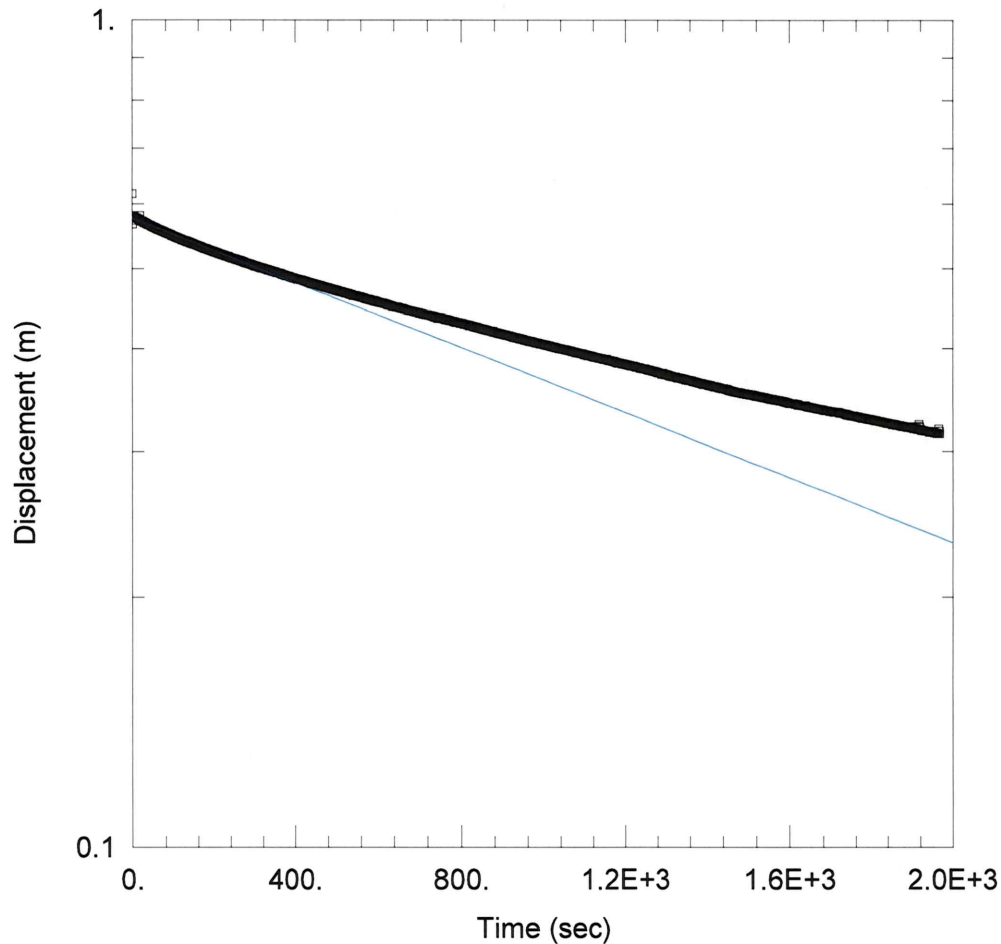

WELL TEST ANALYSIS

Data Set: C:\...MW2SF.aqt

Date: 10/12/18

Time: 17:13:47

PROJECT INFORMATION

Company: PECG

Client: Brook Valley Homes

Project: 170163

Location: Bolton

Test Well: MW2S

Test Date: March 19, 2018

AQUIFER DATA

Saturated Thickness: 6.84 m

Anisotropy Ratio (K_z/K_r): 0.1

WELL DATA (MW2S)

Initial Displacement: 0.6176 m

Static Water Column Height: 5.84 m

Total Well Penetration Depth: 5.84 m

Screen Length: 1.5 m

Casing Radius: 0.0254 m

Well Radius: 0.0254 m


SOLUTION

Aquifer Model: Confined

Solution Method: Hvorslev

$K = 5.12E-7$ m/sec

$y_0 = 0.5769$ m

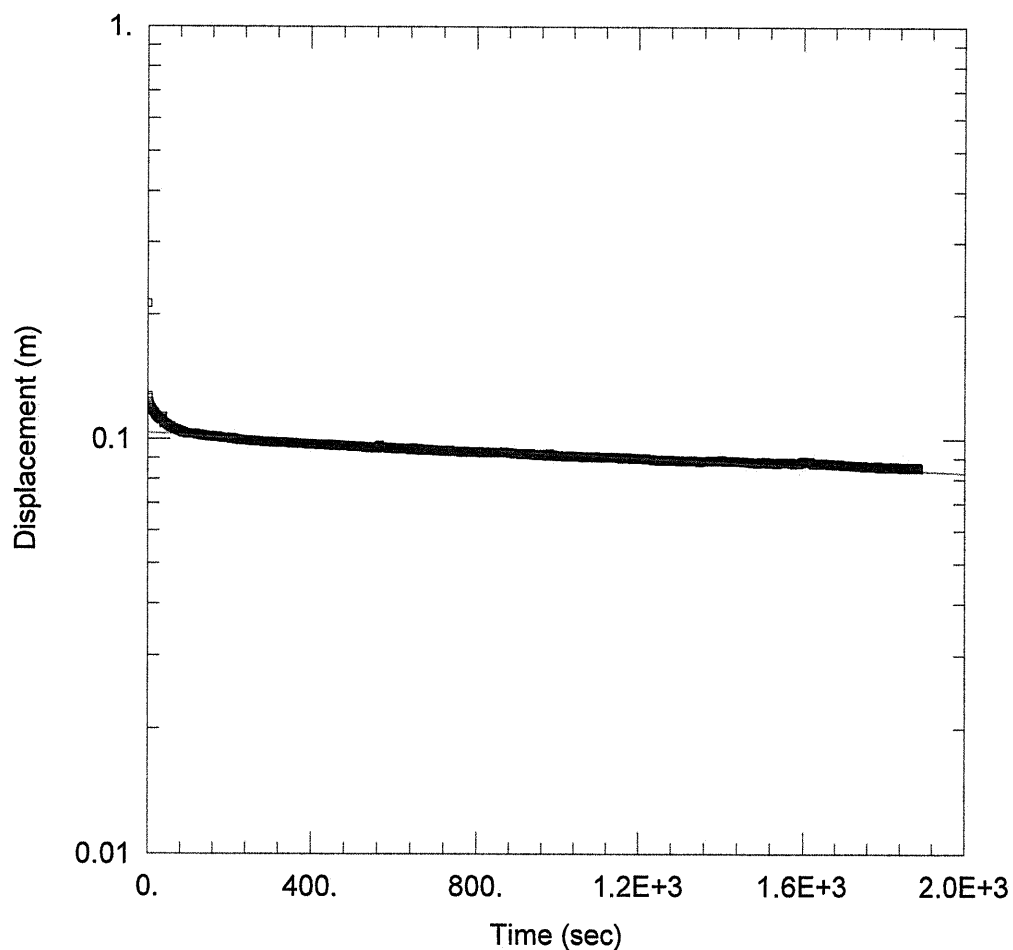

WELL TEST ANALYSIS

Data Set: C:\...MW2DR.aqt

Date: 10/12/18

Time: 17:13:27

PROJECT INFORMATION

Company: PECG

Client: Brook Valley Homes

Project: 170163

Location: Bolton

Test Well: MW2D

Test Date: March 19, 2018

AQUIFER DATA

Saturated Thickness: 7.46 m

Anisotropy Ratio (K_z/K_r): 0.1

WELL DATA (MW2D)

Initial Displacement: 0.213 m

Static Water Column Height: 6.46 m

Total Well Penetration Depth: 6.46 m

Screen Length: 1.5 m

Casing Radius: 0.0254 m

Well Radius: 0.0254 m


SOLUTION

Aquifer Model: Confined

Solution Method: Hvorslev

$K = 1.262E-7$ m/sec

$y_0 = 0.1033$ m

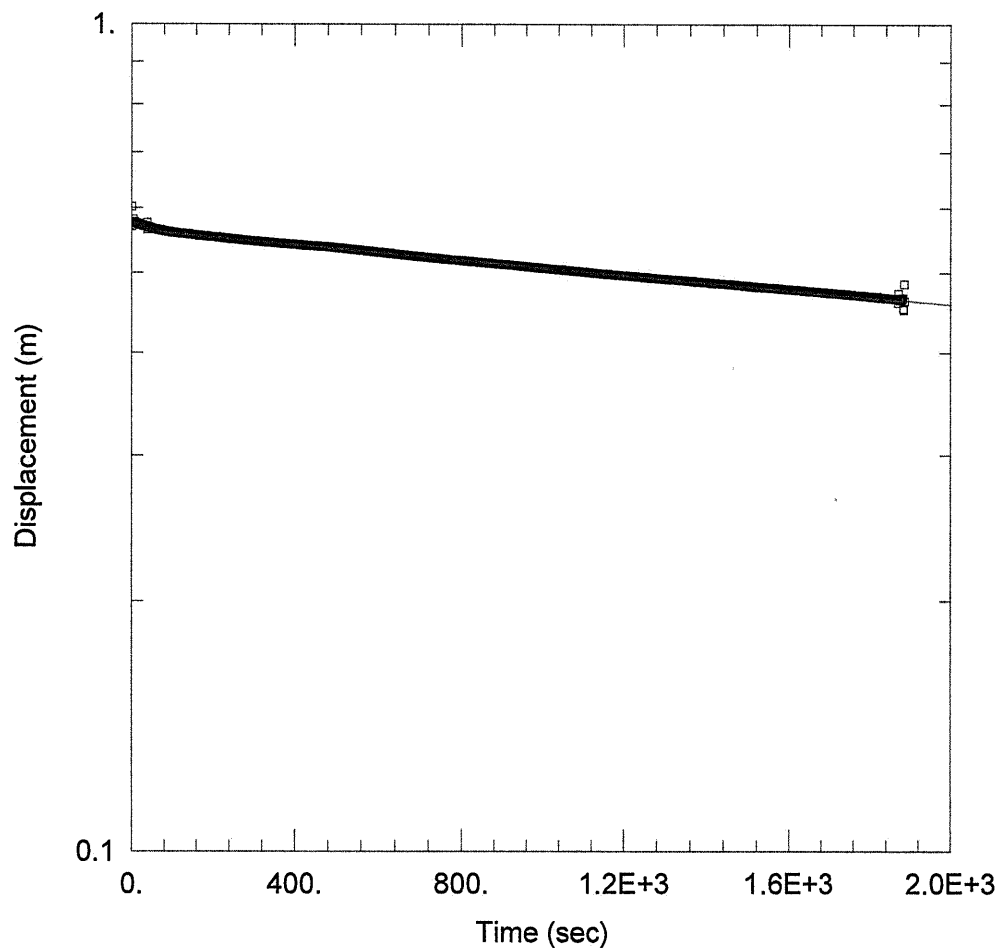

WELL TEST ANALYSIS

Data Set: C:\...MW2DF.aqt
 Date: 10/12/18

Time: 17:05:42

PROJECT INFORMATION

Company: PECG
 Client: Brook Valley Homes
 Project: 170163
 Location: Bolton
 Test Well: MW2D
 Test Date: March 19, 2018

AQUIFER DATA

Saturated Thickness: 7.46 m

Anisotropy Ratio (K_z/K_r): 0.1

WELL DATA (MW2D)

Initial Displacement: 0.6021 m
 Total Well Penetration Depth: 6.46 m
 Casing Radius: 0.0254 m

Static Water Column Height: 6.46 m
 Screen Length: 1.5 m
 Well Radius: 0.0254 m


SOLUTION

Aquifer Model: Confined

Solution Method: Hvorslev

$K = 1.199E-7$ m/sec

$y_0 = 0.5652$ m

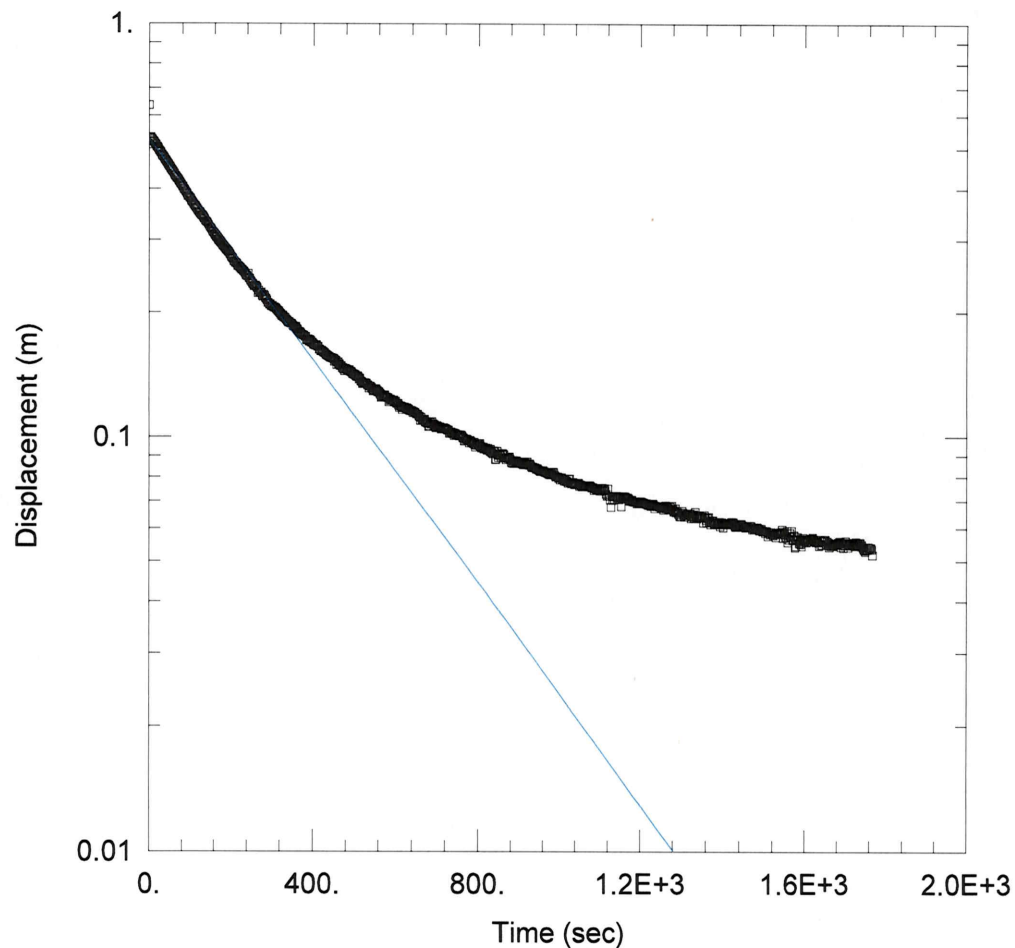

WELL TEST ANALYSIS

Data Set: C:\...MW6F2.aqt

Date: 10/12/18

Time: 17:15:22

PROJECT INFORMATION

Company: PECG

Client: Brook Valley Homes

Project: 170163

Location: Bolton

Test Well: MW6

Test Date: April 4, 2018

AQUIFER DATA

Saturated Thickness: 5.94 m

Anisotropy Ratio (K_z/K_r): 0.1

WELL DATA (MW6)

Initial Displacement: 0.6349 m

Static Water Column Height: 4.94 m

Total Well Penetration Depth: 4.94 m

Screen Length: 1.5 m

Casing Radius: 0.0254 m

Well Radius: 0.0254 m


SOLUTION

Aquifer Model: Confined

Solution Method: Hvorslev

$K = 3.478E-6$ m/sec

$y_0 = 0.5265$ m

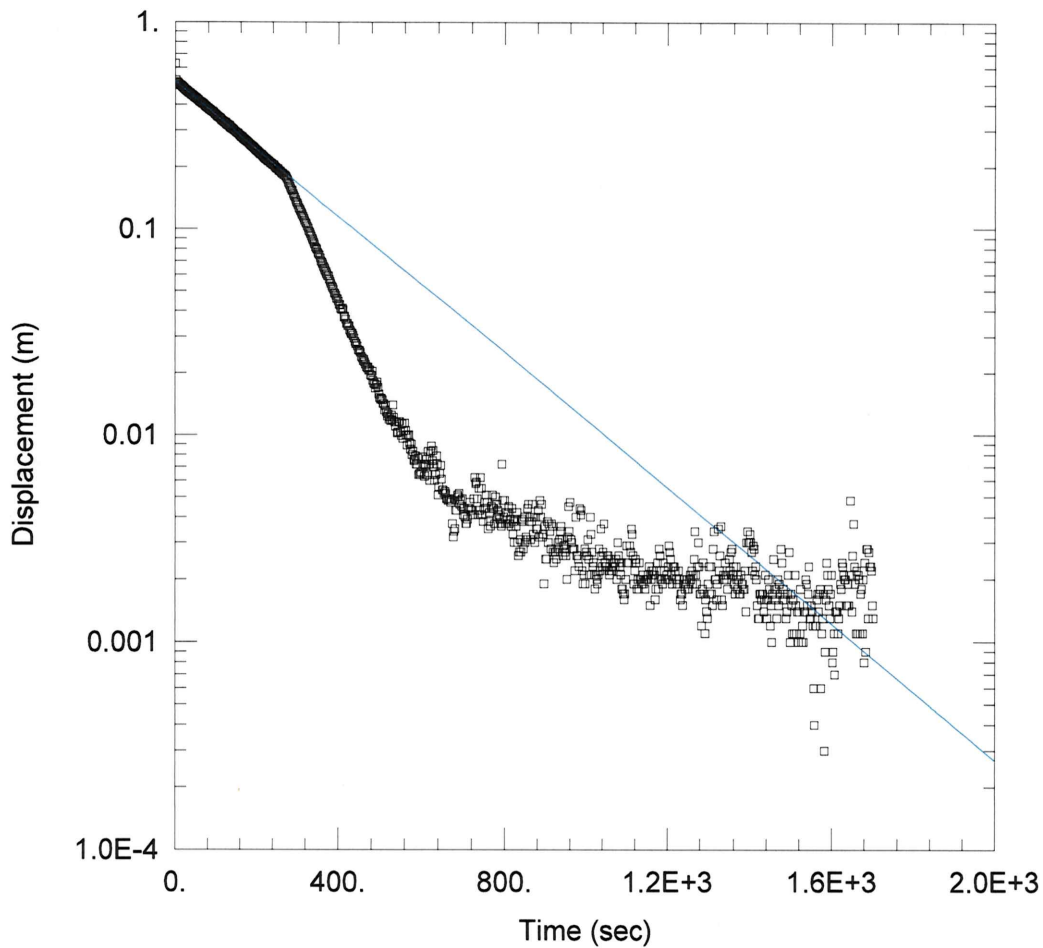

WELL TEST ANALYSIS

Data Set: C:\...\MW6R2.aqt

Date: 10/12/18

Time: 17:16:01

PROJECT INFORMATION

Company: PECG

Client: Brook Valley Homes

Project: 170163

Location: Bolton

Test Well: MW6

Test Date: April 4, 2018

AQUIFER DATA

Saturated Thickness: 5.94 m

Anisotropy Ratio (K_z/K_r): 0.1

WELL DATA (MW6)

Initial Displacement: 0.6292 m

Static Water Column Height: 4.94 m

Total Well Penetration Depth: 4.94 m

Screen Length: 1.5 m

Casing Radius: 0.0254 m

Well Radius: 0.0254 m

SOLUTION

Aquifer Model: Confined

Solution Method: Hvorslev

$K = 4.255E-6$ m/sec

$y_0 = 0.5174$ m



Appendix D

Groundwater Chemistry Certificate of Analysis



PALMER ENVIRONMENTAL CONSULTING
GROUP INC. (Richmond Hill)
ATTN: Ryan Polick
74 Berkeley Street
Toronto ON M5V 2W7

Date Received: 15-MAR-18
Report Date: 23-MAR-18 10:45 (MT)
Version: FINAL

Client Phone: 647-795-8153

Certificate of Analysis

Lab Work Order #: L2068971
Project P.O. #: NOT SUBMITTED
Job Reference: 170163 CHICKADEE LANE
C of C Numbers: 17-622480
Legal Site Desc:

Amanda Fazekas
Account Manager

[This report shall not be reproduced except in full without the written authority of the Laboratory.]

ADDRESS: 95 West Beaver Creek Road, Unit 1, Richmond Hill, ON L4B 1H2 Canada | Phone: +1 905 881 9887 | Fax: +1 905 881 8062
ALS CANADA LTD Part of the ALS Group An ALS Limited Company

Environmental

www.alsglobal.com

RIGHT SOLUTIONS RIGHT PARTNER

ANALYTICAL GUIDELINE REPORT

L2068971 CONTD....

Page 2 of 5

23-MAR-18 10:45 (MT)

170163 CHICKADEE LANE

Sample Details							
Grouping	Analyte	Result	Qualifier	D.L.	Units	Analyzed	Guideline Limits
L2068971-1	MW6						
Sampled By: CLIENT on 15-MAR-18 @ 15:45							
Matrix: WATER							
Physical Tests							
Colour, Apparent		30.9		2.0	CU	17-MAR-18	*5
Conductivity		941		3.0	umhos/cm	17-MAR-18	
Hardness (as CaCO3)		461	HTC	10	mg/L	20-MAR-18	*80-100
pH		7.88		0.10	pH units	17-MAR-18	6.5-8.5
Redox Potential		317	PEHR	-1000	mV	20-MAR-18	
Total Dissolved Solids		560	DLDS	20	mg/L	18-MAR-18	*500
Turbidity		72.0		0.10	NTU	17-MAR-18	*5
Anions and Nutrients							
Acidity (as CaCO3)		30.0		5.0	mg/L	21-MAR-18	
Alkalinity, Total (as CaCO3)		387		10	mg/L	19-MAR-18	30-500
Ammonia, Total (as N)		0.022		0.020	mg/L	19-MAR-18	
Bromide (Br)		<0.10		0.10	mg/L	19-MAR-18	
Chloride (Cl)		55.8		0.50	mg/L	19-MAR-18	250
Fluoride (F)		0.226		0.020	mg/L	19-MAR-18	1.5
Nitrate (as N)		<0.020		0.020	mg/L	19-MAR-18	10
Nitrite (as N)		<0.010		0.010	mg/L	19-MAR-18	1
Orthophosphate-Dissolved (as P)		<0.0030		0.0030	mg/L	19-MAR-18	
Phosphorus, Total		0.0560		0.0030	mg/L	20-MAR-18	
Sulfate (SO4)		77.1		0.30	mg/L	19-MAR-18	500
Bacteriological Tests							
Escherichia Coli		0		0	MPN/100m L	18-MAR-18	0
Total Coliforms		>201		0	MPN/100m L	18-MAR-18	*0
Total Metals							
Aluminum (Al)-Total		1.24		0.0050	mg/L	20-MAR-18	*0.1
Antimony (Sb)-Total		0.00017		0.00010	mg/L	20-MAR-18	0.006
Arsenic (As)-Total		0.00126		0.00010	mg/L	20-MAR-18	0.0100
Barium (Ba)-Total		0.0943		0.00020	mg/L	20-MAR-18	1
Beryllium (Be)-Total		<0.00010		0.00010	mg/L	20-MAR-18	
Bismuth (Bi)-Total		<0.000050		0.000050	mg/L	20-MAR-18	
Boron (B)-Total		0.027		0.010	mg/L	20-MAR-18	5
Cadmium (Cd)-Total		0.0000197		0.000005	mg/L	20-MAR-18	0.005
Calcium (Ca)-Total		108		0.50	mg/L	20-MAR-18	
Cesium (Cs)-Total		0.000180		0.000010	mg/L	20-MAR-18	
Chromium (Cr)-Total		0.00296		0.00050	mg/L	20-MAR-18	0.05
Cobalt (Co)-Total		0.00168		0.00010	mg/L	20-MAR-18	
Copper (Cu)-Total		0.0026		0.0010	mg/L	20-MAR-18	1
Iron (Fe)-Total		2.07		0.050	mg/L	20-MAR-18	*0.3
Lead (Pb)-Total		0.00144		0.000050	mg/L	20-MAR-18	0.01
Lithium (Li)-Total		0.0275		0.0010	mg/L	20-MAR-18	
Magnesium (Mg)-Total		46.3		0.050	mg/L	20-MAR-18	
Manganese (Mn)-Total		0.114		0.00050	mg/L	20-MAR-18	*0.05
Molybdenum (Mo)-Total		0.00215		0.000050	mg/L	20-MAR-18	
Nickel (Ni)-Total		0.00366		0.00050	mg/L	20-MAR-18	
Phosphorus (P)-Total		0.083		0.050	mg/L	20-MAR-18	

** Detection Limit for result exceeds Guideline Limit. Assessment against Guideline Limit cannot be made.

* Analytical result for this parameter exceeds Guideline Limit listed on this report. Guideline Limits applied:

Ontario Drinking Water Regulation (ODWQS) JAN.1,2017 = [Suite] - ON-DW-STANDARD+GUIDELINES

#1: Schedule 1 (Microbiological) and 2 (Chemical) Standards (JAN,2017)

#2: Ontario DW Aesthetic and Operational Guidelines

ANALYTICAL GUIDELINE REPORT

L2068971 CONTD....

Page 3 of 5

23-MAR-18 10:45 (MT)

170163 CHICKADEE LANE

Sample Details		Result	Qualifier	D.L.	Units	Analyzed	Guideline Limits			
Grouping	Analyte									
L2068971-1	MW6									
Sampled By: CLIENT on 15-MAR-18 @ 15:45										
Matrix: WATER										
Total Metals										
Potassium (K)-Total		3.57		0.050	mg/L	20-MAR-18				
Rubidium (Rb)-Total		0.00324		0.00020	mg/L	20-MAR-18				
Selenium (Se)-Total		0.000282		0.000050	mg/L	20-MAR-18	0.01			
Silicon (Si)-Total		8.78		0.10	mg/L	20-MAR-18				
Silver (Ag)-Total		<0.000050		0.000050	mg/L	20-MAR-18				
Sodium (Na)-Total		39.0		0.50	mg/L	20-MAR-18	*20	200		
Strontium (Sr)-Total		0.431		0.0010	mg/L	20-MAR-18				
Sulfur (S)-Total		27.3		0.50	mg/L	20-MAR-18				
Tellurium (Te)-Total		<0.00020		0.00020	mg/L	20-MAR-18				
Thallium (Tl)-Total		0.000028		0.000010	mg/L	20-MAR-18				
Thorium (Th)-Total		0.00039		0.00010	mg/L	20-MAR-18				
Tin (Sn)-Total		0.00156		0.00010	mg/L	20-MAR-18				
Titanium (Ti)-Total		0.0342		0.00030	mg/L	20-MAR-18				
Tungsten (W)-Total		<0.00010		0.00010	mg/L	20-MAR-18	0.02			
Uranium (U)-Total		0.00481		0.000010	mg/L	20-MAR-18				
Vanadium (V)-Total		0.00305		0.00050	mg/L	20-MAR-18				
Zinc (Zn)-Total		0.0071		0.0030	mg/L	20-MAR-18		5		
Zirconium (Zr)-Total		0.00054		0.00030	mg/L	20-MAR-18				

** Detection Limit for result exceeds Guideline Limit. Assessment against Guideline Limit cannot be made.

* Analytical result for this parameter exceeds Guideline Limit listed on this report. Guideline Limits applied:

Ontario Drinking Water Regulation (ODWQS) JAN.1,2017 = [Suite] - ON-DW-STANDARD+GUIDELINES

#1: Schedule 1 (Microbiological) and 2 (Chemical) Standards (JAN,2017)

#2: Ontario DW Aesthetic and Operational Guidelines

Reference Information

Sample Parameter Qualifier key listed:

Qualifier	Description
DLDS	Detection Limit Raised: Dilution required due to high Dissolved Solids / Electrical Conductivity.
PEHR	Parameter Exceeded Recommended Holding Time On Receipt: Proceed With Analysis As Requested.
HTC	Hardness was calculated from Total Ca and/or Mg concentrations and may be biased high (dissolved Ca/Mg results unavailable).

Methods Listed (if applicable):

ALS Test Code	Matrix	Test Description	Method Reference***
ACIDITY-ED	Water	Acidity (as CaCO ₃)	APHA 2310 B - Potentiometric Titration
Acidity is the capacity of a water sample to react with strong base. It can be measured by titration with a strong base to a designated pH endpoint, usually 8.3. If the sample is colorless and clear, titration with base to the phenolphthalein endpoint is used. For dark or turbid samples, potentiometric titration to pH 8.3 is performed.			
ALK-WT	Water	Alkalinity, Total (as CaCO ₃)	EPA 310.2
This analysis is carried out using procedures adapted from EPA Method 310.2 "Alkalinity". Total Alkalinity is determined using the methyl orange colourimetric method.			
BR-IC-N-WT	Water	Bromide in Water by IC	EPA 300.1 (mod)
Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.			
CL-IC-N-WT	Water	Chloride by IC	EPA 300.1 (mod)
Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.			
Analysis conducted in accordance with the Protocol for Analytical Methods Used in the Assessment of Properties under Part XV.1 of the Environmental Protection Act (July 1, 2011).			
COLOUR-APPARENT-WT	Water	Colour	APHA 2120
Apparent Colour is measured spectrophotometrically by comparison to platinum-cobalt standards using the single wavelength method after sample decanting. Colour measurements can be highly pH dependent, and apply to the pH of the sample as received (at time of testing), without pH adjustment. Concurrent measurement of sample pH is recommended.			
EC-WT	Water	Conductivity	APHA 2510 B
Water samples can be measured directly by immersing the conductivity cell into the sample.			
F-IC-N-WT	Water	Fluoride in Water by IC	EPA 300.1 (mod)
Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.			
HARDNESS-CALC-WT	Water	Hardness	APHA 2340 B
Hardness (also known as Total Hardness) is calculated from the sum of Calcium and Magnesium concentrations, expressed in CaCO ₃ equivalents. Dissolved Calcium and Magnesium concentrations are preferentially used for the hardness calculation.			
MET-T-CCMS-WT	Water	Total Metals in Water by CRC ICPMS	EPA 200.2/6020A (mod)
Water samples are digested with nitric and hydrochloric acids, and analyzed by CRC ICPMS.			
Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.			
Analysis conducted in accordance with the Protocol for Analytical Methods Used in the Assessment of Properties under Part XV.1 of the Environmental Protection Act (July 1, 2011).			
NH3-WT	Water	Ammonia, Total as N	EPA 350.1
Sample is measured colorimetrically. When sample is turbid a distillation step is required, sample is distilled into a solution of boric acid and measured colorimetrically.			
NO2-IC-WT	Water	Nitrite in Water by IC	EPA 300.1 (mod)
Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.			
NO3-IC-WT	Water	Nitrate in Water by IC	EPA 300.1 (mod)
Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.			
P-T-COL-WT	Water	Total P in Water by Colour	APHA 4500-P PHOSPHORUS
This analysis is carried out using procedures adapted from APHA Method 4500-P "Phosphorus". Total Phosphorus is determined colourimetrically after persulphate digestion of the sample.			
PH-WT	Water	pH	APHA 4500 H-Electrode
Water samples are analyzed directly by a calibrated pH meter.			
Analysis conducted in accordance with the Protocol for Analytical Methods Used in the Assessment of Properties under Part XV.1 of the Environmental Protection Act (July 1, 2011). Holdtime for samples under this regulation is 28 days			

Reference Information

PO4-DO-COL-WT Water Diss. Orthophosphate in Water by Colour APHA 4500-P PHOSPHORUS

This analysis is carried out using procedures adapted from APHA Method 4500-P "Phosphorus". Dissolved Orthophosphate is determined colourimetrically on a sample that has been lab or field filtered through a 0.45 micron membrane filter.

REDOX-POTENTIAL-WT Water Redox Potential APHA 2580

This analysis is carried out in accordance with the procedure described in the "APHA" method 2580 "Oxidation-Reduction Potential" 2012. Results are reported as observed oxidation-reduction potential of the platinum metal-reference electrode employed, in mV.

It is recommended that this analysis be conducted in the field.

SO4-IC-N-WT Water Sulfate in Water by IC EPA 300.1 (mod)

Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.

SOLIDS-TDS-WT Water Total Dissolved Solids APHA 2540C

This analysis is carried out using procedures adapted from APHA Method 2540 "Solids". Solids are determined gravimetrically. Total Dissolved Solids (TDS) are determined by filtering a sample through a glass fibre filter, TDS is determined by evaporating the filtrate to dryness at 180 degrees celsius.

TC,EC-QT51-WT Water Total Coliform and E. Coli APHA 9223B

This analysis is carried out using procedures adapted from APHA Method 9223 "Enzyme Substrate Coliform Test". E. coli and Total Coliform are determined simultaneously. The sample is mixed with a mixture of hydrolyzable substrates and then sealed in a multi-well packet. The packet is incubated for 18 or 24 hours and then the number of wells exhibiting a positive response are counted. The final result is obtained by comparing the positive responses to a probability table.

TURBIDITY-WT Water Turbidity APHA 2130 B

Sample result is based on a comparison of the intensity of the light scattered by the sample under defined conditions with the intensity of light scattered by a standard reference suspension under the same conditions. Sample readings are obtained from a Nephelometer.

*** ALS test methods may incorporate modifications from specified reference methods to improve performance.

Chain of Custody numbers:

17-622480

The last two letters of the above test code(s) indicate the laboratory that performed analytical analysis for that test. Refer to the list below:

Laboratory Definition Code	Laboratory Location	Laboratory Definition Code	Laboratory Location
WT	ALS ENVIRONMENTAL - WATERLOO, ONTARIO, CANADA	ED	ALS ENVIRONMENTAL - EDMONTON, ALBERTA, CANADA

GLOSSARY OF REPORT TERMS

Surrogates are compounds that are similar in behaviour to target analyte(s), but that do not normally occur in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery. In reports that display the D.L. column, laboratory objectives for surrogates are listed there.

mg/kg - milligrams per kilogram based on dry weight of sample

mg/kg wwt - milligrams per kilogram based on wet weight of sample

mg/kg lwt - milligrams per kilogram based on lipid-adjusted weight

mg/L - unit of concentration based on volume, parts per million.

< - Less than.

D.L. - The reporting limit.

N/A - Result not available. Refer to qualifier code and definition for explanation.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

Analytical results in unsigned test reports with the DRAFT watermark are subject to change, pending final QC review.

Application of guidelines is provided "as is" without warranty of any kind, either expressed or implied, including, but not limited to fitness for a particular purpose, or non-infringement. ALS assumes no responsibility for errors or omissions in the information.



Quality Control Report

Workorder: L2068971

Report Date: 23-MAR-18

Page 2 of 12

Client: PALMER ENVIRONMENTAL CONSULTING GROUP INC. (Richmond Hill)
74 Berkeley Street
Toronto ON M5V 2W7
Contact: Ryan Polick

Test	Matrix	Reference	Result	Qualifier	Units	RPD	Limit	Analyzed
COLOUR-APPARENT-WT Water								
Batch	R3987300							
WG2734505-3 DUP		L2068994-1						
Colour, Apparent		9.1	8.7		CU	4.3	20	17-MAR-18
WG2734505-2 LCS								
Colour, Apparent			102.3		%		85-115	17-MAR-18
WG2734505-1 MB								
Colour, Apparent			<2.0		CU		2	17-MAR-18
EC-WT Water								
Batch	R3989048							
WG2734455-4 DUP		WG2734455-3						
Conductivity		3510	3480		umhos/cm	0.9	10	17-MAR-18
WG2734455-2 LCS								
Conductivity			100.5		%		90-110	17-MAR-18
WG2734455-1 MB								
Conductivity			<3.0		umhos/cm		3	17-MAR-18
F-IC-N-WT Water								
Batch	R3990051							
WG2735070-14 DUP		WG2735070-13						
Fluoride (F)		0.042	0.042		mg/L	0.9	20	19-MAR-18
WG2735070-12 LCS								
Fluoride (F)			101.5		%		90-110	19-MAR-18
WG2735070-11 MB								
Fluoride (F)			<0.020		mg/L		0.02	19-MAR-18
WG2735070-15 MS		WG2735070-13						
Fluoride (F)			101.1		%		75-125	19-MAR-18
MET-T-CCMS-WT Water								
Batch	R3987814							
WG2734886-4 DUP		WG2734886-3						
Aluminum (Al)-Total		0.172	0.169		mg/L	1.5	20	19-MAR-18
Antimony (Sb)-Total		<0.00010	<0.00010	RPD-NA	mg/L	N/A	20	19-MAR-18
Arsenic (As)-Total		0.00056	0.00058		mg/L	3.4	20	19-MAR-18
Barium (Ba)-Total		0.0431	0.0428		mg/L	0.8	20	19-MAR-18
Beryllium (Be)-Total		<0.00010	<0.00010	RPD-NA	mg/L	N/A	20	19-MAR-18
Bismuth (Bi)-Total		<0.000050	<0.000050	RPD-NA	mg/L	N/A	20	19-MAR-18
Boron (B)-Total		0.031	0.031		mg/L	1.6	20	19-MAR-18
Cadmium (Cd)-Total		0.0000067	0.0000090	J	mg/L	0.0000023	0.00001	19-MAR-18
Calcium (Ca)-Total		87.1	87.9		mg/L	0.9	20	19-MAR-18



Quality Control Report

Workorder: L2068971

Report Date: 23-MAR-18

Page 3 of 12

Client: PALMER ENVIRONMENTAL CONSULTING GROUP INC. (Richmond Hill)
74 Berkeley Street
Toronto ON M5V 2W7
Contact: Ryan Polick

Test	Matrix	Reference	Result	Qualifier	Units	RPD	Limit	Analyzed
MET-T-CCMS-WT	Water							
Batch	R3987814							
WG2734886-4 DUP		WG2734886-3						
Chromium (Cr)-Total		<0.00050	<0.00050	RPD-NA	mg/L	N/A	20	19-MAR-18
Cesium (Cs)-Total		0.000017	0.000015		mg/L	14	20	19-MAR-18
Cobalt (Co)-Total		0.00019	0.00018		mg/L	2.0	20	19-MAR-18
Copper (Cu)-Total		0.0010	0.0010		mg/L	0.6	20	19-MAR-18
Iron (Fe)-Total		0.384	0.387		mg/L	0.8	20	19-MAR-18
Lead (Pb)-Total		0.000202	0.000204		mg/L	1.3	20	19-MAR-18
Lithium (Li)-Total		0.0016	0.0015		mg/L	1.1	20	19-MAR-18
Magnesium (Mg)-Total		17.0	16.7		mg/L	2.1	20	19-MAR-18
Manganese (Mn)-Total		0.0822	0.0816		mg/L	0.8	20	19-MAR-18
Molybdenum (Mo)-Total		0.00186	0.00184		mg/L	1.4	20	19-MAR-18
Nickel (Ni)-Total		0.00065	0.00061		mg/L	7.1	20	19-MAR-18
Phosphorus (P)-Total		<0.050	<0.050	RPD-NA	mg/L	N/A	20	19-MAR-18
Potassium (K)-Total		3.08	3.05		mg/L	0.9	20	19-MAR-18
Rubidium (Rb)-Total		0.00067	0.00068		mg/L	1.8	20	19-MAR-18
Selenium (Se)-Total		0.000137	0.000124		mg/L	9.5	20	19-MAR-18
Silicon (Si)-Total		2.92	2.94		mg/L	0.5	20	19-MAR-18
Silver (Ag)-Total		<0.000050	<0.000050	RPD-NA	mg/L	N/A	20	19-MAR-18
Sodium (Na)-Total		26.6	26.1		mg/L	1.8	20	19-MAR-18
Strontium (Sr)-Total		0.267	0.274		mg/L	2.7	20	19-MAR-18
Sulfur (S)-Total		15.4	15.5		mg/L	0.4	25	19-MAR-18
Thallium (Tl)-Total		<0.000010	<0.000010	RPD-NA	mg/L	N/A	20	19-MAR-18
Tellurium (Te)-Total		<0.00020	<0.00020	RPD-NA	mg/L	N/A	20	19-MAR-18
Thorium (Th)-Total		<0.00010	<0.00010	RPD-NA	mg/L	N/A	25	19-MAR-18
Tin (Sn)-Total		<0.00010	<0.00010	RPD-NA	mg/L	N/A	20	19-MAR-18
Titanium (Ti)-Total		0.00441	0.00444		mg/L	0.5	20	19-MAR-18
Tungsten (W)-Total		<0.00010	<0.00010	RPD-NA	mg/L	N/A	20	19-MAR-18
Uranium (U)-Total		0.00109	0.00112		mg/L	3.2	20	19-MAR-18
Vanadium (V)-Total		0.00061	0.00061		mg/L	0.0	20	19-MAR-18
Zinc (Zn)-Total		<0.0030	<0.0030	RPD-NA	mg/L	N/A	20	19-MAR-18
Zirconium (Zr)-Total		<0.00030	<0.00030	RPD-NA	mg/L	N/A	20	19-MAR-18
WG2734886-2 LCS								
Aluminum (Al)-Total			101.0		%		80-120	19-MAR-18
Antimony (Sb)-Total			107.4		%		80-120	19-MAR-18



Quality Control Report

Workorder: L2068971

Report Date: 23-MAR-18

Page 4 of 12

Client: PALMER ENVIRONMENTAL CONSULTING GROUP INC. (Richmond Hill)
74 Berkeley Street

Toronto ON M5V 2W7

Contact: Ryan Polick

Test	Matrix	Reference	Result	Qualifier	Units	RPD	Limit	Analyzed
MET-T-CCMS-WT	Water							
Batch	R3987814							
WG2734886-2	LCS							
Arsenic (As)-Total			101.8		%		80-120	19-MAR-18
Barium (Ba)-Total			101.7		%		80-120	19-MAR-18
Beryllium (Be)-Total			99.5		%		80-120	19-MAR-18
Bismuth (Bi)-Total			99.7		%		80-120	19-MAR-18
Boron (B)-Total			98.4		%		80-120	19-MAR-18
Cadmium (Cd)-Total			102.5		%		80-120	19-MAR-18
Calcium (Ca)-Total			100.3		%		80-120	19-MAR-18
Chromium (Cr)-Total			102.6		%		80-120	19-MAR-18
Cesium (Cs)-Total			104.4		%		80-120	19-MAR-18
Cobalt (Co)-Total			99.8		%		80-120	19-MAR-18
Copper (Cu)-Total			99.2		%		80-120	19-MAR-18
Iron (Fe)-Total			98.5		%		80-120	19-MAR-18
Lead (Pb)-Total			102.5		%		80-120	19-MAR-18
Lithium (Li)-Total			98.0		%		80-120	19-MAR-18
Magnesium (Mg)-Total			103.1		%		80-120	19-MAR-18
Manganese (Mn)-Total			102.9		%		80-120	19-MAR-18
Molybdenum (Mo)-Total			101.1		%		80-120	19-MAR-18
Nickel (Ni)-Total			100.2		%		80-120	19-MAR-18
Phosphorus (P)-Total			102.0		%		70-130	19-MAR-18
Potassium (K)-Total			102.0		%		80-120	19-MAR-18
Rubidium (Rb)-Total			102.5		%		80-120	19-MAR-18
Selenium (Se)-Total			102.7		%		80-120	19-MAR-18
Silicon (Si)-Total			117.4		%		60-140	19-MAR-18
Silver (Ag)-Total			105.0		%		80-120	19-MAR-18
Sodium (Na)-Total			103.7		%		80-120	19-MAR-18
Strontium (Sr)-Total			99.7		%		80-120	19-MAR-18
Sulfur (S)-Total			98.0		%		80-120	19-MAR-18
Thallium (Tl)-Total			99.8		%		80-120	19-MAR-18
Tellurium (Te)-Total			107.1		%		80-120	19-MAR-18
Thorium (Th)-Total			101.4		%		70-130	19-MAR-18
Tin (Sn)-Total			103.1		%		80-120	19-MAR-18
Titanium (Ti)-Total			98.3		%		80-120	19-MAR-18
Tungsten (W)-Total			99.5		%		80-120	19-MAR-18



Quality Control Report

Workorder: L2068971

Report Date: 23-MAR-18

Page 5 of 12

Client: PALMER ENVIRONMENTAL CONSULTING GROUP INC. (Richmond Hill)

74 Berkeley Street

Toronto ON M5V 2W7

Contact: Ryan Polick

Test	Matrix	Reference	Result	Qualifier	Units	RPD	Limit	Analyzed
MET-T-CCMS-WT	Water							
Batch	R3987814							
WG2734886-2 LCS								
Uranium (U)-Total			104.2		%		80-120	19-MAR-18
Vanadium (V)-Total			101.7		%		80-120	19-MAR-18
Zinc (Zn)-Total			97.6		%		80-120	19-MAR-18
Zirconium (Zr)-Total			95.4		%		80-120	19-MAR-18
WG2734886-1 MB								
Aluminum (Al)-Total			<0.0050		mg/L		0.005	19-MAR-18
Antimony (Sb)-Total			<0.00010		mg/L		0.0001	19-MAR-18
Arsenic (As)-Total			<0.00010		mg/L		0.0001	19-MAR-18
Barium (Ba)-Total			<0.00020		mg/L		0.0002	19-MAR-18
Beryllium (Be)-Total			<0.00010		mg/L		0.0001	19-MAR-18
Bismuth (Bi)-Total			<0.000050		mg/L		0.00005	19-MAR-18
Boron (B)-Total			<0.010		mg/L		0.01	19-MAR-18
Cadmium (Cd)-Total			<0.000050		mg/L		0.00005	19-MAR-18
Calcium (Ca)-Total			<0.50		mg/L		0.5	19-MAR-18
Chromium (Cr)-Total			<0.00050		mg/L		0.0005	19-MAR-18
Cesium (Cs)-Total			<0.000010		mg/L		0.00001	19-MAR-18
Cobalt (Co)-Total			<0.00010		mg/L		0.0001	19-MAR-18
Copper (Cu)-Total			<0.0010		mg/L		0.001	19-MAR-18
Iron (Fe)-Total			<0.050		mg/L		0.05	19-MAR-18
Lead (Pb)-Total			<0.000050		mg/L		0.00005	19-MAR-18
Lithium (Li)-Total			<0.0010		mg/L		0.001	19-MAR-18
Magnesium (Mg)-Total			<0.050		mg/L		0.05	19-MAR-18
Manganese (Mn)-Total			<0.00050		mg/L		0.0005	19-MAR-18
Molybdenum (Mo)-Total			<0.000050		mg/L		0.00005	19-MAR-18
Nickel (Ni)-Total			<0.00050		mg/L		0.0005	19-MAR-18
Phosphorus (P)-Total			<0.050		mg/L		0.05	19-MAR-18
Potassium (K)-Total			<0.050		mg/L		0.05	19-MAR-18
Rubidium (Rb)-Total			<0.00020		mg/L		0.0002	19-MAR-18
Selenium (Se)-Total			<0.000050		mg/L		0.00005	19-MAR-18
Silicon (Si)-Total			<0.10		mg/L		0.1	19-MAR-18
Silver (Ag)-Total			<0.000050		mg/L		0.00005	19-MAR-18
Sodium (Na)-Total			<0.50		mg/L		0.5	19-MAR-18
Strontium (Sr)-Total			<0.0010		mg/L		0.001	19-MAR-18
Sulfur (S)-Total			<0.50		mg/L		0.5	19-MAR-18



Quality Control Report

Workorder: L2068971

Report Date: 23-MAR-18

Page 6 of 12

Client: PALMER ENVIRONMENTAL CONSULTING GROUP INC. (Richmond Hill)
74 Berkeley Street
Toronto ON M5V 2W7
Contact: Ryan Polick

Test	Matrix	Reference	Result	Qualifier	Units	RPD	Limit	Analyzed
MET-T-CCMS-WT	Water							
Batch	R3987814							
WG2734886-1 MB								
Thallium (Tl)-Total			<0.000010		mg/L		0.00001	19-MAR-18
Tellurium (Te)-Total			<0.00020		mg/L		0.0002	19-MAR-18
Thorium (Th)-Total			<0.00010		mg/L		0.0001	19-MAR-18
Tin (Sn)-Total			<0.00010		mg/L		0.0001	19-MAR-18
Titanium (Ti)-Total			<0.00030		mg/L		0.0003	19-MAR-18
Tungsten (W)-Total			<0.00010		mg/L		0.0001	19-MAR-18
Uranium (U)-Total			<0.000010		mg/L		0.00001	19-MAR-18
Vanadium (V)-Total			<0.00050		mg/L		0.0005	19-MAR-18
Zinc (Zn)-Total			<0.0030		mg/L		0.003	19-MAR-18
Zirconium (Zr)-Total			<0.00030		mg/L		0.0003	19-MAR-18
WG2734886-5 MS		WG2734886-6						
Aluminum (Al)-Total			96.6		%		70-130	19-MAR-18
Antimony (Sb)-Total			102.5		%		70-130	19-MAR-18
Arsenic (As)-Total			103.9		%		70-130	19-MAR-18
Barium (Ba)-Total			98.3		%		70-130	19-MAR-18
Beryllium (Be)-Total			98.7		%		70-130	19-MAR-18
Bismuth (Bi)-Total			99.2		%		70-130	19-MAR-18
Boron (B)-Total			N/A	MS-B	%		-	19-MAR-18
Cadmium (Cd)-Total			100.8		%		70-130	19-MAR-18
Calcium (Ca)-Total			N/A	MS-B	%		-	19-MAR-18
Chromium (Cr)-Total			102.3		%		70-130	19-MAR-18
Cesium (Cs)-Total			99.7		%		70-130	19-MAR-18
Cobalt (Co)-Total			99.7		%		70-130	19-MAR-18
Copper (Cu)-Total			97.3		%		70-130	19-MAR-18
Iron (Fe)-Total			N/A	MS-B	%		-	19-MAR-18
Lead (Pb)-Total			99.2		%		70-130	19-MAR-18
Lithium (Li)-Total			N/A	MS-B	%		-	19-MAR-18
Magnesium (Mg)-Total			N/A	MS-B	%		-	19-MAR-18
Manganese (Mn)-Total			N/A	MS-B	%		-	19-MAR-18
Molybdenum (Mo)-Total			100.6		%		70-130	19-MAR-18
Nickel (Ni)-Total			97.9		%		70-130	19-MAR-18
Phosphorus (P)-Total			110.4		%		70-130	19-MAR-18
Potassium (K)-Total			107.6		%		70-130	19-MAR-18
Rubidium (Rb)-Total			98.1		%		70-130	19-MAR-18



Quality Control Report

Workorder: L2068971

Report Date: 23-MAR-18

Page 8 of 12

Client: PALMER ENVIRONMENTAL CONSULTING GROUP INC. (Richmond Hill)
74 Berkeley Street
Toronto ON M5V 2W7

Contact: Ryan Polick

Test	Matrix	Reference	Result	Qualifier	Units	RPD	Limit	Analyzed
NO2-IC-WT	Water							
Batch R3990051								
WG2735070-15 MS		WG2735070-13						
Nitrite (as N)			93.0		%		70-130	19-MAR-18
NO3-IC-WT	Water							
Batch R3990051								
WG2735070-14 DUP		WG2735070-13						
Nitrate (as N)		4.99	4.98		mg/L	0.1	25	19-MAR-18
WG2735070-12 LCS								
Nitrate (as N)			99.3		%		70-130	19-MAR-18
WG2735070-11 MB								
Nitrate (as N)			<0.020		mg/L		0.02	19-MAR-18
WG2735070-15 MS		WG2735070-13						
Nitrate (as N)			N/A	MS-B	%		-	19-MAR-18
P-T-COL-WT	Water							
Batch R3988985								
WG2735183-3 DUP		L2068891-1						
Phosphorus, Total		1.56	1.52		mg/L	2.9	20	20-MAR-18
WG2735183-2 LCS								
Phosphorus, Total			91.0		%		80-120	20-MAR-18
WG2735183-1 MB								
Phosphorus, Total			<0.0030		mg/L		0.003	20-MAR-18
WG2735183-4 MS		L2068891-1						
Phosphorus, Total			N/A	MS-B	%		-	20-MAR-18
PH-WT	Water							
Batch R3989048								
WG2734455-4 DUP		WG2734455-3						
pH		7.60	7.62	J	pH units	0.02	0.2	17-MAR-18
WG2734455-2 LCS								
pH			6.97		pH units		6.9-7.1	17-MAR-18
PO4-DO-COL-WT	Water							
Batch R3987616								
WG2735008-3 DUP		L2068487-1						
Orthophosphate-Dissolved (as P)		0.0176	0.0151		mg/L	15	30	19-MAR-18
WG2735008-2 LCS								
Orthophosphate-Dissolved (as P)			100.2		%		70-130	19-MAR-18
WG2735008-1 MB								
Orthophosphate-Dissolved (as P)			<0.0030		mg/L		0.003	19-MAR-18



Quality Control Report

Workorder: L2068971

Report Date: 23-MAR-18

Page 9 of 12

Client: PALMER ENVIRONMENTAL CONSULTING GROUP INC. (Richmond Hill)
74 Berkeley Street
Toronto ON M5V 2W7
Contact: Ryan Polick

Test	Matrix	Reference	Result	Qualifier	Units	RPD	Limit	Analyzed
PO4-DO-COL-WT	Water							
Batch R3987616								
WG2735008-4 MS		L2068487-1						
Orthophosphate-Dissolved (as P)			101.9		%		70-130	19-MAR-18
REDOX-POTENTIAL-WT	Water							
Batch R3991168								
WG2735834-1 DUP		L2068891-1						
Redox Potential		336	333		mV	0.9	25	20-MAR-18
SO4-IC-N-WT	Water							
Batch R3990051								
WG2735070-14 DUP		WG2735070-13						
Sulfate (SO4)		15.5	15.4		mg/L	0.8	20	19-MAR-18
WG2735070-12 LCS								
Sulfate (SO4)			100.8		%		90-110	19-MAR-18
WG2735070-11 MB								
Sulfate (SO4)			<0.30		mg/L		0.3	19-MAR-18
WG2735070-15 MS		WG2735070-13						
Sulfate (SO4)			100.8		%		75-125	19-MAR-18
SOLIDS-TDS-WT	Water							
Batch R3988269								
WG2734727-3 DUP		L2068327-2						
Total Dissolved Solids		635	638		mg/L	0.4	20	18-MAR-18
WG2734727-2 LCS								
Total Dissolved Solids			97.9		%		85-115	18-MAR-18
WG2734727-1 MB								
Total Dissolved Solids			<10		mg/L		10	18-MAR-18
TC,EC-QT51-WT	Water							
Batch R3987530								
WG2734483-2 DUP		L2068440-1						
Total Coliforms		0	0		MPN/100mL	0.0	65	18-MAR-18
Escherichia Coli		0	0		MPN/100mL	0.0	65	18-MAR-18
WG2734483-1 MB								
Total Coliforms			0		MPN/100mL		1	18-MAR-18
Escherichia Coli			0		MPN/100mL		1	18-MAR-18
TURBIDITY-WT	Water							



Quality Control Report

Workorder: L2068971

Report Date: 23-MAR-18

Page 10 of 12

Client: PALMER ENVIRONMENTAL CONSULTING GROUP INC. (Richmond Hill)
74 Berkeley Street
Toronto ON M5V 2W7
Contact: Ryan Polick

Test	Matrix	Reference	Result	Qualifier	Units	RPD	Limit	Analyzed
TURBIDITY-WT	Water							
Batch	R3987229							
WG2734457-3	DUP	L2068994-1						
Turbidity		1.39	1.34		NTU	3.7	15	17-MAR-18
WG2734457-2	LCS							
Turbidity			104.0		%		85-115	17-MAR-18
WG2734457-1	MB							
Turbidity			<0.10		NTU		0.1	17-MAR-18

Quality Control Report

Workorder: L2068971

Report Date: 23-MAR-18

Client: PALMER ENVIRONMENTAL CONSULTING GROUP INC. (Richmond Hill)
74 Berkeley Street
Toronto ON M5V 2W7
Contact: Ryan Polick

Page 11 of 12

Legend:

Limit	ALS Control Limit (Data Quality Objectives)
DUP	Duplicate
RPD	Relative Percent Difference
N/A	Not Available
LCS	Laboratory Control Sample
SRM	Standard Reference Material
MS	Matrix Spike
MSD	Matrix Spike Duplicate
ADE	Average Desorption Efficiency
MB	Method Blank
IRM	Internal Reference Material
CRM	Certified Reference Material
CCV	Continuing Calibration Verification
CVS	Calibration Verification Standard
LCSD	Laboratory Control Sample Duplicate

Sample Parameter Qualifier Definitions:

Qualifier	Description
J	Duplicate results and limits are expressed in terms of absolute difference.
MS-B	Matrix Spike recovery could not be accurately calculated due to high analyte background in sample.
RPD-NA	Relative Percent Difference Not Available due to result(s) being less than detection limit.

Quality Control Report

Workorder: L2068971

Report Date: 23-MAR-18

Client: PALMER ENVIRONMENTAL CONSULTING GROUP INC. (Richmond Hill)
74 Berkeley Street
Toronto ON M5V 2W7
Contact: Ryan Polick

Page 12 of 12

Hold Time Exceedances:

ALS Product Description	Sample ID	Sampling Date	Date Processed	Rec. HT	Actual HT	Units	Qualifier
Physical Tests							
Redox Potential	1	15-MAR-18 15:45	20-MAR-18 21:00	0.25	125	hours	EHTR-FM

Legend & Qualifier Definitions:

EHTR-FM: Exceeded ALS recommended hold time prior to sample receipt. Field Measurement recommended.
EHTR: Exceeded ALS recommended hold time prior to sample receipt.
EHTL: Exceeded ALS recommended hold time prior to analysis. Sample was received less than 24 hours prior to expiry.
EHT: Exceeded ALS recommended hold time prior to analysis.
Rec. HT: ALS recommended hold time (see units).

Notes*:

Where actual sampling date is not provided to ALS, the date (& time) of receipt is used for calculation purposes.
Where actual sampling time is not provided to ALS, the earlier of 12 noon on the sampling date or the time (& date) of receipt is used for calculation purposes. Samples for L2068971 were received on 15-MAR-18 17:00.

ALS recommended hold times may vary by province. They are assigned to meet known provincial and/or federal government requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by the US EPA, APHA Standard Methods, or Environment Canada (where available). For more information, please contact ALS.


The ALS Quality Control Report is provided to ALS clients upon request. ALS includes comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against pre-determined data quality objectives to provide confidence in the accuracy of associated test results.

Please note that this report may contain QC results from anonymous Sample Duplicates and Matrix Spikes that do not originate from this Work Order.

APPENDIX “D”


Figure 4 Subwatershed Boundary - Humber River Watershed, Toronto and Region Conservation


Figure 3-2: Subwatersheds

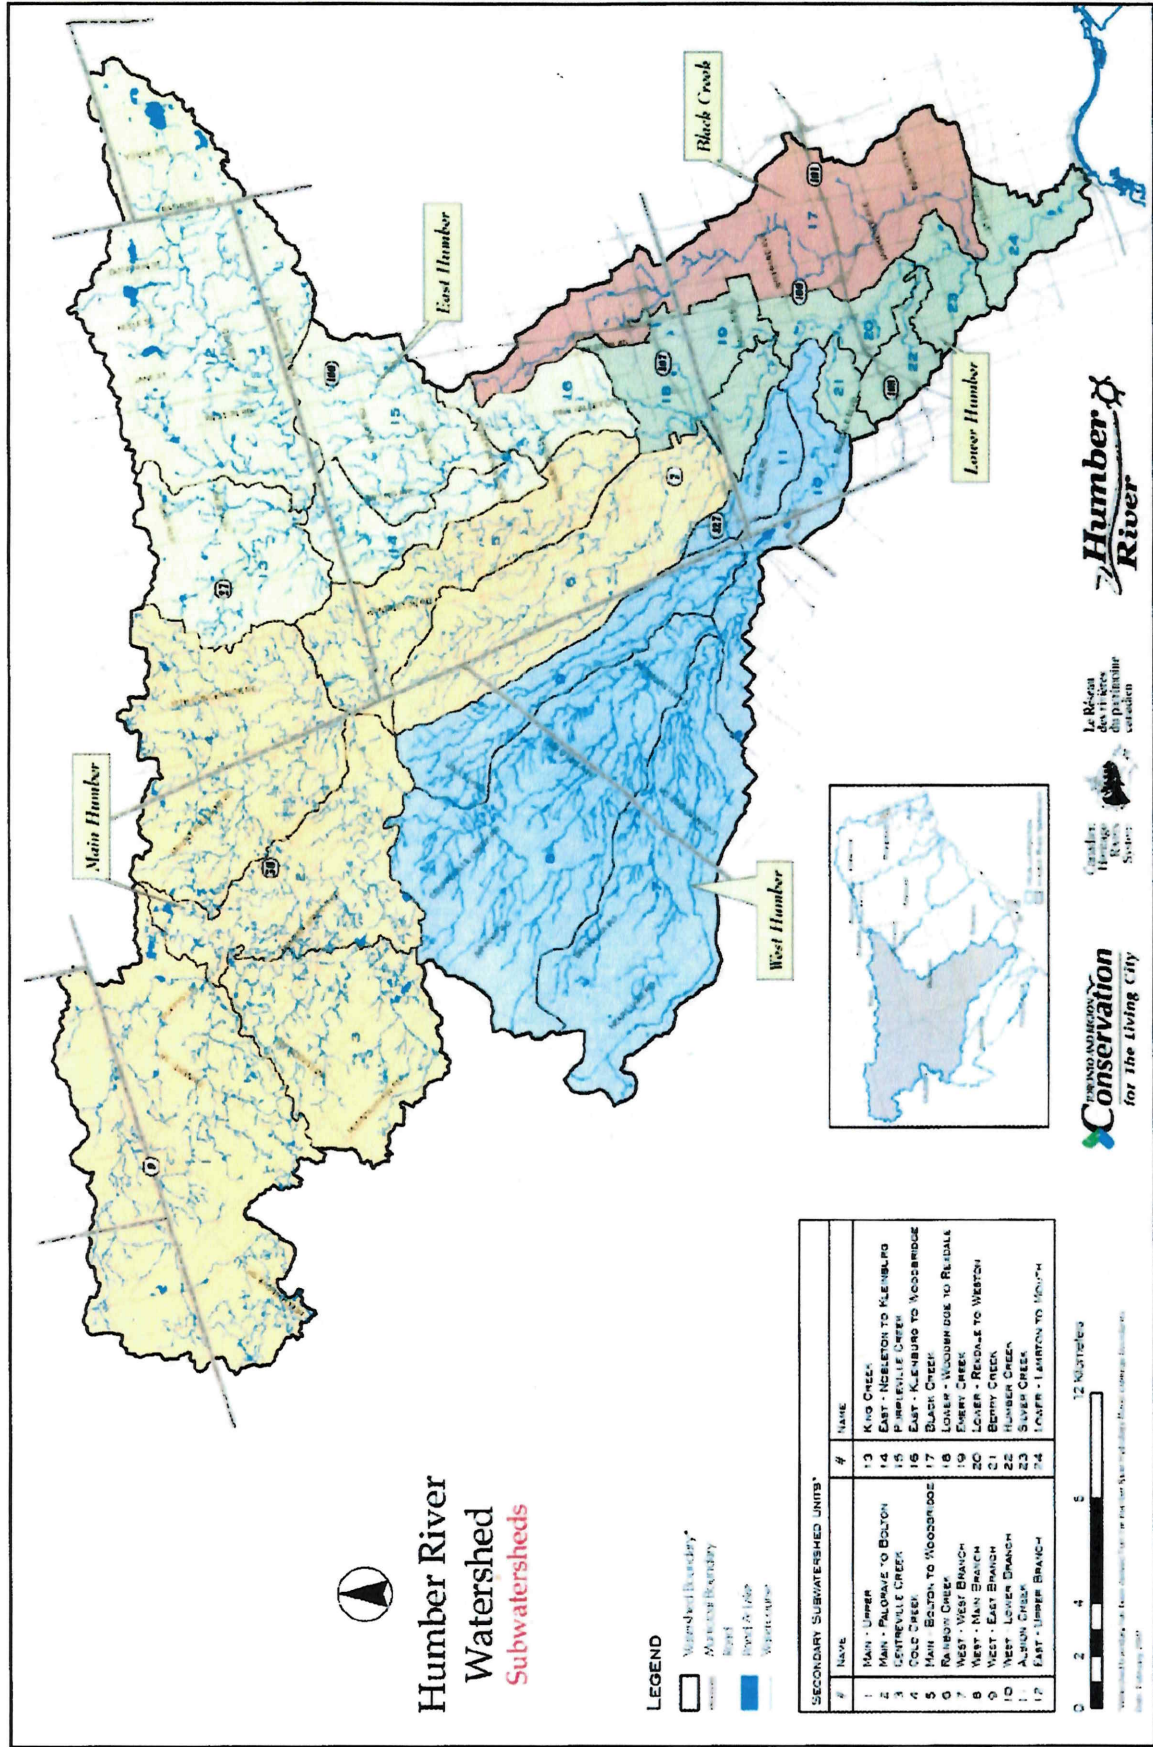

APPENDIX “E”

**Region of Peel, Figures 5 and 8, Bolton Residential Expansion Study, Infrastructure Report, Blue Plan
Engineering Consultants Limited, June 16th 2014**

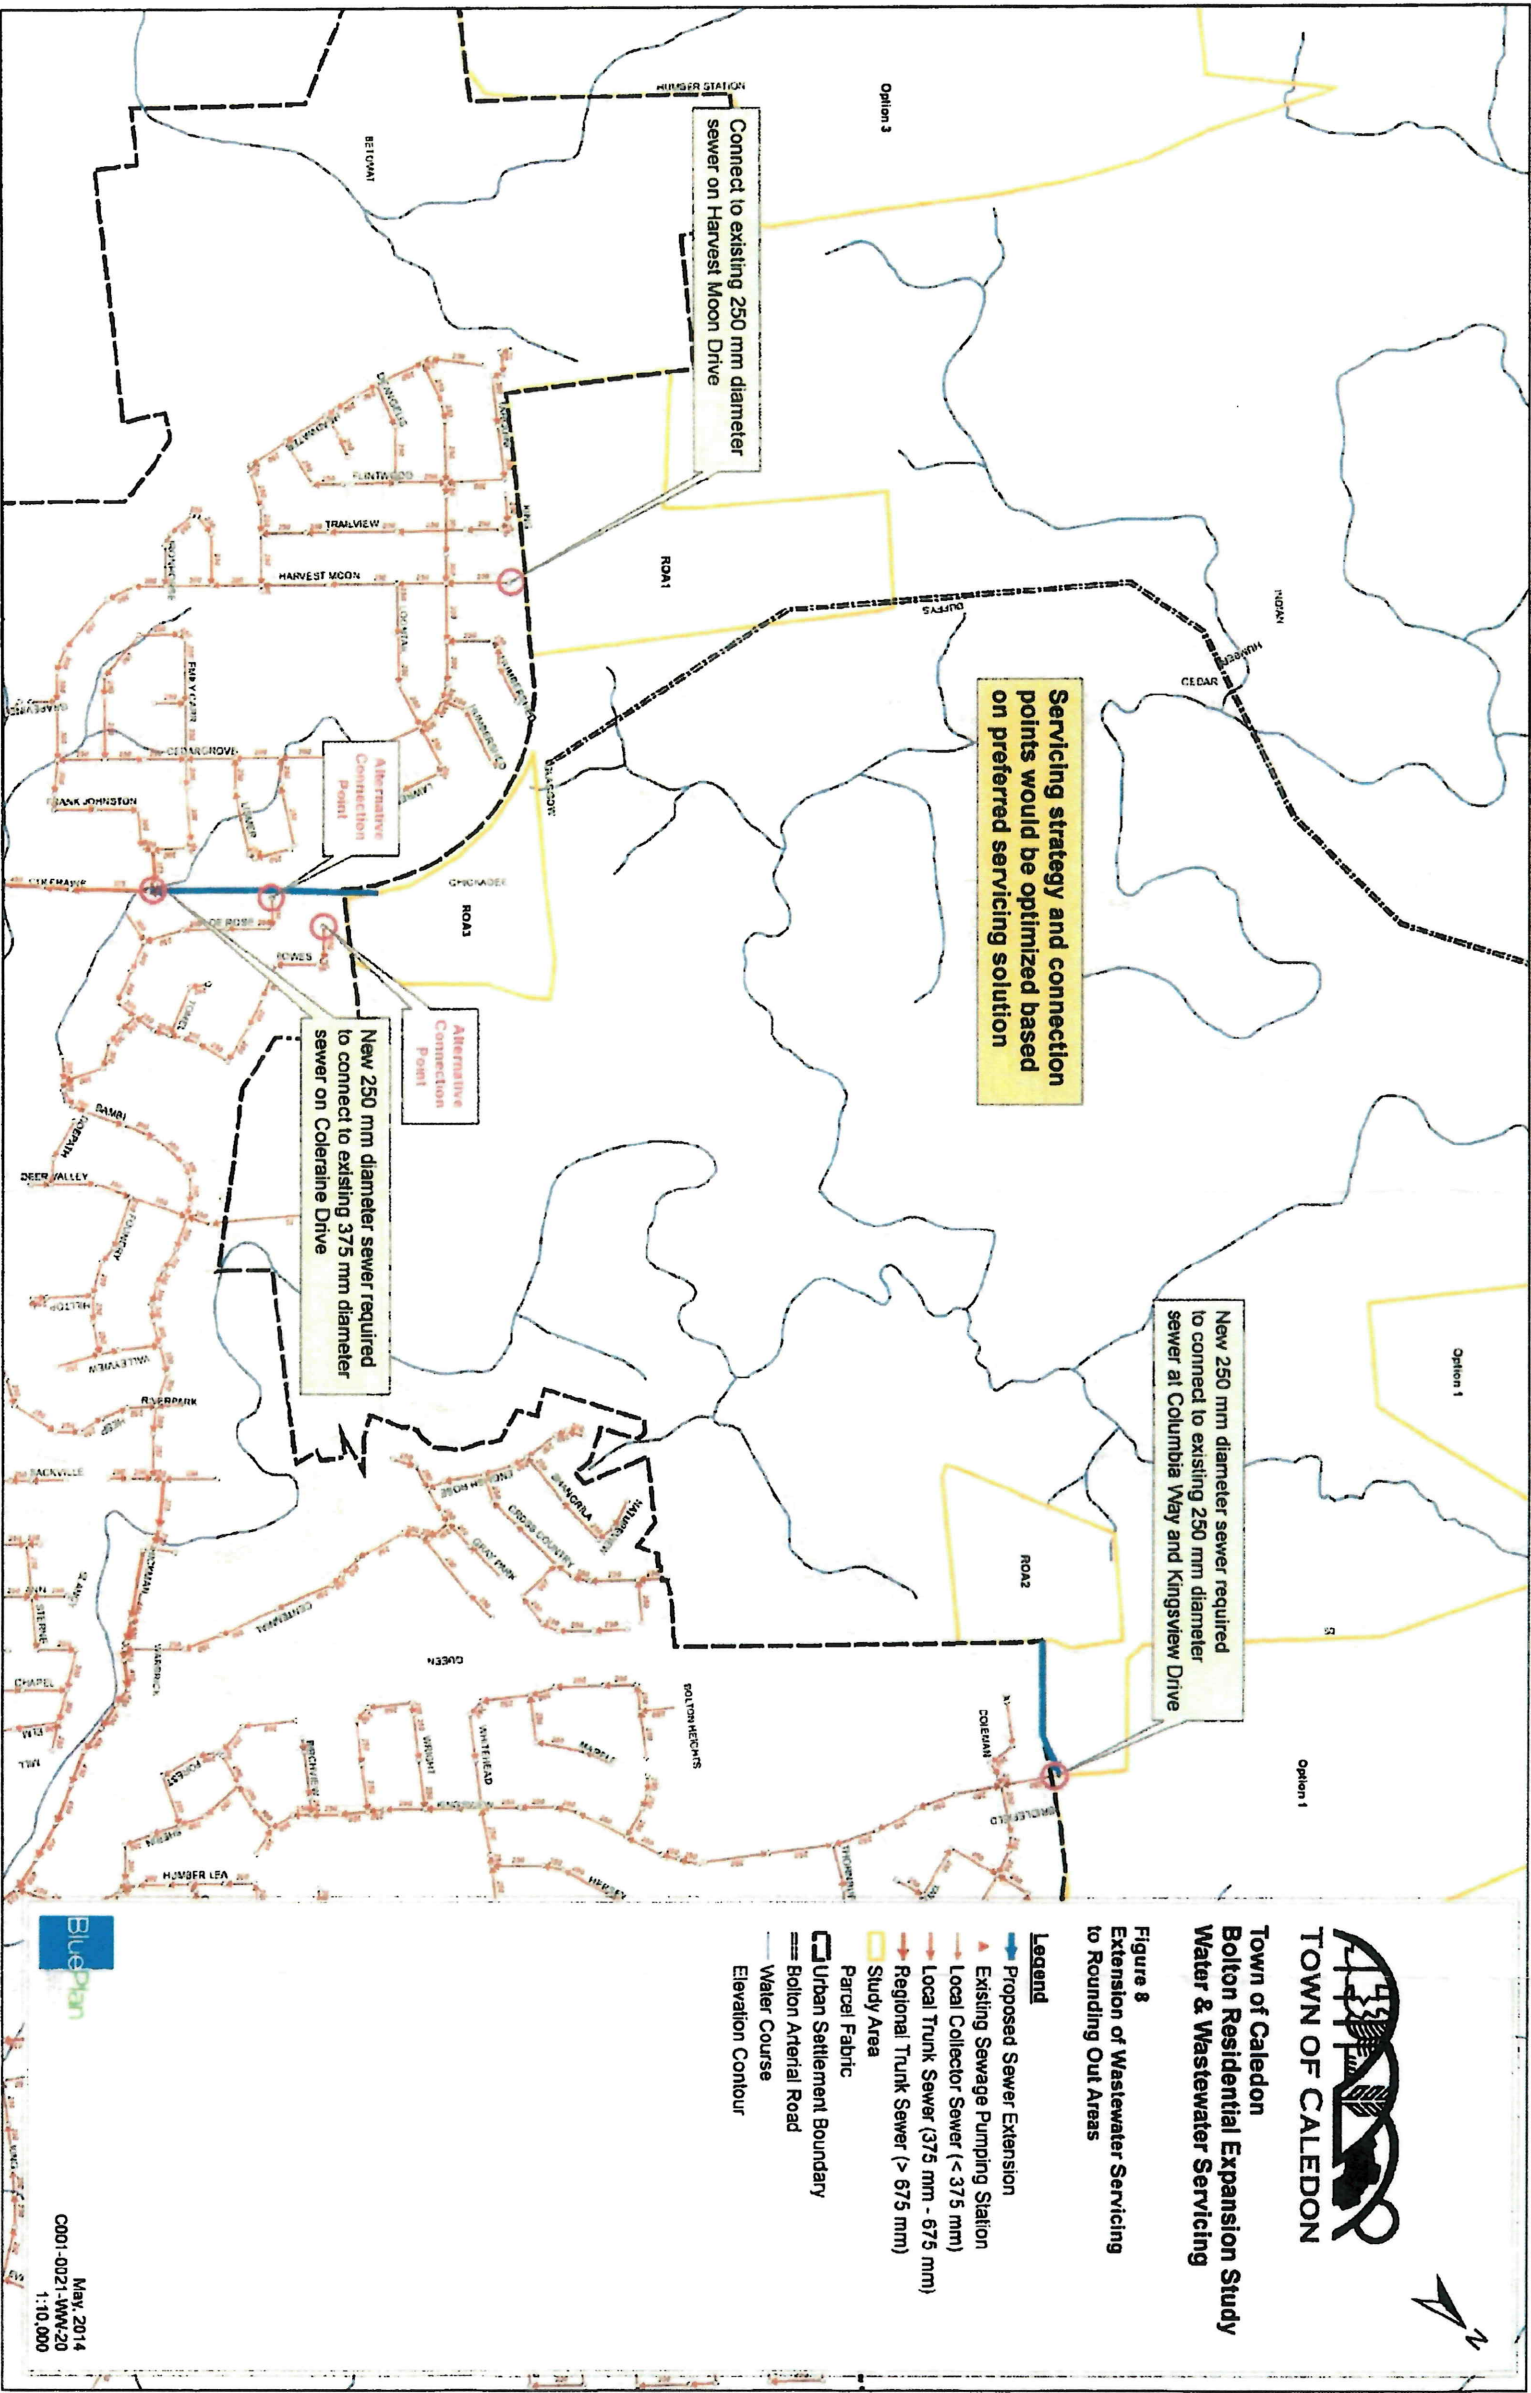

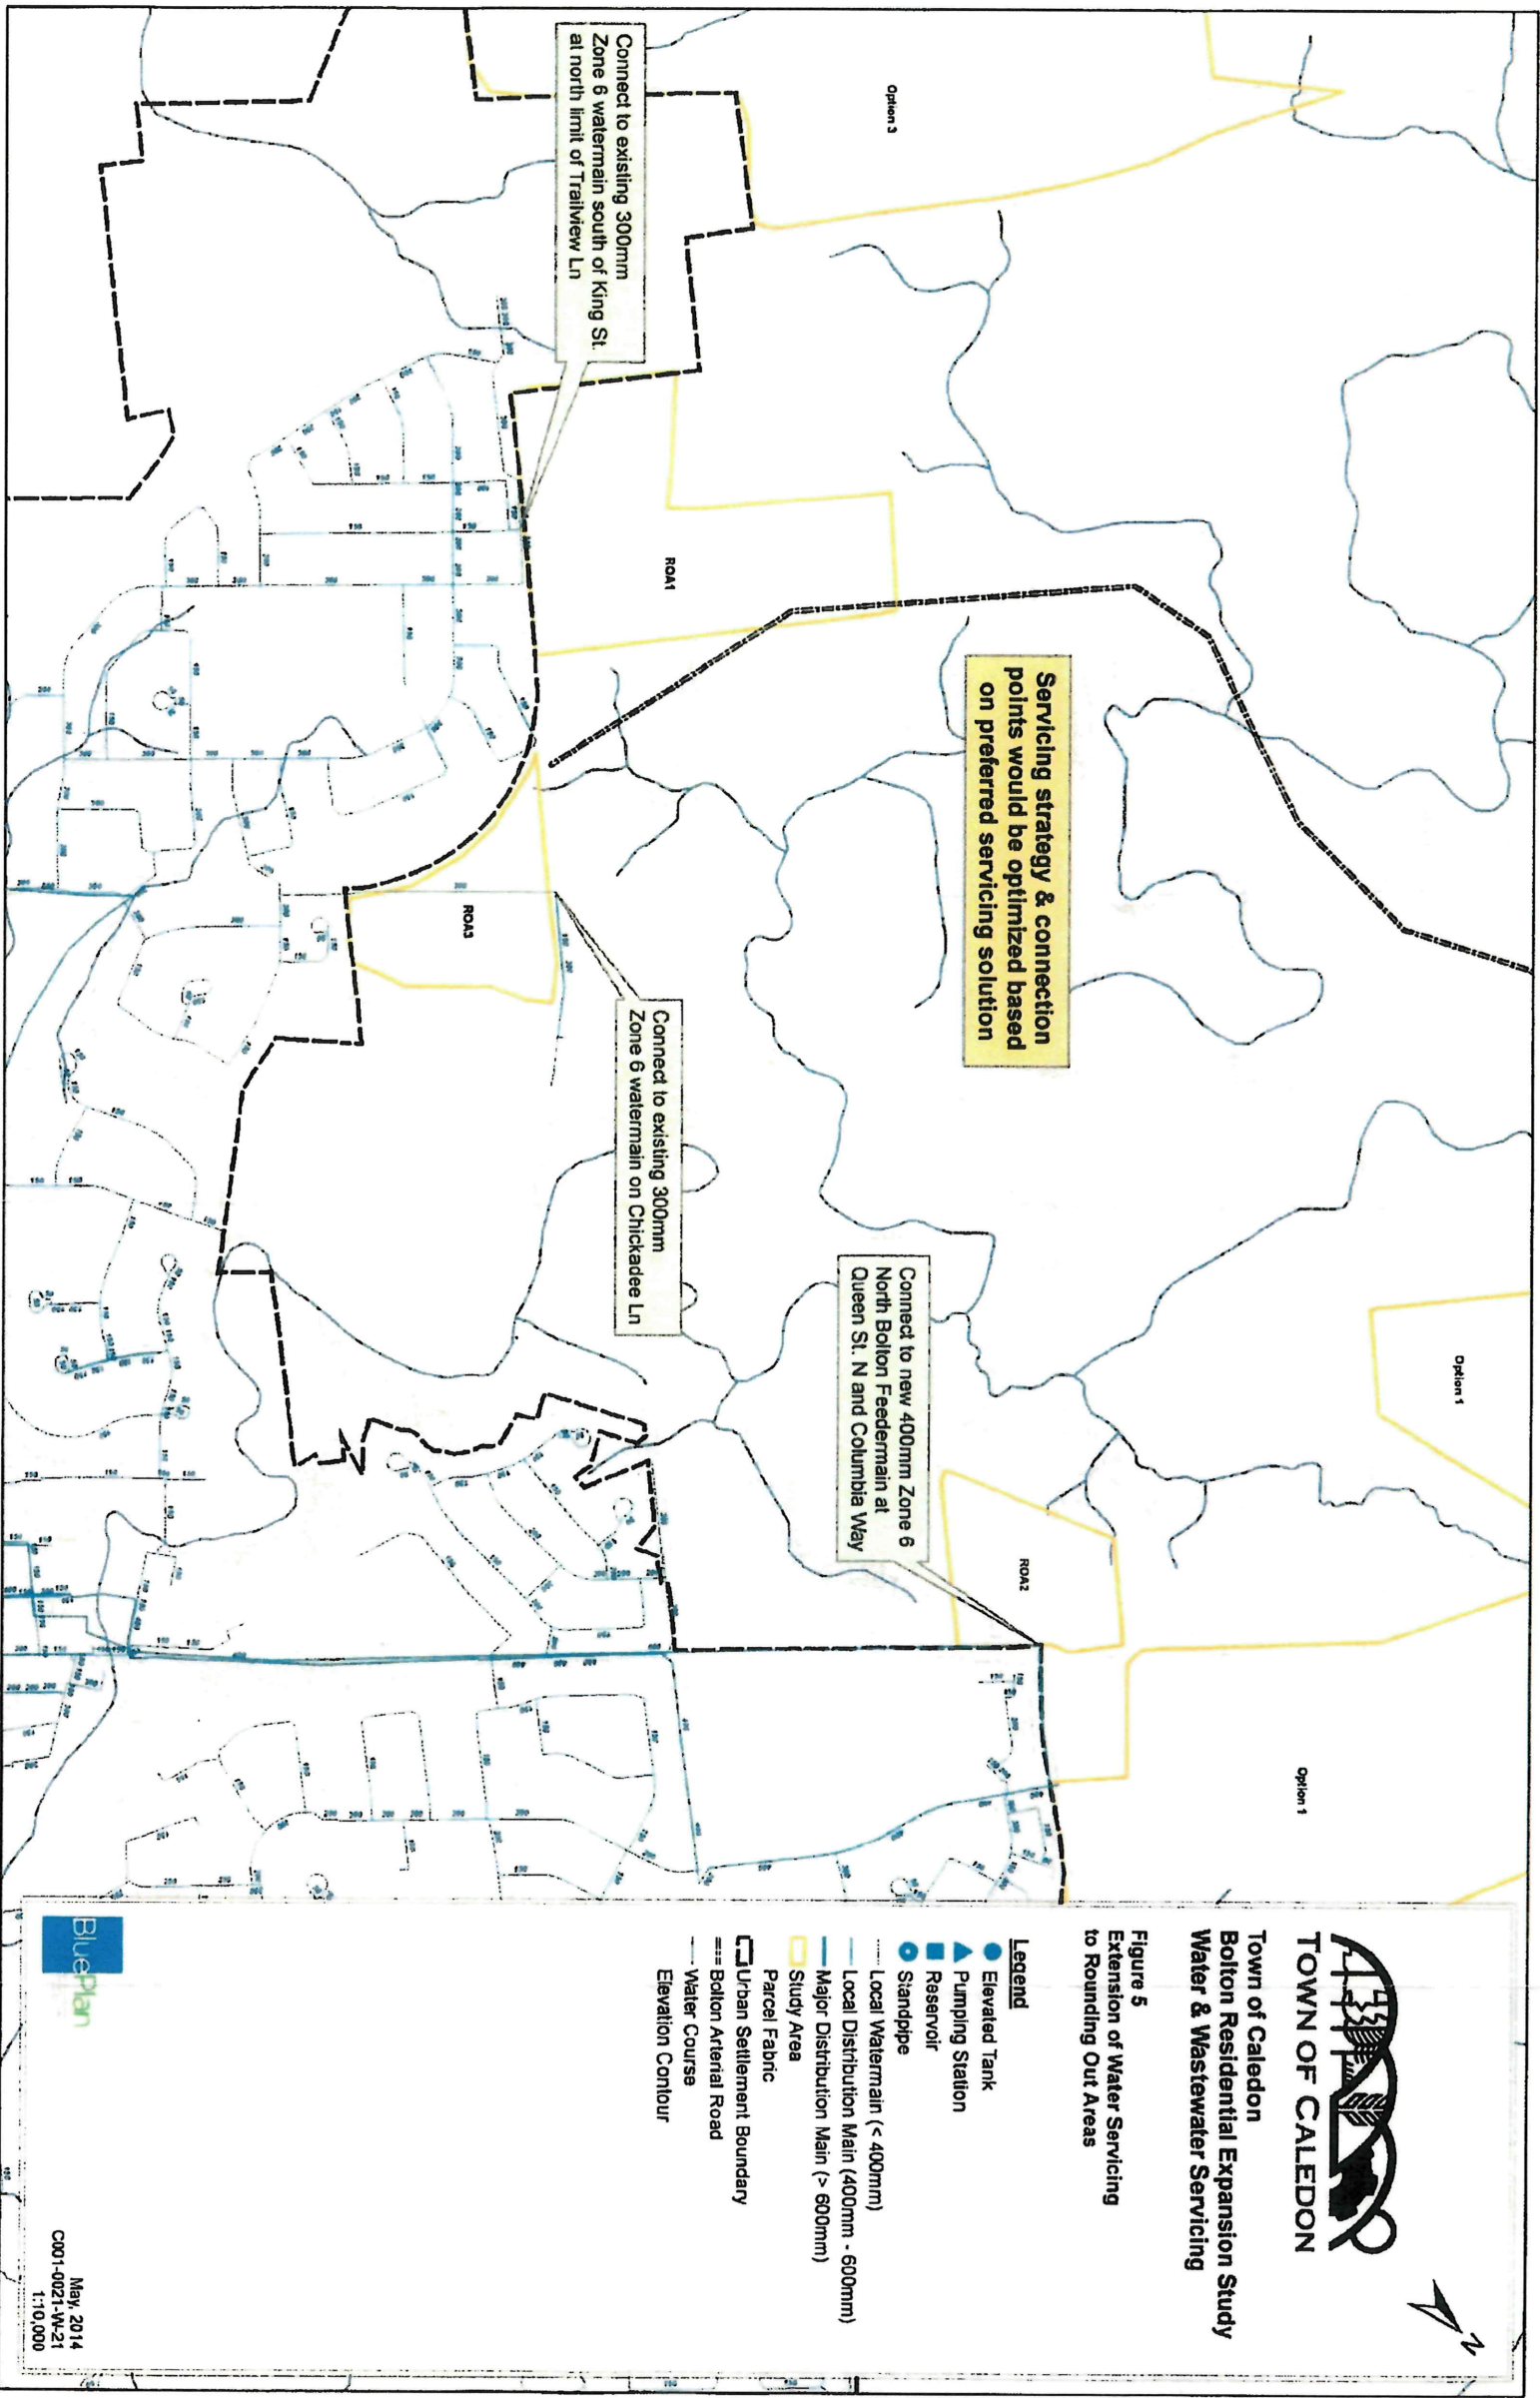

APPENDIX “H”

Storm Sewer Design Sheets

Stormwater Management Calculations - OTTHYMO Modelling

Water Balance Calculations

RELEASE RATE REQUIREMENT FOR SWM POND

Project Number : W17003 Project Name : CHICKADEE LANE Date : 02/01/2021	Prepared By : S.S Checked By: D.K.H
--	--

Total Site Area (Ha) = 7.00

Outlet Location : Innis Lake (Humber River)

Humber River SWM Quantity Control Release Rates based on Equation F (Sub Basin 36)

EVENT	HUMBER RIVER Sub-Basin	B	C	ln(A)	Rel. Rate (L/S/ha)	Rel. Rate (L/S)
100 - Year	Q= 29.912 - 2.316*ln(A)	29.91	2.316	1.95	25.4	178
50 - Year	Q= 26.566 - 2.082*ln(A)	26.57	2.082	1.95	22.5	158
25-Year	Q= 22.639 - 1.741*ln(A)	22.64	1.741	1.95	19.3	135
10-Year	Q= 17.957 - 1.373*ln(A)	17.96	1.373	1.95	15.3	107
5-Year	Q= 14.652 - 1.136*ln(A)	14.65	1.136	1.95	12.4	87
2-Year	Q= 9.506 - 0.719*ln(A)	9.506	0.719	1.95	8.11	57

Note : For West Humber River, the DRC release is 15% of 2 - year, Storage is 2/3rd of 2 - year

Summary of SWM Pond Release Rate targets for different Storm Events

Return Period	Release Rates (L/s)
100 - Year	178
50 - Year	158
25-Year	135
10-Year	107
5-Year	87
2-Year	57
DRC	9

SWM POND STORAGE CALCS

Project Number : W17003

Project Name : CHICKADEE LANE

Date : 02/01/2021

Prepared By : S.S

Checked By : D.K.H

Permanent Pool and Extended Storage Volume Requirements :

Total Site Area draining to Proposed SWM Pond = 7.00 Ha

Total Site Imperviousness = 75%

MOE Standard Requirements = 233.33 m³/ha (includes 40m³/ha Extended Detention)

Permanent Pool Volume Requirement = 193.33 m³/ha (233.33 - 40)

PP Storage Required in proposed Pond = 1353.31 m³

Elevations (m)	Surface Area (m ²)	Average Area (m ²)	Depth (m)	Delta Volume (m ³)	Total Volume (m ³)	
253.05	646					
254.05	1132	889	1.00	889	889	
		1230	0.50	615		
254.55	1327				1504	(Permanent Pool Storage)
254.55	1327					
		1776	1.00	1776		
255.55	2226				1776	
		2498	0.40	999		
255.95	2770				2776	
		3175	0.08	254		
256.03	3581				3030	
		3757	0.50	1878		
256.53	3932				4908	(Total Active Storage)

Storm Event	Elevation (m)	Release Rate Required (L/s)	Storage Required* (m ³)	Storage Provided (m ³)
Permanent Pool			1353	1504
Water Quality	255.25	9	2193	1149
2-Year	255.48	57	1613	1623
5-Year	255.72	87	2174	2175
10-Year	255.87	107	2550	2559
25-Year	256.03	135	3022	3030
50-Year	256.13	158	3375	3392
100-Year	256.23	178	3725	3760

SWM POND CONTROL STRUCTURE DESIGN

Project Number :	W17003	Prepared By :	SS
Project Name :	CHICKADEE LANE	Checked By:	D.K.H
Date :	02/01/2021		

Orifice No. 1 (To Control DRC)		Weir/Orifice No.2 (To Control 2 - 100-Year)	
Orifice Plate Diameter =	0.073 m	Orifice Width =	0.33 m
Area =	73 mm	Orifice Height =	0.15 m
Orifice Coeff. (C) =	0.0042 m ²	Area =	0.05 m ²
Invert =	0.63	Orifice Coeff. (C)	0.63
Orifice Plate Centroid =	254.55 m	Invert =	255.35 m
	254.60 m	Orifice Centroid =	255.43 m
Submerged Orifice Equation = $Q_o = 0.63 \times A \times [2 \times g \times H]^{\frac{1}{2}}$		Weir Equation = $Q = 1.67 \times L \times H^{\frac{3}{2}}$	
Where,		Where,	
Q = Flow rate (m ³ /s)		Q _w = Flow rate (m ³ /s)	
C = Constant		C = Constant	
A = Area of opening (m ²)		L = Weir Length (m)	
H = Net head above the orifice (m)		H = Net Head on the Orifice (m)	
g = Acceleration due to gravity (m/s)			

BOX CUT-OUT DETAILS	
0.33 m	}
0.15 m	
0.05 m ²	

Stage (m):		0.05		ORIFICE/WEIR CONTROL-2 (BOX CUT-OUT)						OVERFLOW WEIR @ 100-YR	
ORIFICE CONTROL-1 (ORIFICE PLATE)											
Elevation	Depth above orifice Centroid (m)	Orifice No. 1 Flow (m³/s)	Depth above orifice Centroid (m)	Orifice No. 2 Flow (m³/s)	Depth Above Weir (m)	Weir No. 2 Flow (m³/s)	Depth above orifice Centroid (m)	Weir Flow (m³/s)	Total Flow (m³/s)		
254.55	0	0							0.000		
254.60	0.06	0.003							0.003		
254.65	0.11	0.004							0.004		
254.70	0.16	0.005							0.005		
254.75	0.21	0.005							0.005		
254.80	0.26	0.006							0.006		
254.85	0.31	0.006							0.006		
254.90	0.36	0.007							0.007		
254.95	0.41	0.007							0.007		
255.00	0.46	0.008							0.008		
255.10	0.51	0.008							0.008		
255.15	0.56	0.009							0.009		
255.20	0.61	0.009							0.009		
255.25	0.66	0.009							0.009		
255.30	0.71	0.010							0.010		
255.35	0.76	0.010							0.010		
255.40	0.81	0.010			0.05	0.01			0.017		
255.45	0.86	0.011			0.10	0.02			0.028		
255.48	0.88	0.011			0.13	0.03			0.036		
255.50	0.91	0.011			0.15	0.03			0.043		
255.55	0.96	0.011			0.20	0.05			0.060		
255.60	1.01	0.012	0.18	0.06					0.069		
255.65	1.06	0.012	0.23	0.06					0.077		
255.70	1.11	0.012	0.28	0.07					0.084		
255.72	1.13	0.012	0.30	0.07					0.086		
255.75	1.16	0.013	0.33	0.08					0.090		
255.80	1.21	0.013	0.38	0.08					0.096		
255.85	1.26	0.013	0.43	0.09					0.102		
255.87	1.28	0.013	0.45	0.09					0.104		
255.90	1.31	0.013	0.48	0.09					0.107		
255.95	1.36	0.014	0.53	0.10					0.112		
256.00	1.41	0.014	0.58	0.10					0.117		
256.03	1.43	0.014	0.60	0.11					0.120		
256.05	1.46	0.014	0.63	0.11					0.122		
256.10	1.51	0.014	0.68	0.11					0.126		
256.13	1.54	0.014	0.71	0.11					0.129		
256.15	1.56	0.015	0.73	0.12					0.130		
256.20	1.61	0.015	0.78	0.12					0.135		
256.23	1.64	0.015	0.81	0.12			0.02	0.04	0.177		
256.25	1.66	0.015	0.83	0.12					0.139		
256.30	1.71	0.015	0.88	0.13					0.143		
256.35	1.76	0.015	0.93	0.13					0.146		
256.40	1.81	0.016	0.98	0.13					0.150		

- DRC Control (Target - 9L/s)
- 2-YR Control (Target - 57L/s)
- 5-YR Control (Target - 87L/s)
- 10-YR Control (Target - 107L/s)
- 25-YR Control (Target - 135L/s)
- 50-YR Control (Target - 158L/s)
- 100-YR Control (Target - 178L/s)
- Overflow Weir with Width = 10m
Elevation on top of Overflow Weir = 256.20m

Water Quality Volume Requirement

Project Number : W17003
Project Name : CHICKADEE LANE
Date : 02/01/2021

Prepared By : S.S
Checked By : D.K.H

Drawdown Time for Water Quality Level :

Based on Equation 4.11 MOE SWM Planning and Design Manual

$$t = \frac{0.66 C_2 h^{1.5} + 2 C_3 h^{0.5}}{2.75 A_o}$$

t = Drawdown time in seconds

A_p = Surface area of the pond (m²)

C = Discharge Coefficient (typically 0.63)

A_o = Cross-sectional area of the orifice (m²)


g = Gravitational acceleration constant (9.81 m/s)

h₁ = Starting water elevation above the orifice (m)

h₂ = Ending water elevation above the orifice (m)

C₂ = Slope coefficient from the area-depth linear regression

C₃ = Intercept from the area-depth linear regression

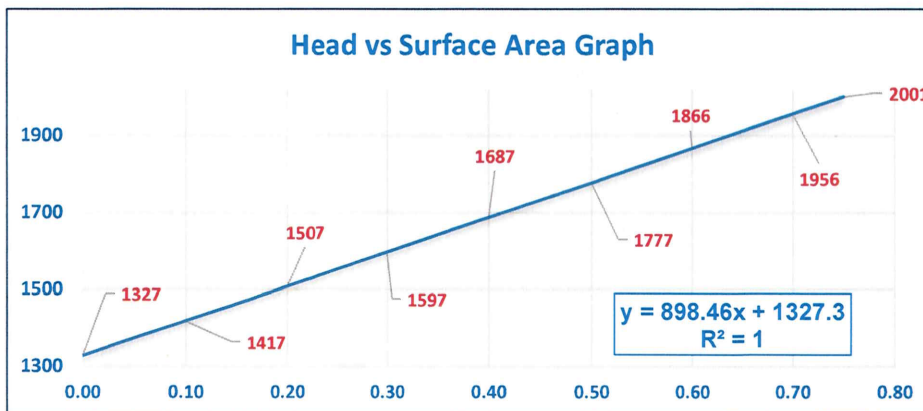

Elevation(m)	Head (m)	AREA (m ²)
254.55	0.00	1327
254.65	0.10	1417
254.75	0.20	1507
254.85	0.30	1597
254.95	0.40	1687
255.05	0.50	1777
255.15	0.60	1866
255.25	0.70	1956
255.30	0.75	2001

Intercept of Regression, C₃ = 1327.3
 Slope coef. of Regression, C₂ = 898.5
 Ultimate Ponding Elevation = 255.25 m (DRC Water Quality Level)
 Depth over orifice = 0.70 m (DRC Level - Permanent Pool Elevation)
 (255.25 - 254.55)

Orifice Diameter =	73 mm
Orifice Area =	0.00419 m²
Drawdown Time (t)=	223139 seconds
	62.0 hours

FOREBAY DESIGN CALCULATIONS

Project Number : W17003

Project Name : CHICKADEE LANE

Date : 02/01/2021

Prepared By : S.S

Checked By: D.K.H

Settling Calculations

Forebay Settling Length (MOE Equation 4.5)

$$\text{Dist} = \sqrt{\frac{rQ_p}{V_s}}$$

For Forebay

Length-to-width ratio of forebay (r) =

2.0 : 1 (INLET-1)

Peak Quality flowrate (Qp) from pond based on release rate and volume of extended detention.

Peak flow rate from the pond during design quality storm (Qp)=

18.532258 m³/Hr

0.005148 m³/s

$$= \frac{\text{DRC-Storage Volume (m}^3\text{)}}{\text{Drawdown Time (hrs)}}$$

Settling Velocity (V_s) = 0.0003 m/s (Recommended from MOEE Manual)

Forebay Settling Length Required =

5.9 m

Total Forebay Length Provided =

21.0 m (INLET -1)

Dispersion Length Calculations

Length of Dispersion (MOE Equation 4.6)

$$\text{Dist} = \frac{8Q}{dV_f}$$

Inlet flow rate - 10 yr. (Q) =

1.451 m³/s (Refer to Storm Design Sheet)

Depth of permanent pool in the forebay (d) =

1.5 m

Desired velocity in the forebay (V_f) =

0.5 m/s (Recommended from MOEE Manual)

Length of Dispersion) =

15.5 m

Minimum Forebay Deep Zone Bottom Width

Minimum Forebay Deep Zone Bottom Width (MOE Equation 4.7)

$$\text{Width} = \frac{\text{Dist}}{8}$$

Distance (D_R) =


15.5 m (Required Dispersion Length)

Width (W_R) =

1.93 m (Required Forebay Bottom Width)

Forebay Bottom Width (W_P) =

12.50 m (Provided Forebay Bottom Width)

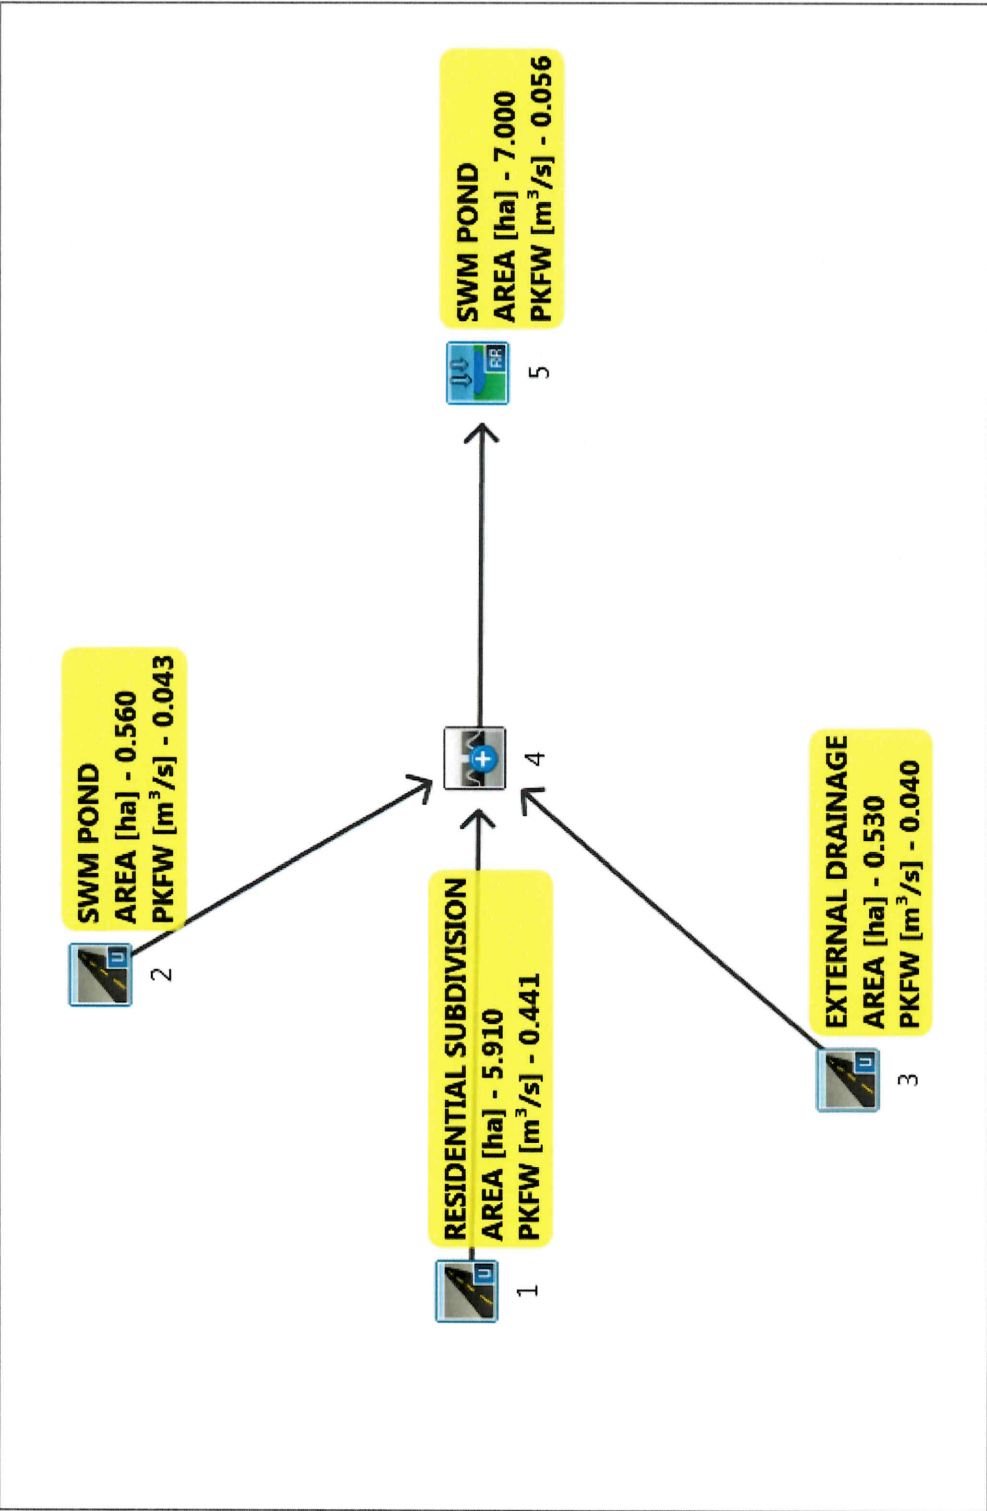

VISUAL OTTHYMO LAYOUT WITH AES STORM-6-HOUR RUN

VO FULL RESULTS.txt

```

V   V   I   SSSSS   U   U   A   L
V   V   I   SS      U   U   A A   L
V   V   I   SS      U   U   AAAAA L
V   V   I   SS      U   U   A   A L
VV      I   SSSSS   UUUUU   A   A LLLLL

```

(v 6.2.2000)

```

000   TTTT   TTTT   H   H   Y   Y   M   M   000   TM
O   O   T   T   H   H   Y   Y   MM   MM   O   O
O   O   T   T   H   H   Y   Y   M   M   O   O
000   T   T   H   H   Y   Y   M   M   000

```

Developed and Distributed by Smart City Water Inc
 Copyright 2007 - 2020 Smart City Water Inc
 All rights reserved.

***** D E T A I L E D O U T P U T *****

Input filename: C:\Program Files (x86)\Visual OTTHYMO 6.2\VO2\voin.dat

Output filename:

C:\Users\Shuchi\AppData\Local\Civica\XH5\8e061c4e-0b2b-4d34-afcd-b9145e333507\7f737f86-0fc5-4fe2-bef5-9cc3d089a48c\scena

Summary filename:

C:\Users\Shuchi\AppData\Local\Civica\XH5\8e061c4e-0b2b-4d34-afcd-b9145e333507\7f737f86-0fc5-4fe2-bef5-9cc3d089a48c\scena

DATE: 01/06/2021

TIME: 11:06:08

USER:

COMMENTS: _____

 ** SIMULATION : 10 Year 6 Hour AES (Bloor, TR **

READ STORM

Ptotal= 55.69 mm

Filename: C:\Users\Shuchi\AppData

ata\Local\Temp\

1e2bf10e-aa06-4302-9fc0-7340cb56677d\9430055c

Comments: 10 Year 6 Hour AES (Bloor, TRCA)

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.25	0.00	2.00	18.94	3.75	7.80	5.50	1.11
0.50	1.11	2.25	18.94	4.00	4.46	5.75	1.11
0.75	1.11	2.50	51.24	4.25	4.46	6.00	1.11
1.00	1.11	2.75	51.24	4.50	2.23	6.25	1.11
1.25	1.11	3.00	14.48	4.75	2.23		
1.50	6.68	3.25	14.48	5.00	1.11		
1.75	6.68	3.50	7.80	5.25	1.11		

VO FULL RESULTS.txt

CALIB STANDHYD (0001) ID= 1 DT= 5.0 min	Area (ha)= 5.91 Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00
--	--

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	4.43	1.48
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	198.49	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	0.00	1.667	6.68	3.250	14.48	4.83	1.11
0.167	0.00	1.750	6.68	3.333	7.80	4.92	1.11
0.250	0.00	1.833	18.94	3.417	7.80	5.00	1.11
0.333	1.11	1.917	18.94	3.500	7.80	5.08	1.11
0.417	1.11	2.000	18.94	3.583	7.80	5.17	1.11
0.500	1.11	2.083	18.94	3.667	7.80	5.25	1.11
0.583	1.11	2.167	18.94	3.750	7.80	5.33	1.11
0.667	1.11	2.250	18.94	3.833	4.46	5.42	1.11
0.750	1.11	2.333	51.24	3.917	4.46	5.50	1.11
0.833	1.11	2.417	51.24	4.000	4.46	5.58	1.11
0.917	1.11	2.500	51.24	4.083	4.46	5.67	1.11
1.000	1.11	2.583	51.24	4.167	4.46	5.75	1.11
1.083	1.11	2.667	51.24	4.250	4.46	5.83	1.11
1.167	1.11	2.750	51.24	4.333	2.23	5.92	1.11
1.250	1.11	2.833	14.48	4.417	2.23	6.00	1.11
1.333	6.68	2.917	14.48	4.500	2.23	6.08	1.11
1.417	6.68	3.000	14.48	4.583	2.23	6.17	1.11
1.500	6.68	3.083	14.48	4.667	2.23	6.25	1.11
1.583	6.68	3.167	14.48	4.750	2.23		

Max.Eff.Inten.(mm/hr)=	51.24	33.51	
over (min)	5.00	20.00	
Storage Coeff. (min)=	5.04 (ii)	15.97 (ii)	
Unit Hyd. Tpeak (min)=	5.00	20.00	
Unit Hyd. peak (cms)=	0.21	0.07	
			TOTALS
PEAK FLOW (cms)=	0.63	0.10	0.721 (iii)
TIME TO PEAK (hrs)=	2.75	2.92	2.75
RUNOFF VOLUME (mm)=	54.69	29.66	48.43
TOTAL RAINFALL (mm)=	55.69	55.69	55.69
RUNOFF COEFFICIENT =	0.98	0.53	0.87

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

CALIB STANDHYD (0002)	Area (ha)= 0.56
---------------------------	-----------------

Page 2

VO FULL RESULTS.txt
 |ID= 1 DT= 5.0 min | Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	0.42	0.14
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	61.10	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	0.00	1.667	6.68	3.250	14.48	4.83	1.11
0.167	0.00	1.750	6.68	3.333	7.80	4.92	1.11
0.250	0.00	1.833	18.94	3.417	7.80	5.00	1.11
0.333	1.11	1.917	18.94	3.500	7.80	5.08	1.11
0.417	1.11	2.000	18.94	3.583	7.80	5.17	1.11
0.500	1.11	2.083	18.94	3.667	7.80	5.25	1.11
0.583	1.11	2.167	18.94	3.750	7.80	5.33	1.11
0.667	1.11	2.250	18.94	3.833	4.46	5.42	1.11
0.750	1.11	2.333	51.24	3.917	4.46	5.50	1.11
0.833	1.11	2.417	51.24	4.000	4.46	5.58	1.11
0.917	1.11	2.500	51.24	4.083	4.46	5.67	1.11
1.000	1.11	2.583	51.24	4.167	4.46	5.75	1.11
1.083	1.11	2.667	51.24	4.250	4.46	5.83	1.11
1.167	1.11	2.750	51.24	4.333	2.23	5.92	1.11
1.250	1.11	2.833	14.48	4.417	2.23	6.00	1.11
1.333	6.68	2.917	14.48	4.500	2.23	6.08	1.11
1.417	6.68	3.000	14.48	4.583	2.23	6.17	1.11
1.500	6.68	3.083	14.48	4.667	2.23	6.25	1.11
1.583	6.68	3.167	14.48	4.750	2.23		

Max.Eff.Inten.(mm/hr)=	51.24	33.51	
over (min)	5.00	15.00	
Storage Coeff. (min)=	2.48 (ii)	13.41 (ii)	
Unit Hyd. Tpeak (min)=	5.00	15.00	
Unit Hyd. peak (cms)=	0.29	0.08	
			TOTALS
PEAK FLOW (cms)=	0.06	0.01	0.070 (iii)
TIME TO PEAK (hrs)=	2.75	2.83	2.75
RUNOFF VOLUME (mm)=	54.69	29.66	48.42
TOTAL RAINFALL (mm)=	55.69	55.69	55.69
RUNOFF COEFFICIENT =	0.98	0.53	0.87

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

 | CALIB
 | STANDHYD (0003)
 | ID= 1 DT= 5.0 min | Area (ha)= 0.53
 Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	0.40	0.13

VO FULL RESULTS.txt

Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	59.44	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	0.00	1.667	6.68	3.250	14.48	4.83	1.11
0.167	0.00	1.750	6.68	3.333	7.80	4.92	1.11
0.250	0.00	1.833	18.94	3.417	7.80	5.00	1.11
0.333	1.11	1.917	18.94	3.500	7.80	5.08	1.11
0.417	1.11	2.000	18.94	3.583	7.80	5.17	1.11
0.500	1.11	2.083	18.94	3.667	7.80	5.25	1.11
0.583	1.11	2.167	18.94	3.750	7.80	5.33	1.11
0.667	1.11	2.250	18.94	3.833	4.46	5.42	1.11
0.750	1.11	2.333	51.24	3.917	4.46	5.50	1.11
0.833	1.11	2.417	51.24	4.000	4.46	5.58	1.11
0.917	1.11	2.500	51.24	4.083	4.46	5.67	1.11
1.000	1.11	2.583	51.24	4.167	4.46	5.75	1.11
1.083	1.11	2.667	51.24	4.250	4.46	5.83	1.11
1.167	1.11	2.750	51.24	4.333	2.23	5.92	1.11
1.250	1.11	2.833	14.48	4.417	2.23	6.00	1.11
1.333	6.68	2.917	14.48	4.500	2.23	6.08	1.11
1.417	6.68	3.000	14.48	4.583	2.23	6.17	1.11
1.500	6.68	3.083	14.48	4.667	2.23	6.25	1.11
1.583	6.68	3.167	14.48	4.750	2.23		

Max.Eff.Inten.(mm/hr)=	51.24	33.51
over (min)	5.00	15.00
Storage Coeff. (min)=	2.44 (ii)	13.37 (ii)
Unit Hyd. Tpeak (min)=	5.00	15.00
Unit Hyd. peak (cms)=	0.30	0.08

PEAK FLOW (cms)=	0.06	0.01	*TOTALS*
TIME TO PEAK (hrs)=	2.75	2.83	0.066 (iii)
RUNOFF VOLUME (mm)=	54.69	29.66	2.75
TOTAL RAINFALL (mm)=	55.69	55.69	48.42
RUNOFF COEFFICIENT =	0.98	0.53	55.69
			0.87

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

ADD HYD (0004)				
1 + 2 = 3				

ID1= 1 (0001):	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
+ ID2= 2 (0002):	5.91	0.721	2.75	48.43
	0.56	0.070	2.75	48.42
=====				
ID = 3 (0004):	6.47	0.791	2.75	48.43

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

VO FULL RESULTS.txt

```

-----
| ADD HYD ( 0004) |
| 3 + 2 = 1 |
-----
          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
      ID1= 3 ( 0004): 6.47    0.791    2.75    48.43
+ ID2= 2 ( 0003): 0.53    0.066    2.75    48.42
=====
      ID = 1 ( 0004): 7.00    0.857    2.75    48.43

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 0005) |
| IN= 2---> OUT= 1 |
| DT= 5.0 min |
-----
          OVERFLOW IS OFF

          OUTFLOW      STORAGE      OUTFLOW      STORAGE
          (cms)      (ha.m.)      (cms)      (ha.m.)
          0.0000      0.0000      0.1730      0.3700
          0.0550      0.1600      0.2100      0.4000
          0.1000      0.2450      0.6800      0.4500

          AREA      QPEAK      TPEAK      R.V.
          (ha)      (cms)      (hrs)      (mm)
INFLOW : ID= 2 ( 0004) 7.000    0.857    2.75    48.43
OUTFLOW: ID= 1 ( 0005) 7.000    0.106    3.92    48.32

          PEAK FLOW REDUCTION [Qout/Qin] (%) = 12.35
          TIME SHIFT OF PEAK FLOW (min) = 70.00
          MAXIMUM STORAGE USED (ha.m.) = 0.2550

```

```

-----
=====
V  V  I  SSSSS  U  U  A  L  (v 6.2.2000)
V  V  I  SS    U  U  A  A  L
V  V  I  SS    U  U  AAAAA L
V  V  I  SS    U  U  A  A  L
VV    I  SSSSS  UUUUU  A  A  LLLLL

000  TTTT  TTTT  H  H  Y  Y  M  M  000  TM
O  O  T  T  H  H  Y  Y  MM MM  O  O
O  O  T  T  H  H  Y  Y  M  M  O  O
000  T  T  H  H  Y  Y  M  M  000

```

Developed and Distributed by Smart City Water Inc
 Copyright 2007 - 2020 Smart City Water Inc
 All rights reserved.

***** D E T A I L E D O U T P U T *****

Input filename: C:\Program Files (x86)\Visual OTTHYMO 6.2\VO2\voin.dat

Output filename:

C:\Users\Shuchi\AppData\Local\Civica\XH5\8e061c4e-0b2b-4d34-afcd-b9145e333507\41eac
 8a9-1279-40f1-93f7-54226a7d65a6\scena

Summary filename:

C:\Users\Shuchi\AppData\Local\Civica\XH5\8e061c4e-0b2b-4d34-afcd-b9145e333507\41eac
 8a9-1279-40f1-93f7-54226a7d65a6\scena

DATE: 01/06/2021

USER:

COMMENTS: _____

** SIMULATION : 100 Year 6 Hour AES (Bloor, T **

| READ STORM |
Ptotal= 80.31 mm

Filename: C:\Users\Shuchi\AppData
Local\Temp\
1e2bf10e-aa06-4302-9fc0-7340cb56677d\57b24d9f
Comments: 100 Year 6 Hour AES (Bloor, TRCA)

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.25	0.00	2.00	27.30	3.75	11.24	5.50	1.61
0.50	1.61	2.25	27.30	4.00	6.42	5.75	1.61
0.75	1.61	2.50	73.88	4.25	6.42	6.00	1.61
1.00	1.61	2.75	73.88	4.50	3.21	6.25	1.61
1.25	1.61	3.00	20.88	4.75	3.21		
1.50	9.64	3.25	20.88	5.00	1.61		
1.75	9.64	3.50	11.24	5.25	1.61		

| CALIB |
| STANDHYD (0001) |
ID= 1 DT= 5.0 min

Area (ha)= 5.91
Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	4.43	1.48
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	198.49	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.083	0.00	1.667	9.64	3.250	20.88	4.83	1.61
0.167	0.00	1.750	9.64	3.333	11.24	4.92	1.61
0.250	0.00	1.833	27.30	3.417	11.24	5.00	1.61
0.333	1.61	1.917	27.30	3.500	11.24	5.08	1.61
0.417	1.61	2.000	27.30	3.583	11.24	5.17	1.61
0.500	1.61	2.083	27.30	3.667	11.24	5.25	1.61
0.583	1.61	2.167	27.30	3.750	11.24	5.33	1.61
0.667	1.61	2.250	27.30	3.833	6.42	5.42	1.61
0.750	1.61	2.333	73.88	3.917	6.42	5.50	1.61
0.833	1.61	2.417	73.88	4.000	6.42	5.58	1.61
0.917	1.61	2.500	73.88	4.083	6.42	5.67	1.61

VO FULL RESULTS.txt							
1.000	1.61	2.583	73.88	4.167	6.42	5.75	1.61
1.083	1.61	2.667	73.88	4.250	6.42	5.83	1.61
1.167	1.61	2.750	73.88	4.333	3.21	5.92	1.61
1.250	1.61	2.833	20.88	4.417	3.21	6.00	1.61
1.333	9.64	2.917	20.88	4.500	3.21	6.08	1.61
1.417	9.64	3.000	20.88	4.583	3.21	6.17	1.61
1.500	9.64	3.083	20.88	4.667	3.21	6.25	1.61
1.583	9.64	3.167	20.88	4.750	3.21		

Max.Eff.Inten.(mm/hr)= 73.88 57.08
over (min) 5.00 15.00
Storage Coeff. (min)= 4.35 (ii) 13.18 (ii)
Unit Hyd. Tpeak (min)= 5.00 15.00
Unit Hyd. peak (cms)= 0.23 0.08

PEAK FLOW (cms)= 0.91 0.19 *TOTALS*
TIME TO PEAK (hrs)= 2.75 2.83 1.092 (iii)
RUNOFF VOLUME (mm)= 79.31 50.24 72.04
TOTAL RAINFALL (mm)= 80.31 80.31 80.31
RUNOFF COEFFICIENT = 0.99 0.63 0.90

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

CALIB	Area (ha)= 0.56	
STANDHYD (0002)	Total Imp(%)= 75.00	Dir. Conn.(%)= 75.00
ID= 1 DT= 5.0 min		

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.42	0.14
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	61.10	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	0.00	1.667	9.64	3.250	20.88	4.83	1.61
0.167	0.00	1.750	9.64	3.333	11.24	4.92	1.61
0.250	0.00	1.833	27.30	3.417	11.24	5.00	1.61
0.333	1.61	1.917	27.30	3.500	11.24	5.08	1.61
0.417	1.61	2.000	27.30	3.583	11.24	5.17	1.61
0.500	1.61	2.083	27.30	3.667	11.24	5.25	1.61
0.583	1.61	2.167	27.30	3.750	11.24	5.33	1.61
0.667	1.61	2.250	27.30	3.833	6.42	5.42	1.61
0.750	1.61	2.333	73.88	3.917	6.42	5.50	1.61
0.833	1.61	2.417	73.88	4.000	6.42	5.58	1.61
0.917	1.61	2.500	73.88	4.083	6.42	5.67	1.61
1.000	1.61	2.583	73.88	4.167	6.42	5.75	1.61
1.083	1.61	2.667	73.88	4.250	6.42	5.83	1.61
1.167	1.61	2.750	73.88	4.333	3.21	5.92	1.61
1.250	1.61	2.833	20.88	4.417	3.21	6.00	1.61

VO FULL RESULTS.txt							
1.333	9.64	2.917	20.88	4.500	3.21	6.08	1.61
1.417	9.64	3.000	20.88	4.583	3.21	6.17	1.61
1.500	9.64	3.083	20.88	4.667	3.21	6.25	1.61
1.583	9.64	3.167	20.88	4.750	3.21		

Max.Eff.Inten.(mm/hr)=	73.88	57.08	
over (min)	5.00	15.00	
Storage Coeff. (min)=	2.15 (ii)	10.98 (ii)	
Unit Hyd. Tpeak (min)=	5.00	15.00	
Unit Hyd. peak (cms)=	0.31	0.09	
			TOTALS
PEAK FLOW (cms)=	0.09	0.02	0.104 (iii)
TIME TO PEAK (hrs)=	2.75	2.83	2.75
RUNOFF VOLUME (mm)=	79.31	50.24	72.03
TOTAL RAINFALL (mm)=	80.31	80.31	80.31
RUNOFF COEFFICIENT =	0.99	0.63	0.90

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

CALIB	Area (ha)= 0.53
STANDHYD (0003)	Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00
ID= 1 DT= 5.0 min	

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	0.40	0.13
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	59.44	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	0.00	1.667	9.64	3.250	20.88	4.83	1.61
0.167	0.00	1.750	9.64	3.333	11.24	4.92	1.61
0.250	0.00	1.833	27.30	3.417	11.24	5.00	1.61
0.333	1.61	1.917	27.30	3.500	11.24	5.08	1.61
0.417	1.61	2.000	27.30	3.583	11.24	5.17	1.61
0.500	1.61	2.083	27.30	3.667	11.24	5.25	1.61
0.583	1.61	2.167	27.30	3.750	11.24	5.33	1.61
0.667	1.61	2.250	27.30	3.833	6.42	5.42	1.61
0.750	1.61	2.333	73.88	3.917	6.42	5.50	1.61
0.833	1.61	2.417	73.88	4.000	6.42	5.58	1.61
0.917	1.61	2.500	73.88	4.083	6.42	5.67	1.61
1.000	1.61	2.583	73.88	4.167	6.42	5.75	1.61
1.083	1.61	2.667	73.88	4.250	6.42	5.83	1.61
1.167	1.61	2.750	73.88	4.333	3.21	5.92	1.61
1.250	1.61	2.833	20.88	4.417	3.21	6.00	1.61
1.333	9.64	2.917	20.88	4.500	3.21	6.08	1.61
1.417	9.64	3.000	20.88	4.583	3.21	6.17	1.61
1.500	9.64	3.083	20.88	4.667	3.21	6.25	1.61
1.583	9.64	3.167	20.88	4.750	3.21		

VO FULL RESULTS.txt

Max.Eff.Inten.(mm/hr)=	73.88	57.08	
over (min)	5.00	15.00	
Storage Coeff. (min)=	2.11 (ii)	10.94 (ii)	
Unit Hyd. Tpeak (min)=	5.00	15.00	
Unit Hyd. peak (cms)=	0.31	0.09	
			TOTALS
PEAK FLOW (cms)=	0.08	0.02	0.099 (iii)
TIME TO PEAK (hrs)=	2.75	2.83	2.75
RUNOFF VOLUME (mm)=	79.31	50.24	72.03
TOTAL RAINFALL (mm)=	80.31	80.31	80.31
RUNOFF COEFFICIENT =	0.99	0.63	0.90

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 85.0 Ia = Dep. Storage (Above)
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

ADD HYD (0004)				
1 + 2 = 3				
	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
ID1= 1 (0001):	5.91	1.092	2.75	72.04
+ ID2= 2 (0002):	0.56	0.104	2.75	72.03
=====				
ID = 3 (0004):	6.47	1.196	2.75	72.04

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

ADD HYD (0004)				
3 + 2 = 1				
	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
ID1= 3 (0004):	6.47	1.196	2.75	72.04
+ ID2= 2 (0003):	0.53	0.099	2.75	72.03
=====				
ID = 1 (0004):	7.00	1.295	2.75	72.04

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

RESERVOIR(0005)				
IN= 2---> OUT= 1				
DT= 5.0 min				

	OVERFLOW IS OFF			
	OUTFLOW	STORAGE	OUTFLOW	STORAGE
	(cms)	(ha.m.)	(cms)	(ha.m.)
	0.0000	0.0000	0.1730	0.3700
	0.0550	0.1600	0.2100	0.4000
	0.1000	0.2450	0.6800	0.4500
	=====			
	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
INFLOW : ID= 2 (0004)	7.000	1.295	2.75	72.04
OUTFLOW: ID= 1 (0005)	7.000	0.176	3.83	71.93

PEAK FLOW REDUCTION [Qout/Qin](%)= 13.58
 TIME SHIFT OF PEAK FLOW (min)= 65.00
 MAXIMUM STORAGE USED (ha.m.)= 0.3725

VO FULL RESULTS.txt

FINISH

```

V   V   I   SSSSS   U   U   A   L           (v 6.2.2000)
V   V   I   SS     U   U   A A   L
V   V   I   SS     U   U   AAAAA L
V   V   I   SS     U   U   A   A   L
VV     I   SSSSS   UUUUU   A   A   LLLLL

```

```

000   TTTT   TTTT   H   H   Y   Y   M   M   000   TM
O   O   T   T   H   H   Y   Y   MM  MM   O   O
O   O   T   T   H   H   Y   Y   M   M   O   O
000   T   T   H   H   Y   M   M   000

```

Developed and Distributed by Smart City Water Inc
Copyright 2007 - 2020 Smart City Water Inc
All rights reserved.

***** D E T A I L E D O U T P U T *****

Input filename: C:\Program Files (x86)\Visual OTTHYMO 6.2\VO2\voin.dat

Output filename:

C:\Users\Shuchi\AppData\Local\Civica\XH5\8e061c4e-0b2b-4d34-afcd-b9145e333507\2596c296-5080-43b9-9771-d8cae20a1e89\scena

Summary filename:

C:\Users\Shuchi\AppData\Local\Civica\XH5\8e061c4e-0b2b-4d34-afcd-b9145e333507\2596c296-5080-43b9-9771-d8cae20a1e89\scena

DATE: 01/06/2021

TIME: 11:06:08

USER:

COMMENTS: _____

```

*****
** SIMULATION : 2 Year 6 Hour AES (Bloor, TRC **
*****

```

READ STORM

Ptotal= 36.00 mm

Filename: C:\Users\Shuchi\AppData\Local\Temp\

1e2bf10e-aa06-4302-9fc0-7340cb56677d\c3eef724

Comments: 2 Year 6 Hour AES (Bloor, TRCA)

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.25	0.00	2.00	12.24	3.75	5.04	5.50	0.72

VO FULL RESULTS.txt

0.50	0.72	2.25	12.24	4.00	2.88	5.75	0.72
0.75	0.72	2.50	33.12	4.25	2.88	6.00	0.72
1.00	0.72	2.75	33.12	4.50	1.44	6.25	0.72
1.25	0.72	3.00	9.36	4.75	1.44		
1.50	4.32	3.25	9.36	5.00	0.72		
1.75	4.32	3.50	5.04	5.25	0.72		

CALIB
STANDHYD (0001)
ID= 1 DT= 5.0 min

Area (ha)= 5.91
Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	4.43	1.48
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	198.49	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	0.00	1.667	4.32	3.250	9.36	4.83	0.72
0.167	0.00	1.750	4.32	3.333	5.04	4.92	0.72
0.250	0.00	1.833	12.24	3.417	5.04	5.00	0.72
0.333	0.72	1.917	12.24	3.500	5.04	5.08	0.72
0.417	0.72	2.000	12.24	3.583	5.04	5.17	0.72
0.500	0.72	2.083	12.24	3.667	5.04	5.25	0.72
0.583	0.72	2.167	12.24	3.750	5.04	5.33	0.72
0.667	0.72	2.250	12.24	3.833	2.88	5.42	0.72
0.750	0.72	2.333	33.12	3.917	2.88	5.50	0.72
0.833	0.72	2.417	33.12	4.000	2.88	5.58	0.72
0.917	0.72	2.500	33.12	4.083	2.88	5.67	0.72
1.000	0.72	2.583	33.12	4.167	2.88	5.75	0.72
1.083	0.72	2.667	33.12	4.250	2.88	5.83	0.72
1.167	0.72	2.750	33.12	4.333	1.44	5.92	0.72
1.250	0.72	2.833	9.36	4.417	1.44	6.00	0.72
1.333	4.32	2.917	9.36	4.500	1.44	6.08	0.72
1.417	4.32	3.000	9.36	4.583	1.44	6.17	0.72
1.500	4.32	3.083	9.36	4.667	1.44	6.25	0.72
1.583	4.32	3.167	9.36	4.750	1.44		

Max.Eff.Inten.(mm/hr)=	33.12	17.18
over (min)	5.00	25.00
Storage Coeff. (min)=	6.00 (ii)	20.27 (ii)
Unit Hyd. Tpeak (min)=	5.00	25.00
Unit Hyd. peak (cms)=	0.19	0.05

PEAK FLOW (cms)=	0.41	0.04	*TOTALS*
TIME TO PEAK (hrs)=	2.75	3.00	0.441 (iii)
RUNOFF VOLUME (mm)=	35.00	15.00	2.75
TOTAL RAINFALL (mm)=	36.00	36.00	30.00
RUNOFF COEFFICIENT =	0.97	0.42	0.83

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL

VO FULL RESULTS.txt
 THAN THE STORAGE COEFFICIENT.
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

CALIB STANDHYD (0002) ID= 1 DT= 5.0 min	Area (ha)= 0.56 Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00
--	--

	IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)= 0.42	0.14
Dep. Storage	(mm)= 1.00	1.50
Average slope	(%)= 1.00	2.00
Length	(m)= 61.10	40.00
Mannings n	= 0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.083	0.00	1.667	4.32	3.250	9.36	4.83	0.72
0.167	0.00	1.750	4.32	3.333	5.04	4.92	0.72
0.250	0.00	1.833	12.24	3.417	5.04	5.00	0.72
0.333	0.72	1.917	12.24	3.500	5.04	5.08	0.72
0.417	0.72	2.000	12.24	3.583	5.04	5.17	0.72
0.500	0.72	2.083	12.24	3.667	5.04	5.25	0.72
0.583	0.72	2.167	12.24	3.750	5.04	5.33	0.72
0.667	0.72	2.250	12.24	3.833	2.88	5.42	0.72
0.750	0.72	2.333	33.12	3.917	2.88	5.50	0.72
0.833	0.72	2.417	33.12	4.000	2.88	5.58	0.72
0.917	0.72	2.500	33.12	4.083	2.88	5.67	0.72
1.000	0.72	2.583	33.12	4.167	2.88	5.75	0.72
1.083	0.72	2.667	33.12	4.250	2.88	5.83	0.72
1.167	0.72	2.750	33.12	4.333	1.44	5.92	0.72
1.250	0.72	2.833	9.36	4.417	1.44	6.00	0.72
1.333	4.32	2.917	9.36	4.500	1.44	6.08	0.72
1.417	4.32	3.000	9.36	4.583	1.44	6.17	0.72
1.500	4.32	3.083	9.36	4.667	1.44	6.25	0.72
1.583	4.32	3.167	9.36	4.750	1.44		

Max.Eff.Inten.(mm/hr)=	33.12	17.18
over (min)	5.00	20.00
Storage Coeff. (min)=	2.96 (ii)	17.24 (ii)
Unit Hyd. Tpeak (min)=	5.00	20.00
Unit Hyd. peak (cms)=	0.28	0.06

PEAK FLOW (cms)=	0.04	0.00	*TOTALS*
TIME TO PEAK (hrs)=	2.75	2.92	0.043 (iii)
RUNOFF VOLUME (mm)=	35.00	15.01	2.75
TOTAL RAINFALL (mm)=	36.00	36.00	29.98
RUNOFF COEFFICIENT =	0.97	0.42	36.00
			0.83

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

VO FULL RESULTS.txt

CALIB
STANDHYD (0003)
ID= 1 DT= 5.0 min

Area (ha)= 0.53
Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.40	0.13
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	59.44	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.083	0.00	1.667	4.32	3.250	9.36	4.83	0.72
0.167	0.00	1.750	4.32	3.333	5.04	4.92	0.72
0.250	0.00	1.833	12.24	3.417	5.04	5.00	0.72
0.333	0.72	1.917	12.24	3.500	5.04	5.08	0.72
0.417	0.72	2.000	12.24	3.583	5.04	5.17	0.72
0.500	0.72	2.083	12.24	3.667	5.04	5.25	0.72
0.583	0.72	2.167	12.24	3.750	5.04	5.33	0.72
0.667	0.72	2.250	12.24	3.833	2.88	5.42	0.72
0.750	0.72	2.333	33.12	3.917	2.88	5.50	0.72
0.833	0.72	2.417	33.12	4.000	2.88	5.58	0.72
0.917	0.72	2.500	33.12	4.083	2.88	5.67	0.72
1.000	0.72	2.583	33.12	4.167	2.88	5.75	0.72
1.083	0.72	2.667	33.12	4.250	2.88	5.83	0.72
1.167	0.72	2.750	33.12	4.333	1.44	5.92	0.72
1.250	0.72	2.833	9.36	4.417	1.44	6.00	0.72
1.333	4.32	2.917	9.36	4.500	1.44	6.08	0.72
1.417	4.32	3.000	9.36	4.583	1.44	6.17	0.72
1.500	4.32	3.083	9.36	4.667	1.44	6.25	0.72
1.583	4.32	3.167	9.36	4.750	1.44		

Max.Eff.Inten.(mm/hr)=	33.12	17.18
over (min)	5.00	20.00
Storage Coeff. (min)=	2.91 (ii)	17.19 (ii)
Unit Hyd. Tpeak (min)=	5.00	20.00
Unit Hyd. peak (cms)=	0.28	0.06

TOTALS

PEAK FLOW (cms)=	0.04	0.00	0.040 (iii)
TIME TO PEAK (hrs)=	2.75	2.92	2.75
RUNOFF VOLUME (mm)=	35.00	15.01	29.98
TOTAL RAINFALL (mm)=	36.00	36.00	36.00
RUNOFF COEFFICIENT =	0.97	0.42	0.83

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

ADD HYD (0004)
1 + 2 = 3

AREA QPEAK TPEAK R.V.

VO FULL RESULTS.txt

	(ha)	(cms)	(hrs)	(mm)
ID1= 1 (0001):	5.91	0.441	2.75	30.00
+ ID2= 2 (0002):	0.56	0.043	2.75	29.98
<hr/>				
ID = 3 (0004):	6.47	0.484	2.75	30.00

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

ADD HYD (0004)
3 + 2 = 1

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
ID1= 3 (0004):	6.47	0.484	2.75	30.00
+ ID2= 2 (0003):	0.53	0.040	2.75	29.98
<hr/>				
ID = 1 (0004):	7.00	0.525	2.75	30.00

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

RESERVOIR(0005)
IN= 2---> OUT= 1
DT= 5.0 min

OVERFLOW IS OFF

OUTFLOW (cms)	STORAGE (ha.m.)	OUTFLOW (cms)	STORAGE (ha.m.)
0.0000	0.0000	0.1730	0.3700
0.0550	0.1600	0.2100	0.4000
0.1000	0.2450	0.6800	0.4500

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW : ID= 2 (0004)	7.000	0.525	2.75	30.00
OUTFLOW: ID= 1 (0005)	7.000	0.056	4.25	29.89

PEAK FLOW REDUCTION [Qout/Qin] (%) = 10.61
TIME SHIFT OF PEAK FLOW (min) = 90.00
MAXIMUM STORAGE USED (ha.m.) = 0.1613

V V I SSSSS U U A L (v 6.2.2000)
V V I SS U U A A L
V V I SS U U A A A A L
V V I SS U U A A L
VV I SSSSS UUUUU A A LLLLL

000 TTTT TTTT H H Y Y M M 000 TM
O O T T H H Y Y M M O O
O O T T H H Y Y M M O O
000 T T H H Y Y M M 000

Developed and Distributed by Smart City Water Inc
Copyright 2007 - 2020 Smart City Water Inc
All rights reserved.

***** D E T A I L E D O U T P U T *****

Input filename: C:\Program Files (x86)\Visual OTTHYMO 6.2\VO2\voin.dat

Output filename:

VO FULL RESULTS.txt

C:\Users\Shuchi\AppData\Local\Civica\vh5\8e061c4e-0b2b-4d34-afcd-b9145e333507\19bd41d0-40da-4e7c-ab09-d8a24a2662d8\scena

Summary filename:

C:\Users\Shuchi\AppData\Local\Civica\vh5\8e061c4e-0b2b-4d34-afcd-b9145e333507\19bd41d0-40da-4e7c-ab09-d8a24a2662d8\scena

DATE: 01/06/2021

TIME: 11:06:08

USER:

COMMENTS: _____

** SIMULATION : 25 Year 6 Hour AES (Bloor, TR **

READ STORM	Filename: C:\Users\Shuchi\AppData\Local\Temp\1e2bf10e-aa06-4302-9fc0-7340cb56677d\484539e2
Ptotal= 65.59 mm	Comments: 25 Year 6 Hour AES (Bloor, TRCA)

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.25	0.00	2.00	22.30	3.75	9.18	5.50	1.31
0.50	1.31	2.25	22.30	4.00	5.25	5.75	1.31
0.75	1.31	2.50	60.35	4.25	5.25	6.00	1.31
1.00	1.31	2.75	60.35	4.50	2.62	6.25	1.31
1.25	1.31	3.00	17.06	4.75	2.62		
1.50	7.87	3.25	17.06	5.00	1.31		
1.75	7.87	3.50	9.18	5.25	1.31		

CALIB STANDHYD (0001) ID= 1 DT= 5.0 min	Area (ha)= 5.91 Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00
--	--

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	4.43	1.48
Dep. Storage (mm)=	1.00	1.50
Average slope (%)=	1.00	2.00
Length (m)=	198.49	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.083	0.00	1.667	7.87	3.250	17.06	4.83	1.31
0.167	0.00	1.750	7.87	3.333	9.18	4.92	1.31
0.250	0.00	1.833	22.30	3.417	9.18	5.00	1.31
0.333	1.31	1.917	22.30	3.500	9.18	5.08	1.31

VO FULL RESULTS.txt							
0.417	1.31	2.000	22.30	3.583	9.18	5.17	1.31
0.500	1.31	2.083	22.30	3.667	9.18	5.25	1.31
0.583	1.31	2.167	22.30	3.750	9.18	5.33	1.31
0.667	1.31	2.250	22.30	3.833	5.25	5.42	1.31
0.750	1.31	2.333	60.35	3.917	5.25	5.50	1.31
0.833	1.31	2.417	60.35	4.000	5.25	5.58	1.31
0.917	1.31	2.500	60.35	4.083	5.25	5.67	1.31
1.000	1.31	2.583	60.35	4.167	5.25	5.75	1.31
1.083	1.31	2.667	60.35	4.250	5.25	5.83	1.31
1.167	1.31	2.750	60.35	4.333	2.62	5.92	1.31
1.250	1.31	2.833	17.06	4.417	2.62	6.00	1.31
1.333	7.87	2.917	17.06	4.500	2.62	6.08	1.31
1.417	7.87	3.000	17.06	4.583	2.62	6.17	1.31
1.500	7.87	3.083	17.06	4.667	2.62	6.25	1.31
1.583	7.87	3.167	17.06	4.750	2.62		

Max.Eff.Inten.(mm/hr)=	60.35	43.45	
over (min)	5.00	15.00	
Storage Coeff. (min)=	4.72 (ii)	14.57 (ii)	
Unit Hyd. Tpeak (min)=	5.00	15.00	
Unit Hyd. peak (cms)=	0.22	0.08	
			TOTALS
PEAK FLOW (cms)=	0.74	0.14	0.874 (iii)
TIME TO PEAK (hrs)=	2.75	2.83	2.75
RUNOFF VOLUME (mm)=	64.59	37.71	57.87
TOTAL RAINFALL (mm)=	65.59	65.59	65.59
RUNOFF COEFFICIENT =	0.98	0.57	0.88

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

CALIB		Area (ha)= 0.56		Dir. Conn.(%)= 75.00	
STANDHYD (0002)		Total Imp(%)= 75.00			
ID= 1 DT= 5.0 min					

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	0.42	0.14
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	61.10	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	0.00	1.667	7.87	3.250	17.06	4.83	1.31
0.167	0.00	1.750	7.87	3.333	9.18	4.92	1.31
0.250	0.00	1.833	22.30	3.417	9.18	5.00	1.31
0.333	1.31	1.917	22.30	3.500	9.18	5.08	1.31
0.417	1.31	2.000	22.30	3.583	9.18	5.17	1.31
0.500	1.31	2.083	22.30	3.667	9.18	5.25	1.31
0.583	1.31	2.167	22.30	3.750	9.18	5.33	1.31
0.667	1.31	2.250	22.30	3.833	5.25	5.42	1.31

VO FULL RESULTS.txt							
0.750	1.31	2.333	60.35	3.917	5.25	5.50	1.31
0.833	1.31	2.417	60.35	4.000	5.25	5.58	1.31
0.917	1.31	2.500	60.35	4.083	5.25	5.67	1.31
1.000	1.31	2.583	60.35	4.167	5.25	5.75	1.31
1.083	1.31	2.667	60.35	4.250	5.25	5.83	1.31
1.167	1.31	2.750	60.35	4.333	2.62	5.92	1.31
1.250	1.31	2.833	17.06	4.417	2.62	6.00	1.31
1.333	7.87	2.917	17.06	4.500	2.62	6.08	1.31
1.417	7.87	3.000	17.06	4.583	2.62	6.17	1.31
1.500	7.87	3.083	17.06	4.667	2.62	6.25	1.31
1.583	7.87	3.167	17.06	4.750	2.62		

Max.Eff.Inten.(mm/hr)= 60.35 43.45
 over (min) 5.00 15.00
 Storage Coeff. (min)= 2.33 (ii) 12.18 (ii)
 Unit Hyd. Tpeak (min)= 5.00 15.00
 Unit Hyd. peak (cms)= 0.30 0.09

PEAK FLOW (cms)= 0.07 0.01 *TOTALS*
 TIME TO PEAK (hrs)= 2.75 2.83 0.084 (iii)
 RUNOFF VOLUME (mm)= 64.59 37.71 57.86
 TOTAL RAINFALL (mm)= 65.59 65.59 65.59
 RUNOFF COEFFICIENT = 0.98 0.57 0.88

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

CALIB	Area (ha)= 0.53
STANDHYD (0003)	Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00
ID= 1 DT= 5.0 min	

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.40	0.13
Dep. Storage (mm)=	1.00	1.50
Average slope (%)=	1.00	2.00
Length (m)=	59.44	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	0.00	1.667	7.87	3.250	17.06	4.83	1.31
0.167	0.00	1.750	7.87	3.333	9.18	4.92	1.31
0.250	0.00	1.833	22.30	3.417	9.18	5.00	1.31
0.333	1.31	1.917	22.30	3.500	9.18	5.08	1.31
0.417	1.31	2.000	22.30	3.583	9.18	5.17	1.31
0.500	1.31	2.083	22.30	3.667	9.18	5.25	1.31
0.583	1.31	2.167	22.30	3.750	9.18	5.33	1.31
0.667	1.31	2.250	22.30	3.833	5.25	5.42	1.31
0.750	1.31	2.333	60.35	3.917	5.25	5.50	1.31
0.833	1.31	2.417	60.35	4.000	5.25	5.58	1.31
0.917	1.31	2.500	60.35	4.083	5.25	5.67	1.31
1.000	1.31	2.583	60.35	4.167	5.25	5.75	1.31

VO FULL RESULTS.txt								
1.083	1.31	2.667	60.35	4.250	5.25	5.83	1.31	
1.167	1.31	2.750	60.35	4.333	2.62	5.92	1.31	
1.250	1.31	2.833	17.06	4.417	2.62	6.00	1.31	
1.333	7.87	2.917	17.06	4.500	2.62	6.08	1.31	
1.417	7.87	3.000	17.06	4.583	2.62	6.17	1.31	
1.500	7.87	3.083	17.06	4.667	2.62	6.25	1.31	
1.583	7.87	3.167	17.06	4.750	2.62			

Max.Eff.Inten.(mm/hr)=	60.35	43.45	
over (min)	5.00	15.00	
Storage Coeff. (min)=	2.29 (ii)	12.14 (ii)	
Unit Hyd. Tpeak (min)=	5.00	15.00	
Unit Hyd. peak (cms)=	0.30	0.09	
			TOTALS
PEAK FLOW (cms)=	0.07	0.01	0.079 (iii)
TIME TO PEAK (hrs)=	2.75	2.83	2.75
RUNOFF VOLUME (mm)=	64.59	37.71	57.86
TOTAL RAINFALL (mm)=	65.59	65.59	65.59
RUNOFF COEFFICIENT =	0.98	0.57	0.88

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

ADD HYD (0004)					
1 + 2 = 3					
	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	
ID1= 1 (0001):	5.91	0.874	2.75	57.87	
+ ID2= 2 (0002):	0.56	0.084	2.75	57.86	
<hr/>					
ID = 3 (0004):	6.47	0.958	2.75	57.87	

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

ADD HYD (0004)					
3 + 2 = 1					
	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	
ID1= 3 (0004):	6.47	0.958	2.75	57.87	
+ ID2= 2 (0003):	0.53	0.079	2.75	57.86	
<hr/>					
ID = 1 (0004):	7.00	1.037	2.75	57.87	

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

RESERVOIR(0005)		OVERFLOW IS OFF			
IN= 2---> OUT= 1					
DT= 5.0 min					
	OUTFLOW (cms)	STORAGE (ha.m.)		OUTFLOW (cms)	STORAGE (ha.m.)
	0.0000	0.0000		0.1730	0.3700
	0.0550	0.1600		0.2100	0.4000
	0.1000	0.2450		0.6800	0.4500

AREA	QPEAK	TPEAK	R.V.
------	-------	-------	------

VO FULL RESULTS.txt
 (ha) (cms) (hrs) (mm)
 INFLOW : ID= 2 (0004) 7.000 1.037 2.75 57.87
 OUTFLOW: ID= 1 (0005) 7.000 0.133 3.83 57.76

PEAK FLOW REDUCTION [Qout/Qin](%)= 12.86
 TIME SHIFT OF PEAK FLOW (min)= 65.00
 MAXIMUM STORAGE USED (ha.m.)= 0.3022

```

V   V   I   SSSSS   U   U   A   L           (v 6.2.2000)
V   V   I   SS      U   U   A A  L
V   V   I   SS      U   U   AAAAA L
V   V   I   SS      U   U   A   A  L
VV      I   SSSSS   UUUUU   A   A  LLLLL

000   TTTT   TTTT   H   H   Y   Y   M   M   000   TM
O   O   T   T   H   H   Y Y   MM MM   O   O
O   O   T   T   H   H   Y   M   M   O   O
000   T   T   H   H   Y   M   M   000

```

Developed and Distributed by Smart City Water Inc
 Copyright 2007 - 2020 Smart City Water Inc
 All rights reserved.

***** D E T A I L E D O U T P U T *****

Input filename: C:\Program Files (x86)\Visual OTTHYMO 6.2\VO2\voin.dat

Output filename:

C:\Users\Shuchi\AppData\Local\Civica\vh5\8e061c4e-0b2b-4d34-afcd-b9145e333507\4738c921-65d2-4f1f-a66b-60ce0e3f3730\scena

Summary filename:

C:\Users\Shuchi\AppData\Local\Civica\vh5\8e061c4e-0b2b-4d34-afcd-b9145e333507\4738c921-65d2-4f1f-a66b-60ce0e3f3730\scena

DATE: 01/06/2021

TIME: 11:06:08

USER:

COMMENTS: _____

```

*****
** SIMULATION : 5 Year 6 Hour AES (Bloor, TRC **
*****

```

READ STORM	Filename: C:\Users\Shuchi\AppData\Local\Temp\1e2bf10e-aa06-4302-9fc0-7340cb56677d\34c151e3
Ptotal= 47.81 mm	Comments: 5 Year 6 Hour AES (Bloor, TRCA)

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
------	------	------	------	------	------	------	------

VO FULL RESULTS.txt							
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.25	0.00	2.00	16.25	3.75	6.69	5.50	0.96
0.50	0.96	2.25	16.25	4.00	3.82	5.75	0.96
0.75	0.96	2.50	43.98	4.25	3.82	6.00	0.96
1.00	0.96	2.75	43.98	4.50	1.91	6.25	0.96
1.25	0.96	3.00	12.43	4.75	1.91		
1.50	5.74	3.25	12.43	5.00	0.96		
1.75	5.74	3.50	6.69	5.25	0.96		

CALIB							
STANDHYD (0001)	Area	(ha)=	5.91				
ID= 1 DT= 5.0 min	Total Imp(%)=	75.00	Dir. Conn.(%)=	75.00			

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	4.43	1.48
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	198.49	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	0.00	1.667	5.74	3.250	12.43	4.83	0.96
0.167	0.00	1.750	5.74	3.333	6.69	4.92	0.96
0.250	0.00	1.833	16.25	3.417	6.69	5.00	0.96
0.333	0.96	1.917	16.25	3.500	6.69	5.08	0.96
0.417	0.96	2.000	16.25	3.583	6.69	5.17	0.96
0.500	0.96	2.083	16.25	3.667	6.69	5.25	0.96
0.583	0.96	2.167	16.25	3.750	6.69	5.33	0.96
0.667	0.96	2.250	16.25	3.833	3.82	5.42	0.96
0.750	0.96	2.333	43.98	3.917	3.82	5.50	0.96
0.833	0.96	2.417	43.98	4.000	3.82	5.58	0.96
0.917	0.96	2.500	43.98	4.083	3.82	5.67	0.96
1.000	0.96	2.583	43.98	4.167	3.82	5.75	0.96
1.083	0.96	2.667	43.98	4.250	3.82	5.83	0.96
1.167	0.96	2.750	43.98	4.333	1.91	5.92	0.96
1.250	0.96	2.833	12.43	4.417	1.91	6.00	0.96
1.333	5.74	2.917	12.43	4.500	1.91	6.08	0.96
1.417	5.74	3.000	12.43	4.583	1.91	6.17	0.96
1.500	5.74	3.083	12.43	4.667	1.91	6.25	0.96
1.583	5.74	3.167	12.43	4.750	1.91		

Max.Eff.Inten.(mm/hr)=	43.98	26.72	
over (min)	5.00	20.00	
Storage Coeff. (min)=	5.35 (ii)	17.32 (ii)	
Unit Hyd. Tpeak (min)=	5.00	20.00	
Unit Hyd. peak (cms)=	0.21	0.06	
			TOTALS
PEAK FLOW (cms)=	0.54	0.08	0.609 (iii)
TIME TO PEAK (hrs)=	2.75	2.92	2.75
RUNOFF VOLUME (mm)=	46.81	23.53	40.99
TOTAL RAINFALL (mm)=	47.81	47.81	47.81
RUNOFF COEFFICIENT =	0.98	0.49	0.86

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:

VO FULL RESULTS.txt

- CN* = 85.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

CALIB
STANDHYD (0002)
ID= 1 DT= 5.0 min

Area (ha)= 0.56
Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00

IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 0.42 0.14
Dep. Storage (mm)= 1.00 1.50
Average slope (%)= 1.00 2.00
Length (m)= 61.10 40.00
Mannings n = 0.013 0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.083	0.00	1.667	5.74	3.250	12.43	4.83	0.96
0.167	0.00	1.750	5.74	3.333	6.69	4.92	0.96
0.250	0.00	1.833	16.25	3.417	6.69	5.00	0.96
0.333	0.96	1.917	16.25	3.500	6.69	5.08	0.96
0.417	0.96	2.000	16.25	3.583	6.69	5.17	0.96
0.500	0.96	2.083	16.25	3.667	6.69	5.25	0.96
0.583	0.96	2.167	16.25	3.750	6.69	5.33	0.96
0.667	0.96	2.250	16.25	3.833	3.82	5.42	0.96
0.750	0.96	2.333	43.98	3.917	3.82	5.50	0.96
0.833	0.96	2.417	43.98	4.000	3.82	5.58	0.96
0.917	0.96	2.500	43.98	4.083	3.82	5.67	0.96
1.000	0.96	2.583	43.98	4.167	3.82	5.75	0.96
1.083	0.96	2.667	43.98	4.250	3.82	5.83	0.96
1.167	0.96	2.750	43.98	4.333	1.91	5.92	0.96
1.250	0.96	2.833	12.43	4.417	1.91	6.00	0.96
1.333	5.74	2.917	12.43	4.500	1.91	6.08	0.96
1.417	5.74	3.000	12.43	4.583	1.91	6.17	0.96
1.500	5.74	3.083	12.43	4.667	1.91	6.25	0.96
1.583	5.74	3.167	12.43	4.750	1.91		

Max.Eff.Inten.(mm/hr)= 43.98 26.72
over (min) 5.00 15.00
Storage Coeff. (min)= 2.64 (ii) 14.61 (ii)
Unit Hyd. Tpeak (min)= 5.00 15.00
Unit Hyd. peak (cms)= 0.29 0.08

PEAK FLOW (cms)= 0.05 0.01 0.059 (iii)
TIME TO PEAK (hrs)= 2.75 2.83 2.75
RUNOFF VOLUME (mm)= 46.81 23.53 40.98
TOTAL RAINFALL (mm)= 47.81 47.81 47.81
RUNOFF COEFFICIENT = 0.98 0.49 0.86

TOTALS

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

VO FULL RESULTS.txt

CALIB
STANDHYD (0003)
ID= 1 DT= 5.0 min

Area (ha)= 0.53
Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	0.40	0.13
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	59.44	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	0.00	1.667	5.74	3.250	12.43	4.83	0.96
0.167	0.00	1.750	5.74	3.333	6.69	4.92	0.96
0.250	0.00	1.833	16.25	3.417	6.69	5.00	0.96
0.333	0.96	1.917	16.25	3.500	6.69	5.08	0.96
0.417	0.96	2.000	16.25	3.583	6.69	5.17	0.96
0.500	0.96	2.083	16.25	3.667	6.69	5.25	0.96
0.583	0.96	2.167	16.25	3.750	6.69	5.33	0.96
0.667	0.96	2.250	16.25	3.833	3.82	5.42	0.96
0.750	0.96	2.333	43.98	3.917	3.82	5.50	0.96
0.833	0.96	2.417	43.98	4.000	3.82	5.58	0.96
0.917	0.96	2.500	43.98	4.083	3.82	5.67	0.96
1.000	0.96	2.583	43.98	4.167	3.82	5.75	0.96
1.083	0.96	2.667	43.98	4.250	3.82	5.83	0.96
1.167	0.96	2.750	43.98	4.333	1.91	5.92	0.96
1.250	0.96	2.833	12.43	4.417	1.91	6.00	0.96
1.333	5.74	2.917	12.43	4.500	1.91	6.08	0.96
1.417	5.74	3.000	12.43	4.583	1.91	6.17	0.96
1.500	5.74	3.083	12.43	4.667	1.91	6.25	0.96
1.583	5.74	3.167	12.43	4.750	1.91		

Max.Eff.Inten.(mm/hr)=	43.98	26.72
over (min)	5.00	15.00
Storage Coeff. (min)=	2.60 (ii)	14.56 (ii)
Unit Hyd. Tpeak (min)=	5.00	15.00
Unit Hyd. peak (cms)=	0.29	0.08

TOTALS

PEAK FLOW (cms)=	0.05	0.01	0.056 (iii)
TIME TO PEAK (hrs)=	2.75	2.83	2.75
RUNOFF VOLUME (mm)=	46.81	23.53	40.98
TOTAL RAINFALL (mm)=	47.81	47.81	47.81
RUNOFF COEFFICIENT =	0.98	0.49	0.86

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

VO FULL RESULTS.txt

ADD HYD (0004)	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
1 + 2 = 3				
ID1= 1 (0001):	5.91	0.609	2.75	40.99
+ ID2= 2 (0002):	0.56	0.059	2.75	40.98
ID = 3 (0004):	6.47	0.668	2.75	40.99

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

ADD HYD (0004)	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
3 + 2 = 1				
ID1= 3 (0004):	6.47	0.668	2.75	40.99
+ ID2= 2 (0003):	0.53	0.056	2.75	40.98
ID = 1 (0004):	7.00	0.724	2.75	40.99

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

RESERVOIR(0005)	OUTFLOW (cms)	STORAGE (ha.m.)	OUTFLOW (cms)	STORAGE (ha.m.)
IN= 2---> OUT= 1	0.0000	0.0000	0.1730	0.3700
DT= 5.0 min	0.0550	0.1600	0.2100	0.4000
	0.1000	0.2450	0.6800	0.4500

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW : ID= 2 (0004)	7.000	0.724	2.75	40.99
OUTFLOW: ID= 1 (0005)	7.000	0.085	3.92	40.88

PEAK FLOW REDUCTION [Qout/Qin](%)= 11.79
 TIME SHIFT OF PEAK FLOW (min)= 70.00
 MAXIMUM STORAGE USED (ha.m.)= 0.2174

V V I SSSSS U U A L (v 6.2.2000)
 V V I SS U U A A L
 V V I SS U U A A A A A L
 V V I SS U U A A L
 VV I SSSSS UUUUU A A LLLLL

000 TTTTT TTTTT H H Y Y M M 000 TM
 0 0 T T H H Y Y MM MM 0 0
 0 0 T T H H Y M M 0 0
 000 T T H H Y M M 000

Developed and Distributed by Smart City Water Inc
 Copyright 2007 - 2020 Smart City Water Inc
 All rights reserved.

***** D E T A I L E D O U T P U T *****

Input filename: C:\Program Files (x86)\Visual OTTHYMO 6.2\VO2\voin.dat
 Page 23

VO FULL RESULTS.txt

Output filename:
C:\Users\Shuchi\AppData\Local\Civica\XH5\8e061c4e-0b2b-4d34-afcd-b9145e333507\93e85b79-b36e-418e-9f46-0d6a14682991\scena

Summary filename:
C:\Users\Shuchi\AppData\Local\Civica\XH5\8e061c4e-0b2b-4d34-afcd-b9145e333507\93e85b79-b36e-418e-9f46-0d6a14682991\scena

DATE: 01/06/2021

TIME: 11:06:08

USER:

COMMENTS: _____

** SIMULATION : 50 Year 6 Hour AES (Bloor, TR **

READ STORM	Filename: C:\Users\Shuchi\AppData\Local\Temp\1e2bf10e-aa06-4302-9fc0-7340cb56677d\90de704
Ptotal= 73.00 mm	Comments: 50 Year 6 Hour AES (Bloor, TRCA)

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.25	0.00	2.00	24.82	3.75	10.22	5.50	1.46
0.50	1.46	2.25	24.82	4.00	5.84	5.75	1.46
0.75	1.46	2.50	67.16	4.25	5.84	6.00	1.46
1.00	1.46	2.75	67.16	4.50	2.92	6.25	1.46
1.25	1.46	3.00	18.98	4.75	2.92		
1.50	8.76	3.25	18.98	5.00	1.46		
1.75	8.76	3.50	10.22	5.25	1.46		

CALIB STANDHYD (0001) ID= 1 DT= 5.0 min	Area (ha)= 5.91 Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00
--	--

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	4.43	1.48
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	198.49	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
0.083	0.00	1.667	8.76	3.250	18.98	4.83	1.46
0.167	0.00	1.750	8.76	3.333	10.22	4.92	1.46

VO FULL RESULTS.txt							
0.250	0.00	1.833	24.82	3.417	10.22	5.00	1.46
0.333	1.46	1.917	24.82	3.500	10.22	5.08	1.46
0.417	1.46	2.000	24.82	3.583	10.22	5.17	1.46
0.500	1.46	2.083	24.82	3.667	10.22	5.25	1.46
0.583	1.46	2.167	24.82	3.750	10.22	5.33	1.46
0.667	1.46	2.250	24.82	3.833	5.84	5.42	1.46
0.750	1.46	2.333	67.16	3.917	5.84	5.50	1.46
0.833	1.46	2.417	67.16	4.000	5.84	5.58	1.46
0.917	1.46	2.500	67.16	4.083	5.84	5.67	1.46
1.000	1.46	2.583	67.16	4.167	5.84	5.75	1.46
1.083	1.46	2.667	67.16	4.250	5.84	5.83	1.46
1.167	1.46	2.750	67.16	4.333	2.92	5.92	1.46
1.250	1.46	2.833	18.98	4.417	2.92	6.00	1.46
1.333	8.76	2.917	18.98	4.500	2.92	6.08	1.46
1.417	8.76	3.000	18.98	4.583	2.92	6.17	1.46
1.500	8.76	3.083	18.98	4.667	2.92	6.25	1.46
1.583	8.76	3.167	18.98	4.750	2.92		

Max.Eff.Inten.(mm/hr)= 67.16 50.27
over (min) 5.00 15.00
Storage Coeff. (min)= 4.52 (ii) 13.81 (ii)
Unit Hyd. Tpeak (min)= 5.00 15.00
Unit Hyd. peak (cms)= 0.23 0.08

PEAK FLOW (cms)= 0.83 0.16 *TOTALS*
TIME TO PEAK (hrs)= 2.75 2.83 0.983 (iii)
RUNOFF VOLUME (mm)= 72.00 43.95 64.99
TOTAL RAINFALL (mm)= 73.00 73.00 73.00
RUNOFF COEFFICIENT = 0.99 0.60 0.89

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

CALIB	Area (ha)= 0.56
STANDHYD (0002)	Total Imp(%)= 75.00 Dir. Conn.(%)= 75.00
ID= 1 DT= 5.0 min	

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.42	0.14
Dep. Storage (mm)=	1.00	1.50
Average slope (%)=	1.00	2.00
Length (m)=	61.10	40.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	0.00	1.667	8.76	3.250	18.98	4.83	1.46
0.167	0.00	1.750	8.76	3.333	10.22	4.92	1.46
0.250	0.00	1.833	24.82	3.417	10.22	5.00	1.46
0.333	1.46	1.917	24.82	3.500	10.22	5.08	1.46
0.417	1.46	2.000	24.82	3.583	10.22	5.17	1.46
0.500	1.46	2.083	24.82	3.667	10.22	5.25	1.46

VO FULL RESULTS.txt							
0.583	1.46	2.167	24.82	3.750	10.22	5.33	1.46
0.667	1.46	2.250	24.82	3.833	5.84	5.42	1.46
0.750	1.46	2.333	67.16	3.917	5.84	5.50	1.46
0.833	1.46	2.417	67.16	4.000	5.84	5.58	1.46
0.917	1.46	2.500	67.16	4.083	5.84	5.67	1.46
1.000	1.46	2.583	67.16	4.167	5.84	5.75	1.46
1.083	1.46	2.667	67.16	4.250	5.84	5.83	1.46
1.167	1.46	2.750	67.16	4.333	2.92	5.92	1.46
1.250	1.46	2.833	18.98	4.417	2.92	6.00	1.46
1.333	8.76	2.917	18.98	4.500	2.92	6.08	1.46
1.417	8.76	3.000	18.98	4.583	2.92	6.17	1.46
1.500	8.76	3.083	18.98	4.667	2.92	6.25	1.46
1.583	8.76	3.167	18.98	4.750	2.92		

Max.Eff.Inten.(mm/hr)=	67.16	50.27	
over (min)	5.00	15.00	
Storage Coeff. (min)=	2.23 (ii)	11.52 (ii)	
Unit Hyd. Tpeak (min)=	5.00	15.00	
Unit Hyd. peak (cms)=	0.30	0.09	
			TOTALS
PEAK FLOW (cms)=	0.08	0.02	0.094 (iii)
TIME TO PEAK (hrs)=	2.75	2.83	2.75
RUNOFF VOLUME (mm)=	72.00	43.95	64.97
TOTAL RAINFALL (mm)=	73.00	73.00	73.00
RUNOFF COEFFICIENT =	0.99	0.60	0.89

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
 CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
 THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

CALIB			
STANDHYD (0003)	Area (ha)= 0.53		
ID= 1 DT= 5.0 min	Total Imp(%)= 75.00	Dir. Conn.(%)= 75.00	

		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	0.40	0.13
Dep. Storage	(mm)=	1.00	1.50
Average Slope	(%)=	1.00	2.00
Length	(m)=	59.44	40.00
Mannings n	=	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 5.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----							
TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.083	0.00	1.667	8.76	3.250	18.98	4.83	1.46
0.167	0.00	1.750	8.76	3.333	10.22	4.92	1.46
0.250	0.00	1.833	24.82	3.417	10.22	5.00	1.46
0.333	1.46	1.917	24.82	3.500	10.22	5.08	1.46
0.417	1.46	2.000	24.82	3.583	10.22	5.17	1.46
0.500	1.46	2.083	24.82	3.667	10.22	5.25	1.46
0.583	1.46	2.167	24.82	3.750	10.22	5.33	1.46
0.667	1.46	2.250	24.82	3.833	5.84	5.42	1.46
0.750	1.46	2.333	67.16	3.917	5.84	5.50	1.46
0.833	1.46	2.417	67.16	4.000	5.84	5.58	1.46

VO FULL RESULTS.txt							
0.917	1.46	2.500	67.16	4.083	5.84	5.67	1.46
1.000	1.46	2.583	67.16	4.167	5.84	5.75	1.46
1.083	1.46	2.667	67.16	4.250	5.84	5.83	1.46
1.167	1.46	2.750	67.16	4.333	2.92	5.92	1.46
1.250	1.46	2.833	18.98	4.417	2.92	6.00	1.46
1.333	8.76	2.917	18.98	4.500	2.92	6.08	1.46
1.417	8.76	3.000	18.98	4.583	2.92	6.17	1.46
1.500	8.76	3.083	18.98	4.667	2.92	6.25	1.46
1.583	8.76	3.167	18.98	4.750	2.92		

Max.Eff.Inten.(mm/hr)= 67.16 50.27
over (min) 5.00 15.00
Storage Coeff. (min)= 2.19 (ii) 11.49 (ii)
Unit Hyd. Tpeak (min)= 5.00 15.00
Unit Hyd. peak (cms)= 0.31 0.09

PEAK FLOW (cms)= 0.07 0.02 *TOTALS*
TIME TO PEAK (hrs)= 2.75 2.75 0.089 (iii)
RUNOFF VOLUME (mm)= 72.00 43.95 2.75
TOTAL RAINFALL (mm)= 73.00 73.00 64.97
RUNOFF COEFFICIENT = 0.99 0.60 73.00
0.89

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

ADD HYD (0004)					
1 + 2 = 3					
	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	
ID1= 1 (0001):	5.91	0.983	2.75	64.99	
+ ID2= 2 (0002):	0.56	0.094	2.75	64.97	
<hr/>					
ID = 3 (0004):	6.47	1.077	2.75	64.98	

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

ADD HYD (0004)					
3 + 2 = 1					
	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	
ID1= 3 (0004):	6.47	1.077	2.75	64.98	
+ ID2= 2 (0003):	0.53	0.089	2.75	64.97	
<hr/>					
ID = 1 (0004):	7.00	1.166	2.75	64.98	

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

RESERVOIR(0005)		OVERFLOW IS OFF	
IN= 2---> OUT= 1			
DT= 5.0 min			
OUTFLOW (cms)	STORAGE (ha.m.)	OUTFLOW (cms)	STORAGE (ha.m.)
0.0000	0.0000	0.1730	0.3700
0.0550	0.1600	0.2100	0.4000
0.1000	0.2450	0.6800	0.4500

VO FULL RESULTS.txt

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW : ID= 2 (0004)	7.000	1.166	2.75	64.98
OUTFLOW: ID= 1 (0005)	7.000	0.154	3.83	64.88

PEAK FLOW REDUCTION [Qout/Qin] (%) = 13.20
 TIME SHIFT OF PEAK FLOW (min) = 65.00
 MAXIMUM STORAGE USED (ha.m.) = 0.3375

APPENDIX “F”

Sanitary Sewer Design Sheets for Proposed Subdivision; Region of Peel *Connections Multi-Use Demand Tables*

CHICKADEE GROVE COMMUNITY
TOWN OF CALEDON

SANITARY SEWER DESIGN SUNDIAL HOMES PHASE 11																	
CANDEVCON LIMITED																	
CONSULTING ENGINEERS AND PLANNERS																	
LOCATION			From	To	Area	Area	Density	Population	Cumulative	Cumulative	Sewage	Infiltration	Total **	Length	Pipe Dia.	PREPARED BY:	F.S
		MH	MHA	No.	(ha)	(ppha)	(Equivalent)	Area (ha)	Population	Flow (1)	Flow (2)	Flow (1+2)	(m)	(mm)	%	Capacity	Velocity
STREET A		MH1A	MH2A	1	0.19	175	33	0.19	33	0.013	0.00004	0.01304	23	250	1.00%	0.059	1.21
STREET A		MH2A	MH3A	2	0.39	175	68	0.58	102	0.013	0.00012	0.01312	78.2	250	0.50%	0.042	0.86
STREET A		MH3A	MH4A	3	0.66	175	116	1.24	217	0.013	0.00025	0.01325	78.2	250	0.50%	0.042	0.86
STREET A		MH4A	MH5A	4	0.28	175	49	1.52	266	0.013	0.00030	0.01330	36.6	250	0.50%	0.042	0.86
STREET A		MH5A	MH6A	5	0.45	175	79	1.97	345	0.013	0.00039	0.01339	67.8	250	0.50%	0.042	0.86
STREET B		MH10A	MH11A	6	0.22	175	39	0.22	39	0.013	0.00004	0.01304	26.2	250	0.50%	0.042	0.86
STREET B		MH11A	MH12A	15	0.50	175	88	0.72	126	0.013	0.00014	0.01314	100	250	0.50%	0.042	0.86
GLASGOW ROAD		MH7A	MH8A	14	0.21	175	37	0.21	37	0.013	0.00004	0.01304	32.6	250	1.00%	0.059	1.21
GLASGOW ROAD		MH8A	MH9A	7	0.37	175	65	0.58	102	0.013	0.00012	0.01312	100	250	0.50%	0.042	0.86
STREET C		MH13A	MH14A	13	0.25	175	44	0.25	44	0.013	0.00005	0.01305	42	250	1.00%	0.059	1.21
STREET C		MH14A	MH9A	16	0.48	175	84	0.73	128	0.013	0.00015	0.01315	100	250	0.50%	0.042	0.86
CHICKADEE LANE		MH9A	MH12A	8	0.37	175	65	1.68	294	0.013	0.00034	0.01334	85.5	250	0.50%	0.042	0.86
STREET D		MH15A	MH12A	11	0.55	175	96	0.55	96	0.013	0.00011	0.01311	57.7	250	1.00%	0.059	1.21
CHICKADEE LANE		MH12A	MH6A	9	0.44	175	77	3.39	593	0.013	0.00068	0.01368	98	250	0.50%	0.042	0.86
STREET C		MH16A	MH17A	12	0.51	175	89	0.51	89	0.013	0.00010	0.01310	51.5	250	1.00%	0.059	1.21
STREET C		MH17A	MH18A	10	0.38	175	67	0.89	156	0.013	0.00018	0.01318	90.4	250	0.50%	0.042	0.86
STREET C		MH18A	MH6A	0	0.00	175	0	0.89	156	0.013	0.00018	0.01318	28.8	250	0.50%	0.042	0.86
CHICKADEE LANE		MH6A	MH19A	0	0.00	175	0	6.25	1094	0.014	0.00125	0.01525	75	250	0.50%	0.042	0.86
CHICKADEE LANE		MH19A	MH20A	0	0.00	175	0	6.25	1094	0.014	0.00125	0.01525	100	250	0.50%	0.042	0.86
CHICKADEE LANE		MH20A	MH21A	0	0.00	175	0	6.25	1094	0.014	0.00125	0.01525	100	250	0.50%	0.042	0.86
CHICKADEE LANE		MH21A	MH22A	0	0.00	175	0	6.25	1094	0.014	0.00125	0.01525	100	250	0.50%	0.042	0.86
CHICKADEE LANE		MH22A	EXMH	0	0.00	175	0	6.25	1094	0.014	0.00125	0.01525	46	250	0.50%	0.042	0.86
CHICKADEE LANE		EXMH	EXMH	0	0.00	175	0	6.25	1094	0.014	0.00125	0.01525	100	250	0.50%	0.042	0.86
CHECK					6.25	0.00											

Connection Single Use Demand Table

WATER CONNECTION

Connection point ³⁾			
Existing 300mm dia water-main on Glasgow Road and Chickadee Lane			
Pressure zone of connection point		Pressure Zone 6	
Total equivalent population to be serviced ¹⁾		487	
Total lands to be serviced		6.25 ha	
Hydrant flow test			
	Hydrant flow test location	13977 CHICKADEE LANE	
	Pressure (kPa)	Flow (in l/s)	Time
Minimum water pressure	303 (44psi)	59.75	1:00 PM
Maximum water pressure	331 (48psi)	81.38	1:00 PM

No.	Water demands		
	Demand type	Demand	Units
1	Average day flow	1.58	l/s
2	Maximum day flow	3.16	l/s
3	Peak hour flow	4.73	l/s
4	Fire flow ²⁾	180*	l/s
Analysis			
5	Maximum day plus fire flow	183.16	l/s

*Typical for residential development

WASTEWATER CONNECTION

Connection point ⁴⁾ Existing 375mm dia sewer on Emil Kolb Parkway	
Total equivalent population to be serviced ¹⁾	
Total lands to be serviced	
6	Wastewater sewer effluent (in l/s)

**Average flow including infiltration

- ¹⁾ The calculations should be based on the development estimated population (employment or residential).
²⁾ Please reference the Fire Underwriters Survey Document
³⁾ Please specify the connection point ID
⁴⁾ Please specify the connection point (wastewater line or manhole ID)
 Also, the "total equivalent population to be serviced" and the "total lands to be serviced" should reference the connection point. (The FSR should contain one copy of Site Servicing Plan)

Please include the graphs associated with the hydrant flow test information table
 Please provide Professional Engineer's signature and stamp on the demand table
 All required calculations must be submitted with the demand table submission.



APPENDIX “G”

Hydrant Flow Test

Region of Peel Connections Multi-Use Demand Table



5-200 Connie Cres. Concord ON L4K 1M1 Phone 416-883-9777 Fax 905-303-6977


FLOW TEST REPORT

LOCATION OF RESIDUAL HYDRANT 13921 CHICKADEE LANE

LOCATION OF FLOW HYDRANT 13977 CHICKADEE LANE

TIME OF TEST 1:00 WATERMAIN SIZE 300 mm STATIC PRESSURE 60 psi

NUMBER OF OUTLETS	PITOT PRESSURE	FLOW (US G.P.M.)	RESIDUAL PRESSURE
One 2 1/2" hydrant port	32 psi	947	48 psi
Two 2 1/2" hydrant port	15 psi	1297	44 psi

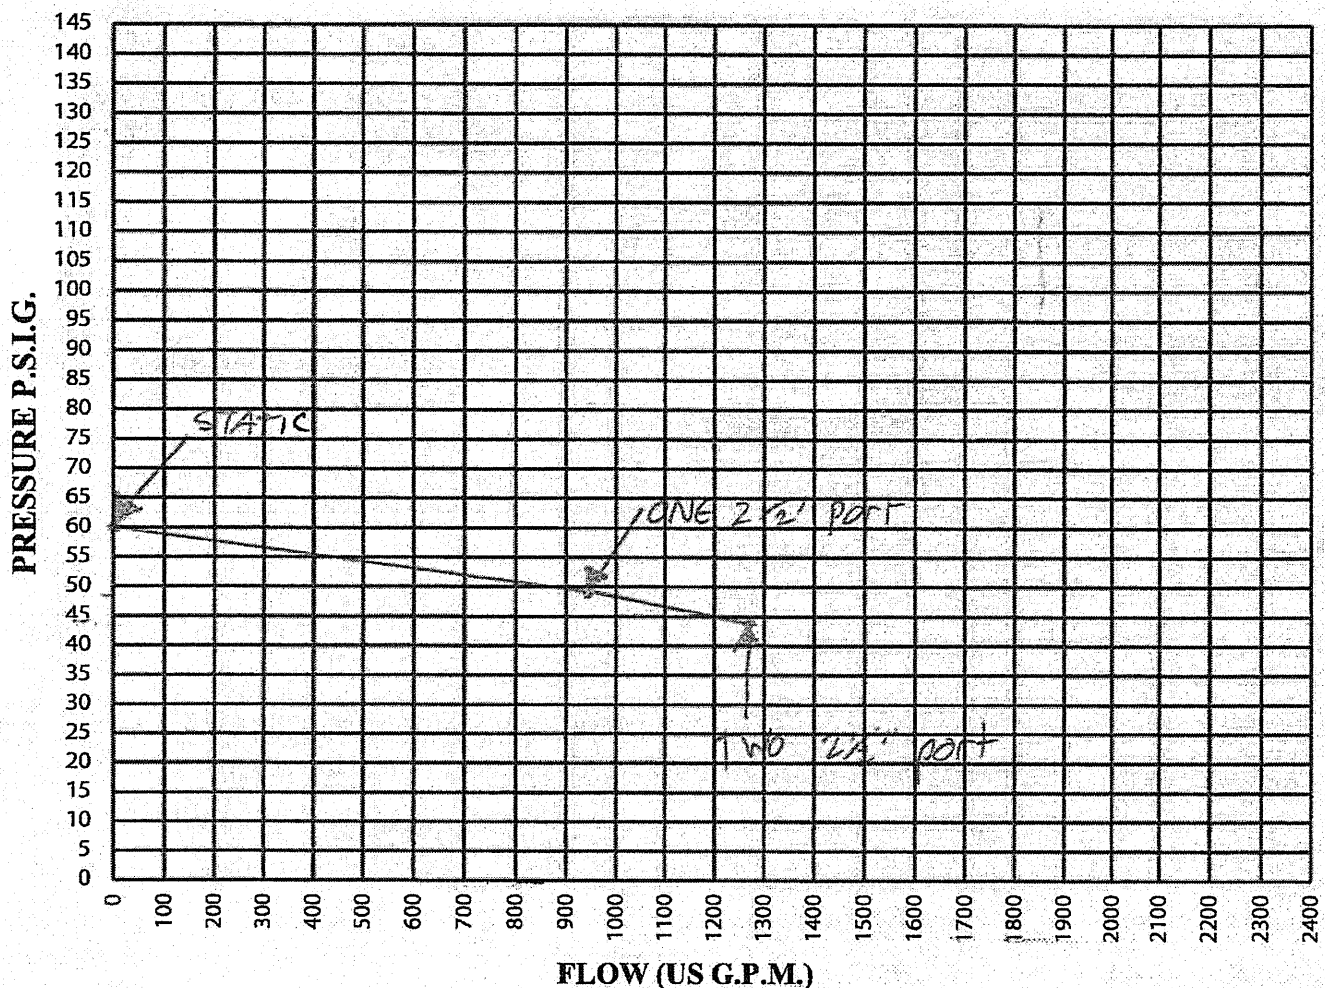

PROJECT LOCATION CHICKADEE Lane & Glasgow Rd

DATE 04/09/18

COMPANY NAME BROOKVALLEY PROJECT MANAGEMENT
(PRINT NAME)

AQUAZITION EMPLOYEE Nick Gruciel
(PRINT NAME)

Connection Single Use Demand Table

WATER CONNECTION

Connection point ³⁾			
Existing 300mm dia water-main on Glasgow Road and Chickadee Lane			
Pressure zone of connection point		Pressure Zone 6	
Total equivalent population to be serviced ¹⁾		487	
Total lands to be serviced		6.25 ha	
Hydrant flow test			
	Hydrant flow test location	13977 CHICKADEE LANE	
	Pressure (kPa)	Flow (in l/s)	Time
Minimum water pressure	303 (44psi)	59.75	1:00 PM
Maximum water pressure	331 (48psi)	81.38	1:00 PM

No.	Water demands		
	Demand type	Demand	Units
1	Average day flow	1.58	l/s
2	Maximum day flow	3.16	l/s
3	Peak hour flow	4.73	l/s
4	Fire flow ²⁾	180*	l/s
Analysis			
5	Maximum day plus fire flow	183.16	l/s

*Typical for residential development

WASTEWATER CONNECTION

Connection point ⁴⁾ Existing 375mm dia sewer on Emil Kolb Parkway	
Total equivalent population to be serviced ¹⁾	487
Total lands to be serviced	6.25 ha
6 Wastewater sewer effluent (in l/s)	2.96**

**Average flow including infiltration

- ¹⁾ The calculations should be based on the development estimated population (employment or residential).
²⁾ Please reference the Fire Underwriters Survey Document
³⁾ Please specify the connection point ID
⁴⁾ Please specify the connection point (wastewater line or manhole ID)
Also, the "total equivalent population to be serviced" and the "total lands to be serviced" should reference the connection point. (The FSR should contain one copy of Site Servicing Plan)

Please include the graphs associated with the hydrant flow test information table
Please provide Professional Engineer's signature and stamp on the demand table
All required calculations must be submitted with the demand table submission.

