


SIGN FACE

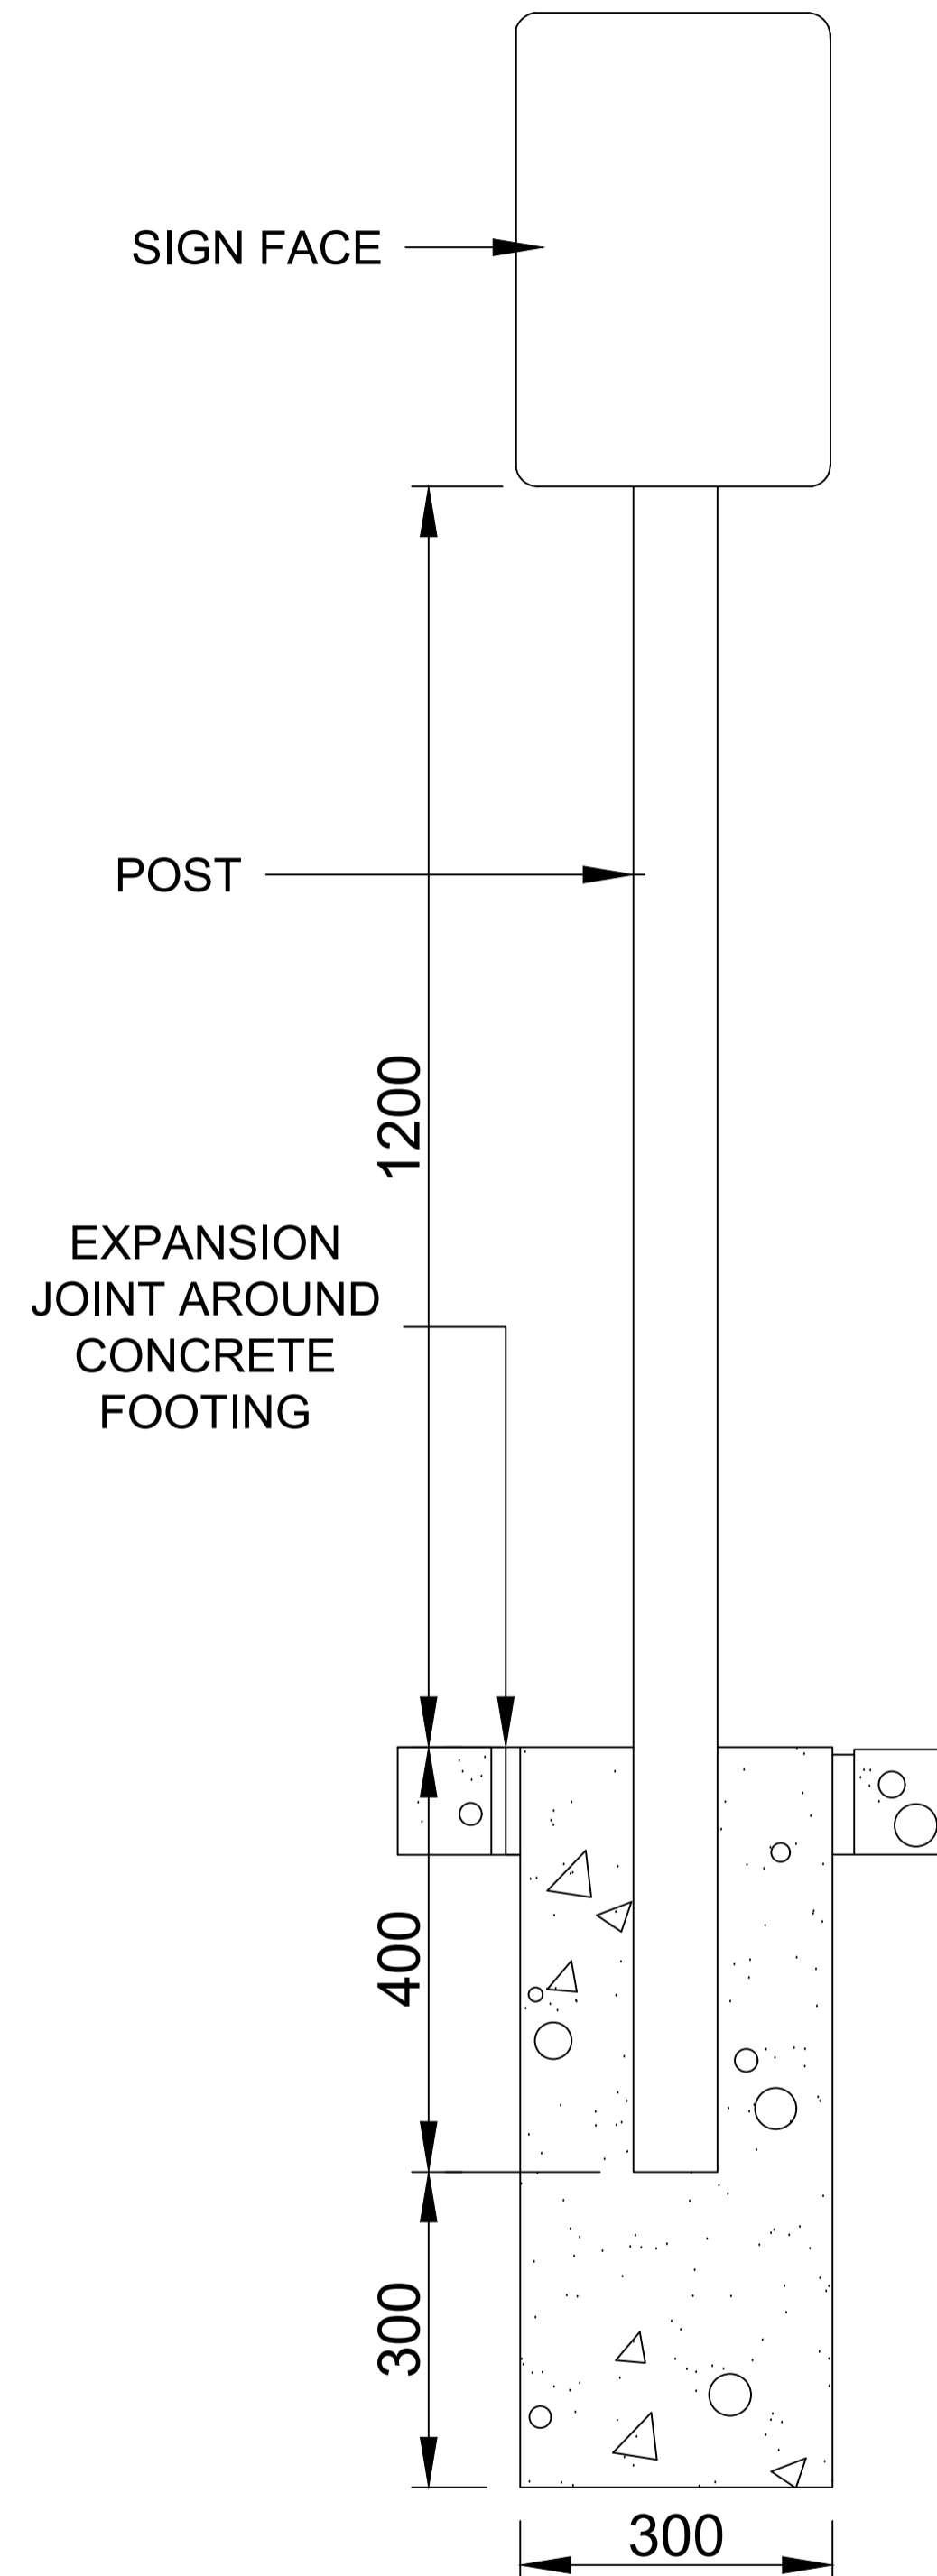

MOUNTING DETAIL

NOTE:

- ALL DIMENSIONS IN MILLIMETERS UNLESS OTHERWISE NOTED.

HANDICAPPED PARKING SIGNAGE REQUIREMENTS

- ALL HANDICAPPED PARKING STALLS SHALL BE DESIGNATED BY SIGNAGE AS PER BY-LAW 134-83
- THE REQUIRED SIGN(S) MUST BE MOUNTED AT LEAST 0.6M AND NOT MORE THAN 2.0M FROM THE FACE OF THE CURB AT THE HEIGHT OF 1.2m ABOVE THE TOP OF CURB ELEVATION. SIGNS MUST NOT OBSTRUCT THE SIDEWALK.
- WHERE AN UNOBSTRUCTED BUILDING FACE IS LOCATED NO MORE THAN 2.0M FROM THE FACE OF THE CURB AT THE HANDICAPPED BAY, THE REQUIRED SIGN(S) MAY BE MOUNTED ON THE BUILDING FACE.

SIGN FACE

- 0.084 GAUGE ALUMINUM SIGN BLANK
- WHITE BACKGROUND
- HOLES-METRO PUNCH

MOUNTING

THE SIGN FACE MUST BE SECURED

- TO A POST WITH TWO GALVANIZED 12mm HEX HEAD BOLTS AND NUTS WITH FLAT WASHERS ON BOTH SIDES.
- TO A MASONRY BUILDING FACE WITH TWO GALVANIZED 50mm LONG , 6mm DIAMETER HEX-HEAD LAG BOLTS WITH FLAT WASHERS IN LEAD SHIELD MASONRY ANCHORS.
- TO A METAL BUILDING FACE WHERE THE MINIMUM METAL THICKNESS IS 2mm WITH TWO #10 PLATED, SELF-TAPPING SHEET-METAL SCREWS WITH FLAT WASHER.

POST

- 100mm X 100mm PRESSURE TREATED WOOD, OR 75mm ø STANDARD GALVANIZED STEEL PIPE.
- POST TO BE CAST IN PLACE IN 300mm ø CONCRETE FOOTING.

TOWN OF CALEDON

ACCESSIBLE PARKING SIGNAGE

APR'D: **B.B.** DATE: **AUGUST 17**

DRAWN: **B.M.** SCALE: **N.T.S.**

STANDARD No. 1103

NO.	REVISION	APR'D	DATE