


PLAN:

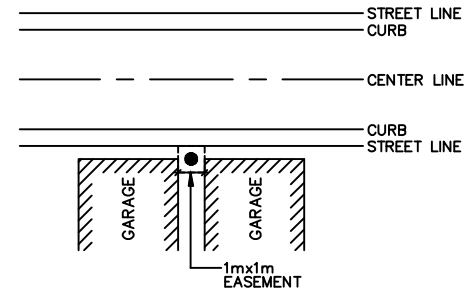

NOTES

1. THE FOLLOWING IS A MINIMUM ROAD BASE AND WILL REQUIRE A SOILS REPORT VERIFICATION
 - 40 mm HL3
 - 65 mm HL8
 - 150 mm GRANULAR "A"
 - 300 mm GRANULAR "B"
2. STREETLIGHT FIXTURE PER APPROVED TOWN STANDARD.
3. FULL LENGTH MINIMUM 100 MM DIA. SUB-DRAINS C/W FILTERCLOTH SHALL BE INSTALLED, AS PER APPROVED TOWN OF CALEDON STANDARD NO. 218.
4. SUB-GRADE SHALL BE COMPACTED TO A MINIMUM 95% OF S.P.D. AT OPTIMUM MOISTURE CONTENT.
5. WHERE POSSIBLE MANHOLE LIDS TO BE LOCATED OUT OF TIRE LANE OF TRAFFIC.
6. TRANSFORMERS TO BE LOCATED ON SIDE STREETS WHERE POSSIBLE OR ALTERNATIVELY ON EASEMENT ADJACENT TOLANEWAY.
7. STREET LIGHT POLE IN 1m x 1m EASEMENT.
8. 50m MAXIMUM POLE SPACING AND THEREFORE MAXIMUM LANEWAY LENGTH IS 50m WITHOUT LANEWAY ILLUMINATION.
9. ONLY STORM SEWERS ARE PERMITTED WITHIN LANEWAYS.
10. WHERE LANEWAYS ARE PROPOSED ADJACENT RESIDENTIAL REAR YARDS, HARD SURFACING IS TO BE INSTALLED FROM THE BACK OF CURB TO THE STREET LINE. HARD SURFACE TYPE IS AT THE DISCRETION OF THE TOWN.

TOWN OF CALEDON

8.0m LANEWAY
6.0m ROADWAY (5.4m PAVEMENT)

4	TEXT AND SLOPE REVISIONS		JULY 19	APR'D: C.C.	DATE: JUNE 08
3	DIMENSION AND TEXT REVISION		JAN. 09		
2	DIMENSION AND LAYOUT REVISION		JULY 08	DRAWN:	SCALE: N.T.S.
1	NOTES EDIT, STANDARD No. 225 NOW 200		JUNE 08		
NO.	REVISION	APR'D	DATE	STANDARD No. 200	