


## VERTICAL RISER

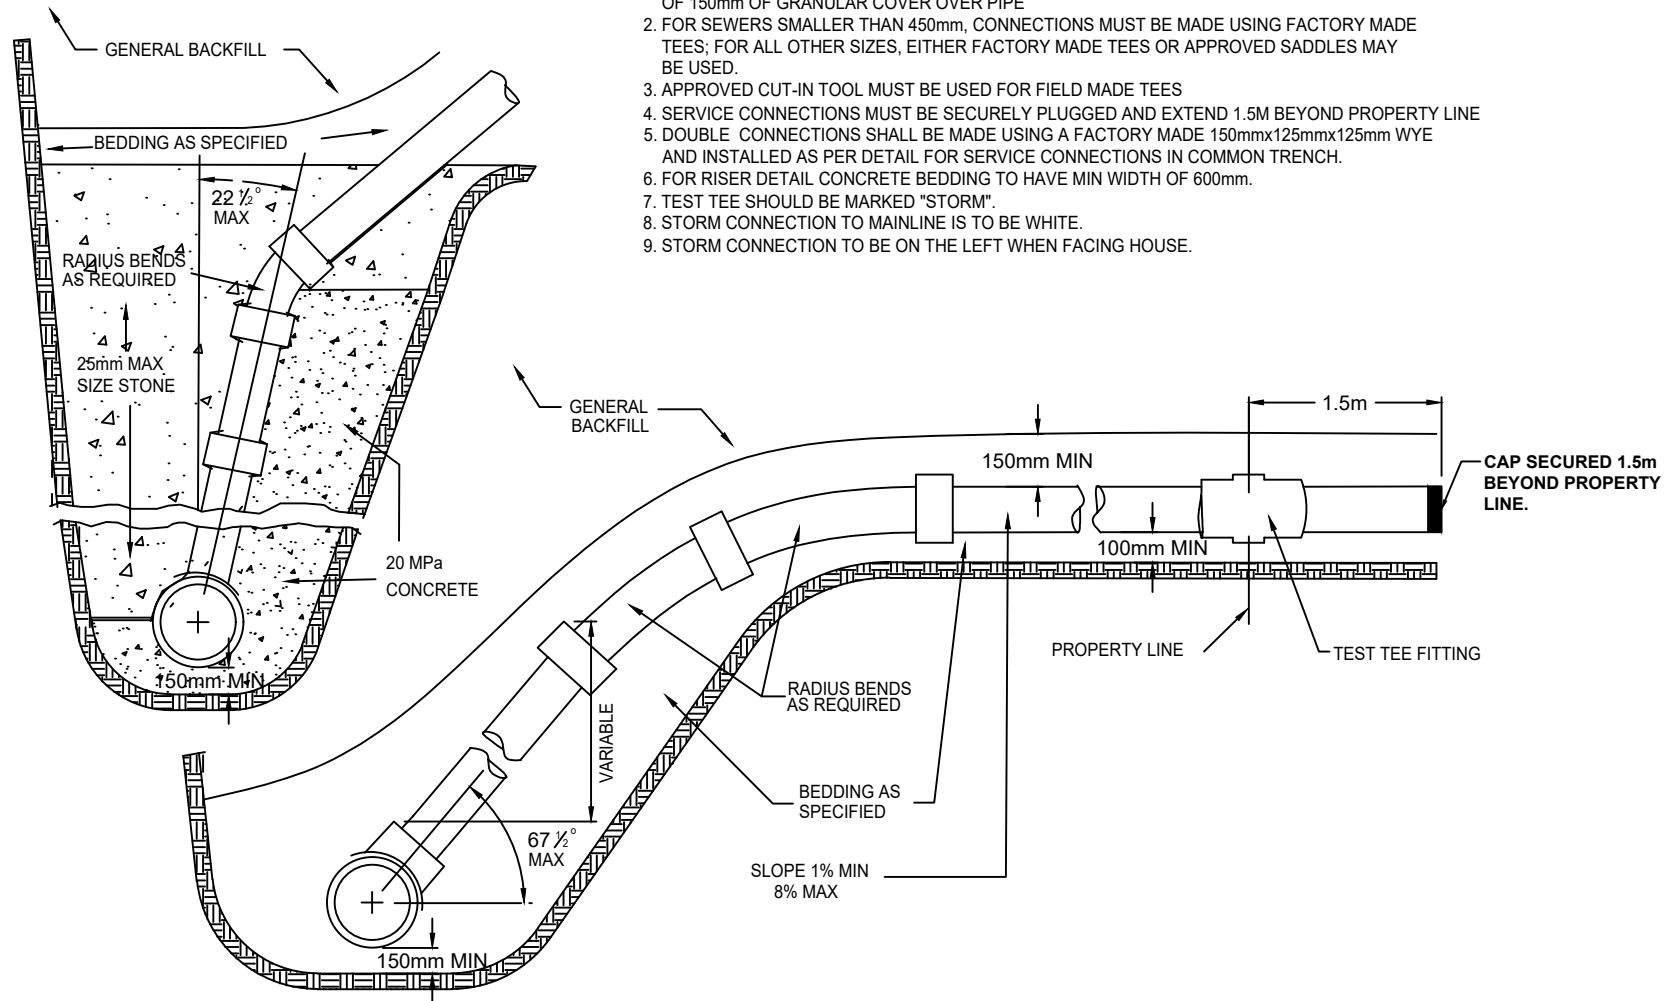

**NOTES:**

1. GRANULAR A BEDDING (OR APPROVED EQUIVALENT) TO BE PLACED TO SPRINGLINE AND MIN OF 150mm OF GRANULAR COVER OVER PIPE
2. FOR SEWERS SMALLER THAN 450mm, CONNECTIONS MUST BE MADE USING FACTORY MADE TEES; FOR ALL OTHER SIZES, EITHER FACTORY MADE TEES OR APPROVED SADDLES MAY BE USED.
3. APPROVED CUT-IN TOOL MUST BE USED FOR FIELD MADE TEES
4. SERVICE CONNECTIONS MUST BE SECURELY PLUGGED AND EXTEND 1.5M BEYOND PROPERTY LINE
5. DOUBLE CONNECTIONS SHALL BE MADE USING A FACTORY MADE 150mmx125mmx125mm WYE AND INSTALLED AS PER DETAIL FOR SERVICE CONNECTIONS IN COMMON TRENCH.
6. FOR RISER DETAIL CONCRETE BEDDING TO HAVE MIN WIDTH OF 600mm.
7. TEST TEE SHOULD BE MARKED "STORM".
8. STORM CONNECTION TO MAINLINE IS TO BE WHITE.
9. STORM CONNECTION TO BE ON THE LEFT WHEN FACING HOUSE.

TOWN OF CALEDON

**STORM SEWER  
SERVICE CONNECTION**  
FOR RIGID PIPE

NO.	REVISION	APR'D	DATE
4	DRAWING & TEXT REVISIONS		APRIL 19
3	DRAWING REVISIONS		JULY 18
2	TEXT REVISIONS		APRIL 18
1	STANDARD No. 701 NOW 501		JUNE 08

APR'D:	C.C.	DATE:	DEC 1999
DRAWN:	BJM	SCALE:	NTS
<b>STANDARD No. 501</b>			