


ELEVATION VIEW

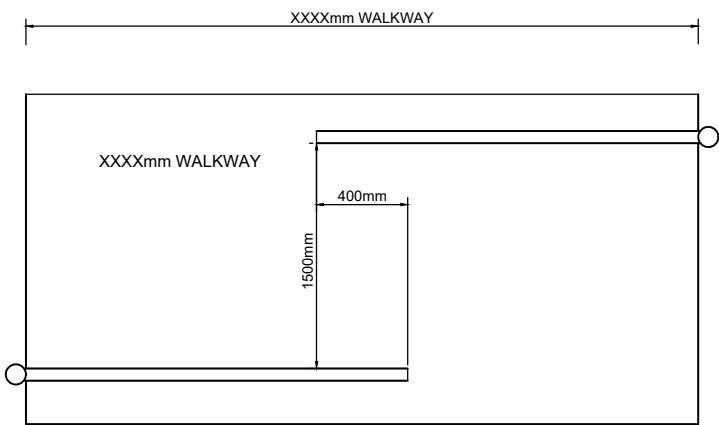

PLAN VIEW

NOTE:

1. ALL FENCE POSTS TO BE BLACK POLYETHYLENE COATED.
2. ALL PIPE WEIGHTS TO BE SCHEDULE 40.
3. CONCRETE 32MPa MIN. AFTER 28 DAYS.
4. ALL JOINTS TO BE WELDED. WELDING SHALL CONFORM TO THE LATEST ISSUE OF C.S.A. SPECIFICATIONS W59.
5. HINGE PINS TO BE STAINLESS STEEL.
6. GATE TO BE MANUFACTURED AND HOT DIP GALVANIZED.
7. ADDITIONAL BRACE ARMS NEEDED FOR GATES GREATER THAN 2000mm.
8. CONTRACTOR TO PADLOCK GATE IMMEDIATELY FOLLOWING INSTALLATION. KEYS TO BE PROVIDED TO TOWN UPON AWARD OF SUBSTANTIAL COMPLETION.
9. ALL DIMENSIONS IN MILLIMETERS UNLESS OTHERWISE NOTED.
10. 3M BRAND (OR APPROVED EQUAL) REFLECTIVE GATE ARM MARKINGS, ALTERNATING RED AND WHITE DIAMOND GRADE - 50mm WIDTH (ALONG TOP RAIL).
11. MINIMUM 6.0m WIDTH REQUIRED FOR EMERGENCY ACCESS.

TOWN OF CALEDON					APR'D: C.C.	DATE: MARCH 08
WALKWAY P-GATE WITH BRACE	3	TEXT AND DRAWING REVISION		MAY 19	DRAWN: B.B.	SCALE: N.T.S.
	2	STANDARD No. 605 NOW 609		APR 19	STANDARD No. 609	
	1	STANDARD No. 930 NOW 605		JUNE 08		
	NO.	REVISION		APR'D	DATE	